

Health and economic benefits of building ventilation interventions for reducing indoor PM_{2.5} exposure from both indoor and outdoor origins in urban Beijing, China

Article

Accepted Version

Creative Commons: Attribution-Noncommercial-No Derivative Works 4.0

Yuan, Y., Luo, Z. ORCID: <https://orcid.org/0000-0002-2082-3958>, Liu, J., Wang, Y. and Lin, Y. (2018) Health and economic benefits of building ventilation interventions for reducing indoor PM_{2.5} exposure from both indoor and outdoor origins in urban Beijing, China. *Science of the Total Environment*, 626. pp. 546-554. ISSN 0048-9697 doi: 10.1016/j.scitotenv.2018.01.119 Available at <https://centaur.reading.ac.uk/74886/>

It is advisable to refer to the publisher's version if you intend to cite from the work. See [Guidance on citing](#).

To link to this article DOI: <http://dx.doi.org/10.1016/j.scitotenv.2018.01.119>

Publisher: Elsevier

including copyright law. Copyright and IPR is retained by the creators or other copyright holders. Terms and conditions for use of this material are defined in the [End User Agreement](#).

www.reading.ac.uk/centaur

CentAUR

Central Archive at the University of Reading

Reading's research outputs online

Manuscript revised to Science of the Total Environment, Dec 2017

Health and economic benefits of building ventilation interventions for reducing indoor PM_{2.5} exposure from both indoor and outdoor origins in urban Beijing, China.

Ye Yuan^{1,2}, Zhiwen Luo^{2,*}, Jing Liu^{3,*}, Yaowu Wang¹, Yaoyu Lin¹

1. School of Architecture and Urban Planning, Harbin Institute of Technology (Shenzhen), Shenzhen, China.
2. School of the Built Environment, University of Reading, United Kingdom.
3. School of Architecture, Harbin Institute of Technology, Harbin, China.

Word count of abstract: 241

Word count of text: 5959

*Correspondence author:

Dr Zhiwen Luo, School of the Built Environment, University of Reading, United Kingdom

Email: z.luo@reading.ac.uk

Prof Jing Liu, School of Architecture, Harbin Institute of Technology, China

Email: liujinghit0@163.com

24 Nomenclature:

	Variables		Population		Subscripts
<i>A</i>	Floor area	<i>P</i>	Penetration factor	<i>BE</i>	Building energy
<i>a</i>	<i>Per capita</i> floor area	<i>p</i>	Price	<i>c</i>	Cooling
<i>ACR</i>	Air change rate	<i>Q</i>	Building energy load	<i>E</i>	Exhausted air
<i>C</i>	PM _{2.5} Concentration	<i>q</i>	Specific enthalpy of air	<i>e</i>	Electricity
<i>c</i>	Specific heat	<i>S</i>	Indoor emission rate	<i>h</i>	Heating
<i>D</i>	Electric power	<i>t</i>	Temperature	<i>I</i>	Infiltration
<i>d</i>	Humidity	<i>V</i>	Indoor volume	<i>IA</i>	Indoor air
<i>EB</i>	Economic benefit	<i>VSL</i>	Value of statistical life	<i>OA</i>	Outdoor air
<i>F</i>	Flow volume	<i>β</i>	Concentration-response	<i>p</i>	Ground source heat pump
<i>H</i>	Annual health risk cases		(C-R) coefficient	<i>r</i>	Room air conditioning
<i>K</i>	Deposition rate	<i>η</i>	Efficiency	<i>V</i>	Mechanical ventilation
<i>M</i>	Annual monetary cost	<i>ρ</i>	Air density	<i>VF</i>	Mechanical ventilation filter
<i>m</i>	Annual mortality rate	<i>τ</i>	Time	<i>VP</i>	Mechanical ventilation power

25

26 **Abstract:**

27 China is confronted with serious PM_{2.5} pollution, especially in the capital city of Beijing. Exposure to
28 PM_{2.5} could lead to various negative health impacts including premature mortality. As people spend
29 most of their time indoors, the indoor exposure to PM_{2.5} from both indoor and outdoor origins
30 constitutes the majority of personal exposure to PM_{2.5} pollution. Different building interventions have
31 been introduced to mitigate indoor PM_{2.5} exposure, but always at the cost of energy expenditure. In
32 this study, the health and economic benefits of different ventilation intervention strategies for
33 reducing indoor PM_{2.5} exposure are modelled using a representative urban residence in Beijing, with
34 consideration of different indoor PM_{2.5} emission strengths and outdoor pollution. Our modelling
35 results show that the increase of envelope air-tightness can achieve significant economic benefits
36 when indoor PM_{2.5} emissions are absent; however, if an indoor PM_{2.5} source is present, the benefits

only increase slightly in mechanically ventilated buildings, but may show negative benefit without mechanical ventilation. Installing mechanical ventilation in Beijing can achieve annual economic benefits ranging from 200yuan/capita to 800yuan/capita if indoor $PM_{2.5}$ sources exist. If there is no indoor emission, the annual benefits above 200yuan/capita can be achieved only when the $PM_{2.5}$ filtration efficiency is no less than 90% and the envelope air-tightness is above Chinese National Standard Level 7. Introducing mechanical ventilation with low $PM_{2.5}$ filtration efficiency to current residences in urban Beijing will increase the indoor $PM_{2.5}$ exposure and result in excess costs to the residents.

Keywords: $PM_{2.5}$; building ventilation; health; energy; economic benefit; indoor exposure

1 Introduction

With the rapid urbanization and economic growth of the past few decades, China is confronted with degrading urban air quality, especially in mega-cities. PM_{2.5} pollution has become one of the most serious environmental hazards in China and attracts global attention (Fang *et al.*, 2016). Beijing is the capital of China and is located in the most PM_{2.5} polluted regions of China. According to the China Environmental Status Bulletin (2016), the annual mean PM_{2.5} concentration in Beijing was 81 µg/m³ in 2015, which is over twice the interim target-1 (35 µg/m³) and eight times the guideline (10 µg/m³) recommended by the World Health Organization (WHO, 2006). The citizens of Beijing were exposed to the highest PM_{2.5} concentration among all Chinese cities, with 91% (2014), 86% (2015) and 73% (2016) of the city's population exceeding 70 µg/m³ exposure (Song *et al.*, 2017).

Epidemiological studies have demonstrated that exposure to PM_{2.5} is associated with many types of negative health consequences. According to the global study conducted by the Global Burden of Diseases (GBD) in 2015, ambient PM_{2.5} air pollution contributed to an estimated increased mortality by 17.1% from ischaemic heart disease, 14.2% from cerebrovascular disease, 16.5% from lung cancer, 24.7% from lower respiratory infections, and 27.1% from chronic obstructive pulmonary disease (Cohen *et al.*, 2017). Ambient PM_{2.5} has become the fifth-ranking mortality risk factor and cause 4.2 million (with 1.1 million contributed by China) annual mortality cases. However, the majority of the exposure actually occurs indoors as people spend about 90% of their time indoors (Klepeis *et al.*, 2001; Ji and Zhao, 2015(a)), and the outdoor pollutants can penetrate into a building's interior space and cause indoor exposure to PM_{2.5} of ambient origins. Ji and Zhao (2015(b)) estimated that the mortality directly derived from indoor exposure to particles of outdoor origins accounted for 81%-89% of the total increase in mortality associated with exposure to outdoor PM pollution. Hänninen and Asikainen (2013) also reported that in the Europe Union in 2010, 1.28 million burdens of disease were estimated to be caused by indoor exposures to outdoor air pollution.

Source control is regarded to be the most effective way to reduce PM pollution. However, it will require a long-term effort by several generations, as happened in the western world decades ago, to diminish the outdoor pollution emissions and clean up the atmosphere. Therefore, for the benefit of

Chinese public welfare, the emergent short-term challenge is to impose effective, yet inexpensive, interventions to reduce such exposure risk that are affordable for typical Chinese households. Increase of building air-tightness and the installation of mechanical ventilation with effective filtration are regarded as two major interventions at the building scale to reduce indoor exposure to outdoor PM pollution. Increasing the air-tightness of the building could effectively prevent the ingress of outdoor pollution and reduce the energy cost for heating in winter, but at the same time, it could lead to a reduced capacity for diluting the indoor-generated emissions (Shrubsole *et al.*, 2012). On the other hand, the introduction of mechanical ventilation could effectively ventilate the indoor space, but will potentially introduce pollutants from outdoors depending on the effectiveness of filtration. Mechanical ventilation always comes with a higher cost of energy compared with non-mechanical methods. Furthermore, the indoor human activities such as cooking, smoking and household cleaning can elevate short-term indoor PM_{2.5} concentrations by as much as several orders of magnitude and make a significant contribution to indoor particle exposures (Long *et al.*, 2000; Dimitroulopoulou *et al.*, 2006; McGrath *et al.*, 2017). The health benefits and economic costs of those interventions differ significantly, and remain largely unquantified. A holistic understanding of energy cost and health consequences for different ventilation interventions in response to both indoor and outdoor emissions is necessary.

Several existing studies have investigated the building ventilation interventions to reduce indoor exposure to outdoor PM pollution. Chen *et al.* (2016) modelled the indoor PM_{2.5} concentrations of six offices in China, showing that increasing the air-tightness of the buildings' external windows could effectively prevent the infiltration of outdoor particles and improve the indoor air quality. Zhao *et al.* (2015) estimated that residential ventilation systems with higher filtration efficiencies could reduce premature mortality and yield monetary benefits, especially in old residences with low air-tightness, but could also adversely influence outdoor particle infiltration if improperly installed (Stephens, 2015). Some researchers further combined the estimates from health impacts and operation costs. Montgomery *et al.* (2015) modified the ventilation system and filter efficiencies in an office building and compared the indoor particle concentrations, operation costs and monetized health benefits to occupants for a number of cities around the world. Results showed that, although the operation cost of

filtration systems varied by a factor of 3 between cities, the monetized health benefits of filter installations outweighed the operation costs by up to a factor of 10, and the net benefits were greatest for the highest efficiency filters. Zuraimi (2007) compared the economic benefits of health risk reduction to the monetary cost of building interventions in Singapore, demonstrating that ventilation strategies and filtration efficiencies can greatly influence PM₁₀ exposure and its estimated impacts on population health with the health benefits being much larger than the operating costs. However, a similar study conducted in Toronto, Canada showed that the health benefits may not always outweigh the operating and retrofit costs, depending on the reference building model and the retrofit strategies (Zuraimi and Tan, 2015). Moreover, the above-mentioned studies only considered indoor particles of outdoor origin.

Some other researchers only considered the indoor particle emission and therefore the effect of the building ventilation interventions. Spilak *et al.* (2014) studied 27 dwellings in Denmark and found that indoor PM_{2.5} concentrations were strongly associated with building characteristics and indoor PM_{2.5} sources, and particle filtration units could effectively reduce the PM_{2.5} levels in dwellings by more than half. The simulation studies on indoor PM_{2.5} concentrations in British dwellings showed that reductions in envelope permeability could decrease indoor PM_{2.5} exposure if combined with mechanical ventilation and heat recovery systems, but would lead to substantial increases in indoor PM_{2.5} concentrations if without mechanical ventilation (Shrubsole *et al.*, 2012; Milner *et al.*, 2015).

According to the brief review above, the studies on the economic benefits of building ventilation interventions which combined health risk and operation cost only focused on PM_{2.5} from outdoor origins, while the studies that considered PM_{2.5} from both outdoor and indoor origins only focused on the reduction of indoor exposure instead of the consequent combined health and economic impacts. In China, due to the large population nationwide, most urban residences are multi-storey apartments without purpose-built mechanical ventilation systems. The Chinese cooking style is quite different from those of the west, leading to substantial particle emissions indoors (Lee *et al.*, 2001; He *et al.*, 2004(b)). Considering the above two national features and the high level of ambient PM_{2.5} pollution in Beijing, the health and economic impacts of building ventilation interventions on urban residences in Beijing may show distinct characteristics compared to the existing studies, and is therefore worthy of

detailed investigation. The overarching aim of this paper is to evaluate and prioritize the potential health benefit and economic cost of different ventilation intervention strategies in order to reduce the indoor exposure to PM_{2.5} pollution of both outdoor and indoor origins for representative urban residential buildings in Beijing, China.

2 Methods

The modelling framework of the present study is illustrated by Fig.1. We first consider a basic scenario representing the current residential ventilation situation in urban Beijing, and different interventions are proposed to improve the current situation in response to the outdoor air pollution. The public health benefit from indoor PM_{2.5} pollution after intervention (EB_{health}), and the energy cost due to building ventilation (EB_{energy}) are therefore estimated. The uniqueness of the framework is to convert the public health impact and energy consumption into monetary values to make them comparable within a unified platform. The total economic benefit (EB_{total}) can be estimated as:

$$EB_{total} = EB_{health} + EB_{energy} \quad (1)$$

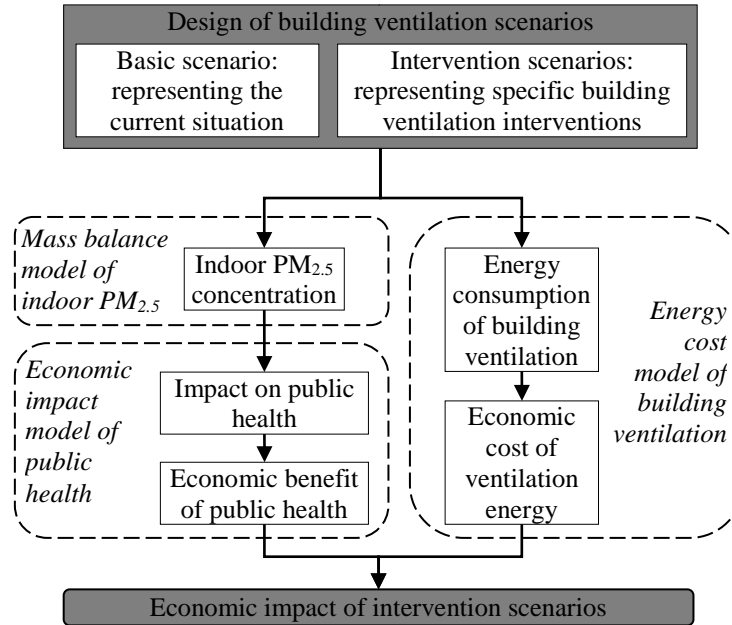


Fig.1: The modelling framework

Being the first step of this study, an idealized representative urban apartment in Beijing is assumed as the model subject. This apartment is located on the 6th floor, which is estimated to be half-way up the average residential building. Accommodating a typical Beijing family (working parents and a school child), the number of occupants in the model apartment is assumed to be 3, and the number of bedrooms is 2. According to the Beijing statistical yearbook (2016), the *per capita* residential area of urban households in Beijing is 31.69m² in 2015. Therefore, the floor area of the apartment measures 8m×12.5m, and the ceiling height is 2.8m (the indoor volume=280m³). Windows are placed on southern and northern external walls. The opening joint length on each side is 24m. The height of the central line of the windows is 1.6m, and the total height of the central line of the window from the ground is estimated to be 18m. The external windows are assumed closed during the modelling, meaning there is no natural ventilation in the apartment.

Cooking and smoking are two common indoor residential PM_{2.5} sources. Because the contribution to indoor PM_{2.5} concentrations from cooking activities are tens of times greater than smoking (He *et al.*, 2004(a); Fabian *et al.*, 2012), and Chinese smokers and their families are more aware of their health nowadays, cooking is considered as the only indoor PM_{2.5} source in the present modelling. In Chinese urban households, local exhausts such as range hoods are widely used while cooking. Therefore, in this analysis, a range hood with an exhaust flow as 10m³/min (the minimum volume provided by the National Standard of China GB/T17713-2011 (AQSIQ and SAC, 2011)) is installed in the model apartment, which only runs when the cooking activities are present.

2.1 Scenarios design

Fig.2 presents a simplified schematic diagram of the fate and transport of PM_{2.5} in the indoor space model. The building ventilation interventions to reduce indoor exposure to both indoor and outdoor PM_{2.5} pollution involve changes in air-tightness levels (ATL) of the building envelope and the installation of mechanical ventilation with different PM_{2.5} filtration efficiencies (PFE) (natural ventilation is not considered here as it is mainly determined by human behaviour, which is not the scope of current study). The economic benefits of different interventions are evaluated relative to the current building ventilation situation. Therefore, in the following analysis, scenarios are designed as

follows: a basic scenario representing the current situation, and several intervention scenarios with different ATLs and mechanical ventilation.

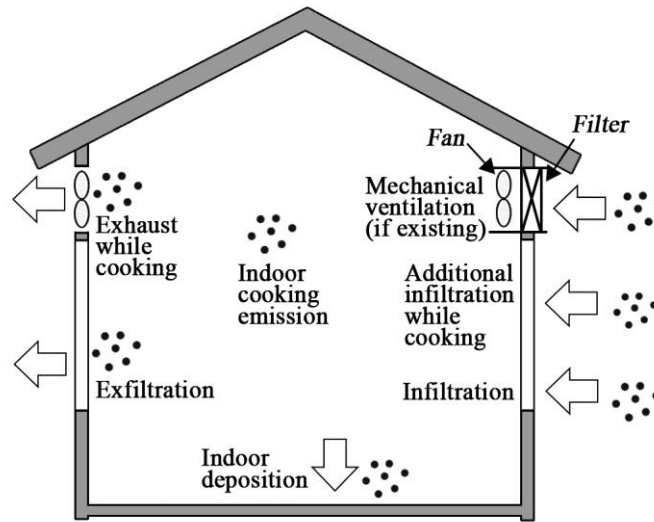


Fig.2: Simplified schematic of the fate and transport of indoor $PM_{2.5}$

2.1.1 Basic scenario

The basic scenario is considered as infiltration only without mechanical ventilation, which represents the general urban buildings in Beijing. The infiltration airflow is induced by the wind and stack effects, and strongly influenced by the air-tightness level of the external windows. According to National Standard of China GB/T7106-2008, there are eight air tightness levels (ATLs). We calculated the annual infiltration airflow rate with respect to each ATL for our model building, as shown in Fig.3. The detail calculation procedure of combined wind-and-buoyancy driven infiltration airflow is introduced in the Supplement Information (SI1). The annual average air change rate of urban apartments in Beijing with windows closed was found to be around 0.21/h as determined by Shi *et al.* (2015) by both numerical simulations and field measurement. Our prediction with ATL3 matches well with the work from Shi *et al.* (2015). Therefore, the model building with ATL3 without mechanical ventilation can best represent the current situation as the basic scenario.

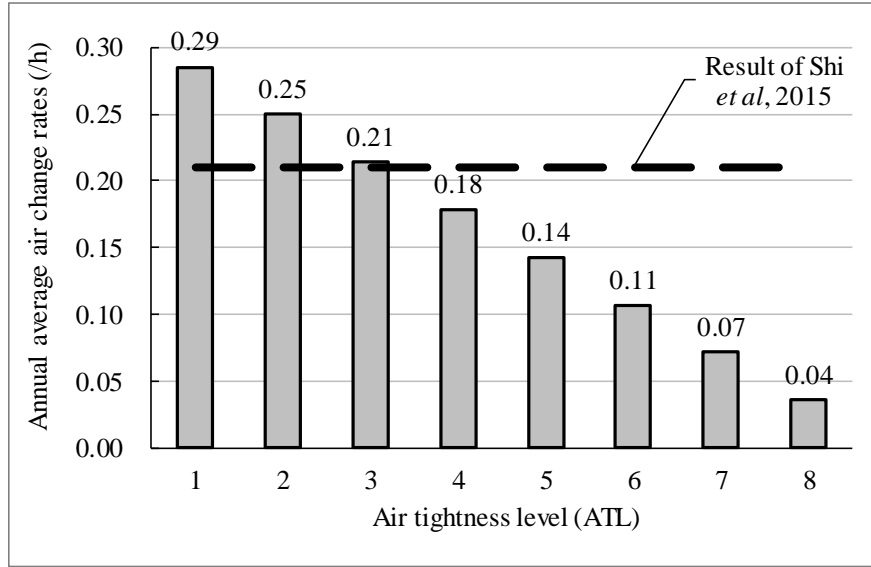


Fig.3: Annual average air change rates of the model building with different air-tightness levels

2.1.2 Intervention scenarios

All the intervention scenarios are listed in Table 1, considering different ATLs and PM_{2.5} filtration efficiencies (PFE) for mechanical ventilation. ATL5 and ATL7 are requirements from the Industry Standard of China JGJ26-2010 (MOHURD, 2010) and the Local Standard of Beijing DB11/891-2012 (BMCUP and BMAQTS, 2012), respectively. Currently in China, the PM_{2.5} filtration efficiency (PFE) has not been standardized in national standards for air filters (AQSIQ and SAC, 2008(a), (c)). PFE is graded into 4 levels from 50% to 99%. For each intervention scenario, the letter “A” and “F” stand for air-tightness level and the PM_{2.5} filtration efficiency of the mechanical ventilation system; “NV” stands for no mechanical ventilation; the numbers stand for the corresponding level and efficiency (%). For example, A5NV represents the intervention scenario with air tightness level increases from basic scenario of ATL3 to ATL5, without mechanical ventilation. A3F50 represents the intervention scenario with air tightness level 3 and mechanical ventilation with filtration efficiency of 50%.

Table 1: Design of the intervention scenarios

Intervention scenarios	Mechanical ventilation	Air-tightness levels (ATL)	PM _{2.5} filtration efficiencies of mechanical ventilation (PFE)
A5NV	×	5	—
A7NV	×	7	—
A3F50	√	3	50%
A3F70	√	3	70%
A3F90	√	3	90%
A3F99	√	3	99%
A5F50	√	5	50%
A5F70	√	5	70%
A5F90	√	5	90%
A5F99	√	5	99%
A7F50	√	7	50%
A7F70	√	7	70%
A7F90	√	7	90%
A7F99	√	7	99%

2.2 Modelling methodologies

2.2.1 The mass balance model of indoor PM_{2.5}

Because particles emitted during cooking can disperse quickly from the kitchen to the living room and impact all occupants in the residence (Wan *et al.*, 2011), the model apartment is simplified as a well-mixed single compartment. Based on this assumption and the fate and transport of indoor PM_{2.5} shown in Fig.2, the dynamic mass balance model is:

$$V \cdot \frac{dC_{IA}}{d\tau} = C_{OA} \cdot [P \cdot F_I + P \cdot F_{RH,I} + (1 - \eta_{VF}) \cdot F_V] + S - C_{IA} \cdot (F_E + F_{RH,E} + K \cdot V) \quad (2)$$

where V is the indoor volume (280m³); C_{IA} is the indoor PM_{2.5} concentration; C_{OA} is the outdoor PM_{2.5} concentration; P is the penetration factor for PM_{2.5} entering via air infiltration; F_I is the infiltration

airflow caused by wind and stack effects, $F_{RH,I}$ is the infiltration airflow caused by the exhaust of the range hood while cooking; η_{VF} is the PM_{2.5} removal efficiency of the filter in the ventilation system; F_V is the ventilation airflow; S is the indoor PM_{2.5} emission rate; F_E is the exfiltration airflow; $F_{RH,E}$ is the exhaust airflow by the range hood while cooking, (16m³/min); K is the deposition rate for PM_{2.5}.

The dynamic mass balance model can be described in a discrete form. The indoor PM_{2.5} concentration at time step $\tau+\Delta\tau$ is:

$$C_{IA} \big|_{\tau+\Delta\tau} = C_{IA} \big|_{\tau} \cdot e^{-x\Delta\tau/V} + \frac{y \cdot C_{OA} \big|_{\tau+\Delta\tau} + S \big|_{\tau+\Delta\tau}}{x} (1 - e^{-x\Delta\tau/V}) \quad (3)$$

where

$$\begin{cases} x = F_E \big|_{\tau+\Delta\tau} + F_{RH,E} \big|_{\tau+\Delta\tau} + K \cdot V \\ y = P \cdot F_I \big|_{\tau+\Delta\tau} + P \cdot F_{RH,I} \big|_{\tau+\Delta\tau} + (1 - \eta_{VF}) \cdot F_V \big|_{\tau+\Delta\tau} \end{cases} \quad (4)$$

In the following modelling, because cooking activities usually last for a few minutes, the time step $\Delta\tau$ is set at 1min. The indoor PM_{2.5} concentrations of 1min intervals for a whole year (totally 525,600 steps) are considered. The initial indoor concentration ($C_{IA}|_{t=0}$) is calculated by the steady-state form. Hourly ambient data, such as concentrations, temperatures and wind velocities, are discreted to 60 minutes and assumed constant within the whole hour.

The determination of all the parameters in the mass balance model is described in the Supplement Information (SI2). We also consider different cooking durations to take into account the contribution of indoor emission. The cooking minutes for each daily meal are classified into four groups, as listed in Table 2.

Table 2: Setting of daily cooking times

Group	Breakfast		Lunch		Supper	
	Daily period	Duration	Daily period	Duration	Daily period	Duration
1	None	0 min	None	0 min	None	0 min
2	7:00~7:10	10 min	12:00~12:20	20 min	19:00~19:20	20 min
3	7:00~7:20	20 min	12:00~12:40	40 min	19:00~19:40	40 min
4	7:00~7:30	30 min	12:00~13:00	60 min	19:00~20:00	60 min

2.2.2 Economic impact model of public health

Most of the epidemiologic studies linking air pollution and health endpoints are based on a relative risk model in the form of a Poisson regression (Kan and Chen, 2004). The health risk can be calculated using the concentration-response (C-R) coefficient (Huang and Zhang, 2013):

$$H = H_0 \cdot \exp(\beta \cdot (C - C_0)) \quad (5)$$

where C and H are the annual pollutant concentration and annual health endpoint; β is the concentration-response (C-R) coefficient, representing the excess health risk per each $1\mu\text{g}/\text{m}^3$ increase in $\text{PM}_{2.5}$; C_0 is the threshold concentration, below which there is no observed health effect; H_0 is the baseline incidence under C_0 . So far, in China, studies on concentration-response relationships derived from long-term exposure to $\text{PM}_{2.5}$ have been largely absent (Shang *et al.*, 2013). A C-R coefficient of 0.4% provided by Pope *et al.* (2002), which is widely used for evaluating the health risk of long-term $\text{PM}_{2.5}$ exposure, is adopted in the present study.

Considering both the indoor and outdoor exposures, the pollutant concentration C is determined as the time-weighted annual average concentration, which is calculated as:

$$C = \frac{\tau_{IA} \cdot \overline{C_{IA}} + \tau_{OA} \cdot \overline{C_{OA}}}{24} \quad (6)$$

where τ_{IA} and τ_{OA} are the daily indoor and outdoor exposure hours, $\overline{C_{IA}}$ and $\overline{C_{OA}}$ are annual average indoor and outdoor concentrations. According to the review by Zhou and Zhao (2012), the indoor and outdoor time that Chinese adults spent per day are estimated to be 21.1 and 2.9 hours, respectively.

There is no lower threshold yet identified for the health effects of $\text{PM}_{2.5}$. In this analysis, because the basic scenario is representing the current situation, the corresponding health risk can be calculated relative to the basic scenario, as follows:

$$H' = N \cdot m = H_0 \cdot \exp(\beta \cdot (C' - C_0)) \quad (7)$$

where H' , N , and m are the annual mortality cases, population (18,777,000), and annual mortality rate (0.495%) of urban Beijing, 2015, respectively; C' is the time-weighted annual average concentration in the basic scenario.

Therefore, combining Equations (5) and (7), the health effect of the intervention scenarios compared to the basic scenario can be calculated as follows:

$$\Delta H = N \cdot m \cdot \left[\exp\left(\beta \cdot (C - C')\right) - 1 \right] \quad (8)$$

where ΔH is the difference of mortality cases between the intervention scenario and the basic scenario. A negative ΔH means a reduction of mortality cases.

The economic impact of public health is assessed by using the value of a statistical life (VSL, Viscusi and Aldy, 2003). Unlike the value of an actual life, the VSL is the value that an individual places on a marginal change in the likelihood of death. According to the research by Xie (2011), VSL is 16.8 million yuan *per capita* in Beijing. Therefore, the corresponding annual *per capita* economic benefit can be estimated by:

$$EB_{health} = -\frac{\Delta H \cdot VSL}{N} \quad (9)$$

2.2.3 Energy cost of building ventilation

The economic cost of energy consumption of the building ventilation (M_{BE}) consists of three components: the heating and cooling energy cost of infiltration airflows (M_I), the heating and cooling energy cost of mechanical ventilation airflows (M_V), and the fan power cost of the mechanical ventilation system (M_{VP}).

$$M_{BE} = M_I + M_V + M_{VP} \quad (10)$$

The heating and cooling energy cost of infiltration airflows (M_I) are derived from the corresponding heating and cooling loads ($Q_{I,h}$ and $Q_{I,c}$) of the model apartment:

$$M_I = \frac{a \cdot p_e}{10^3 A \cdot \eta_{c,r}} \int Q_{I,c} d\tau + \frac{a \cdot p_h}{10^3 A} \int Q_{I,h} d\tau \quad (11)$$

where a is the urban *per capita* residential floor area in Beijing (31.69m²); p_e is the mean value of the current civil electricity price in Beijing, 0.5yuan/(kW·h); p_h is the current residential heating price in Beijing, 0.16yuan/(kW·h); $\eta_{c,r}$ is the cooling efficiency of the room air conditioners, estimated at 2.65 by the National Standard of China GB12021.3-2010 (AQSIQ and SAC, 2010).

The heating and cooling energy cost of mechanical ventilation airflows (M_V) is derived from the corresponding heating and cooling loads ($Q_{V,h}$ and $Q_{V,c}$) as follows:

$$M_V = \frac{a \cdot P_e}{10^3 A \cdot \eta_{c,p}} \int Q_{V,c} d\tau + \frac{a \cdot P_h}{10^3 A} \int Q_{V,h} d\tau \quad (12)$$

where $\eta_{c,p}$ is the average cooling efficiency of ground source heat pumps, which is mostly used for the ventilation cooling sources, estimated at 3.08 by the National Standard of China GB/T19409-2013 (AQSIQ and SAC, 2013).

The fan power of the mechanical ventilation system (M_{VP}) is calculated as follows:

$$M_{VP} = 0.365 \frac{p_e \cdot \tau_{IA} \cdot a \cdot D_{VP}}{A} \quad (13)$$

where D_{VP} is the input power of the mechanical ventilation system. According to Stephens *et al.* (2010), the energy consumption caused by the variation of filter efficiencies is negligible when set against the whole energy consumption of the mechanical ventilation system. Therefore, we assume a constant $D_{VP}=45W$ for all the mechanically ventilated scenarios, which is taken from the Construction Industry Standard of China JG/T391-2012 (MOHURD, 2012).

The calculation of the heating and cooling loads of infiltration and mechanical ventilation airflows ($Q_{I,h}$, $Q_{I,c}$, $Q_{V,h}$, and $Q_{V,c}$) are introduced in the Supplemental Information (SI3). Finally, the economic benefit of building ventilation energy can be expressed as:



$$EB_{energy} = M'_{BE} - M_{BE} \quad (14)$$

where M'_{BE} means the economic cost of the building ventilation energy for the basic scenario.

3 Results



3.1 Indoor PM_{2.5} concentrations

Fig.4 shows the averages and standard deviations of indoor PM_{2.5} concentrations with different cooking activities, which are expressed as “breakfast/lunch/supper minutes.” The resultant indoor concentrations of the basic scenario are also shown for comparison. The horizontal solid and dashed lines in Fig.4(a) are the guideline (10 $\mu g/m^3$) and interim target-1 (35 $\mu g/m^3$) of the WHO, respectively.

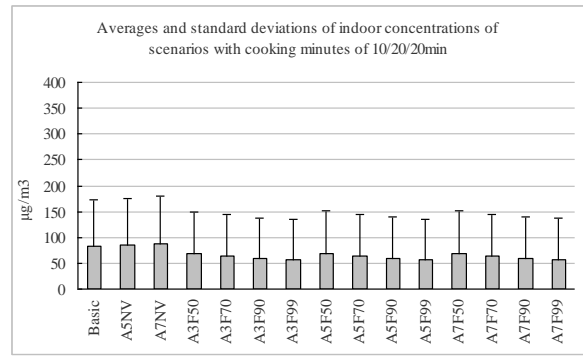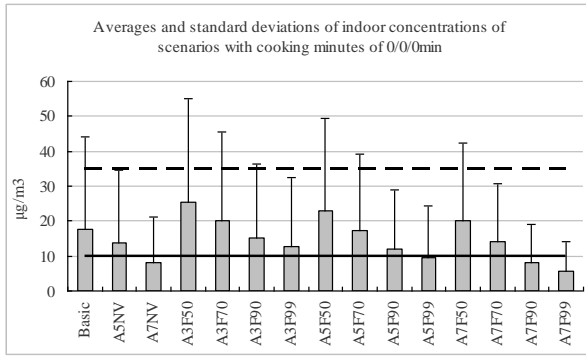

(a) 0/0/0min

(b) 10/20/20min

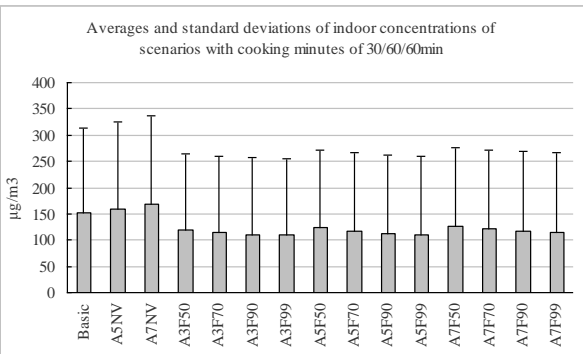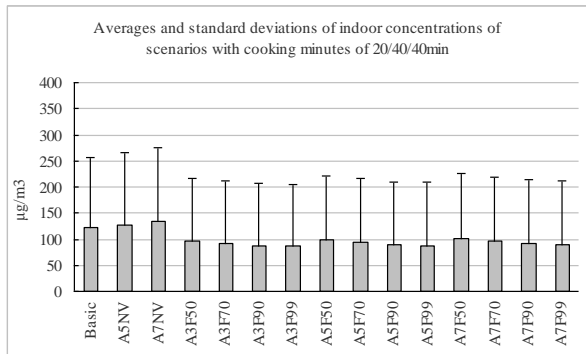

(c) 20/40/40min

(d) 30/60/60min

Fig.4: Averages and standard deviations of indoor PM_{2.5} concentrations

The indoor PM_{2.5} concentrations are greatly affected by the cooking emissions, though the cooking duration is divided into 3 periods and no more than 2.5 hours in total per day. The averages and standard deviations all increase significantly with the increase of cooking duration. As depicted in Fig.4(a), the annual averages for all scenarios are below the interim target-1 of the WHO, while the annual averages of scenarios A7NV (ATL7 without mechanical ventilation), A7F90 (ATL7, PFE=90%) and A7F99 (ATL7, PFE=99%) fall below the WHO guideline. However, when the cooking duration becomes longer, as shown in Fig.4 (c) and (d), the annual averages for all scenarios are even higher than the annual average ambient PM_{2.5} concentration (81µg/m³).

Fig.4(a) also shows that when there is no indoor source, although most of the scenarios can reduce the indoor concentrations, the scenarios with PFE=50% could lead to higher indoor concentrations compared with the basic scenario. This is because the mechanical ventilation system under this low filtration efficiency could draw substantial amounts of PM_{2.5} into the indoor space.

As shown in Fig.4(b) to (d), if an indoor source is present, the installation of mechanical ventilation systems would always decrease the indoor concentration, while increasing air-tightness without mechanical ventilation slightly leads to the opposite effect. That is because the air supplied from the mechanical ventilation system can dilute the indoor-generated pollutants, while the high level of air-tightness prevents the exfiltration of the indoor particles.

The standard deviations in Fig.4(a) show similar variation characteristics with the averages, indicating that without indoor sources, the appropriate interventions can not only reduce the indoor concentration levels, but also control the fluctuation of the indoor concentration in the long-term. However, in Fig.4(b) to (d), with the same indoor emission strength and ventilation conditions (with or without a mechanical ventilation system), the standard deviations of different scenarios do not vary significantly. That is because the indoor emissions become the main influencing factor of the long-term average concentration.

3.2 Total economic benefits

For all the intervention scenarios with different cooking activities, the total annual economic benefits are shown in Fig.5. The separate analysis of public health and energy cost is presented in the Supplement Information (SI4 and SI5).

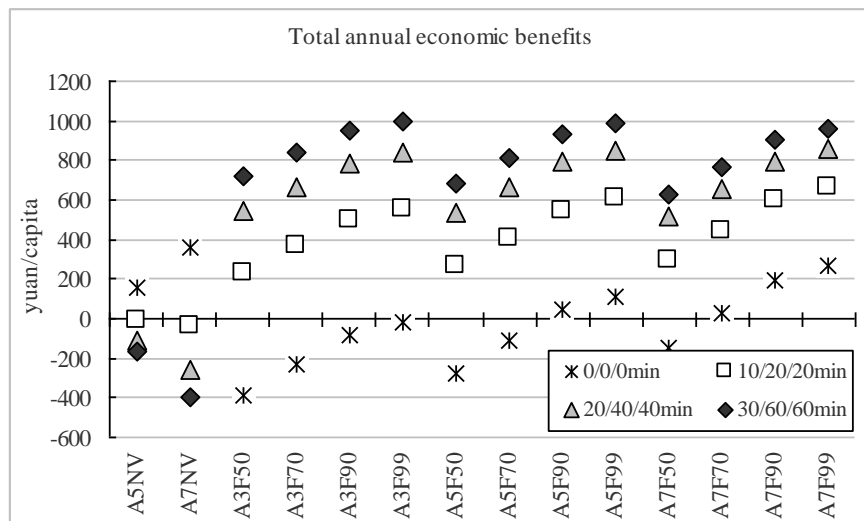


Fig.5: Total annual economic benefits

From the results in Fig.5, the following observations can be made:

(1) For the scenarios without indoor $PM_{2.5}$ emission, the economic benefits of most of the scenarios are below or near zero, while only the scenarios A7NV, A7F90, and A7F99 can achieve positive economic benefits greater than 200yuan/capita. However, scenario A7NV is not recommended as only improving air-tightness without supplying additional outdoor air could give rise to an accumulation of other indoor pollution, for example CO_2 , VOCs, and potential negative health consequences.

(2) For the scenarios without mechanical ventilation, the benefits are positive and grow with the increase of the air-tightness if there is no indoor $PM_{2.5}$ source. However, the benefits will fall and become negative if an indoor source exists, indicating that the effect of solely improving air-tightness without installing mechanical ventilation is not a cost-effective intervention for the occupants when the real situation of indoor emission is taken into account.

(3) If an indoor $PM_{2.5}$ source and mechanical ventilation coexist in the building, the economic benefits of the scenarios with the same filtration efficiency vary slightly with the air-tightness level, while the benefits of the scenarios with the same air-tightness level increase significantly with the improvement of the filtration efficiency. Moreover, the benefits of all the mechanically ventilated scenarios range from 234yuan/capita (A3F50) to 1,001yuan/capita (A3F99), and increase with the indoor emission strength. Thus, if there is indoor emission, the enhancement of filtration efficiency is an effective strategy which can reduce indoor $PM_{2.5}$ exposure and achieve significant economic benefits.

(4) Though the scenario A3F50 has the least benefit among all the modelling results, A7F90 and A7F99 are the only two scenarios which can always achieve economic benefits above 200yuan/capita with different indoor emission conditions. Considering the uncertainty of the cooking style and duration, and a further extension to all the building types in urban Beijing, the high level of air-tightness and mechanical ventilation with high $PM_{2.5}$ filtration efficiency are both important.

4 Discussion

4.1 In response to high outdoor air pollution in Beijing

The annual average ambient PM_{2.5} concentration of Beijing in 2015 is 82.57 μ g/m³, which is much higher than those in other 96 global largest cities studied in Stephens *et al.* (2016). Therefore, such high level of ambient PM_{2.5} concentration of Beijing could lead to an elevated indoor PM_{2.5} exposure to outdoor origin compared to those western studies. For different ventilation scenarios without indoor PM_{2.5} emissions, the annual averages of indoor PM_{2.5} concentrations range from 5.52 to 25.24 μ g/m³ (Fig.4(a)), and the estimated mortality reduction ratios ($\Delta H/H'$) range from -2.65 to 4.23%. However, for 22 U.S. cities, among which the largest annual ambient PM_{2.5} concentration was still less than 20 μ g/m³, Zhao *et al.* (2015) found that for different home types with different filters in the USA, the annual average indoor PM_{2.5} concentrations were from 0.11 to 3.70 μ g/m³, and the estimated mortality reduction ratios ranged from 0 to 2.5%, which are much smaller than our results.

Furthermore, our study demonstrated that a high filtration efficiency (>90%) should be adopted in Beijing in response to the high outdoor air pollution. The result is in good agreement with the study by Stephens *et al.* (2016), where the filters with PM_{2.5} filtration efficiency above 96% were recommended for outdoor air intakes in Beijing in order to keep the indoor exposure to outdoor PM_{2.5} under 12 μ g/m³. According to our modelling results in Fig.4(a), without consideration of indoor emission, the Scenario A3F99 (with current air tightness level ATL3 and mechanical ventilation system with PM_{2.5} filtration efficiency of 99%) could keep indoor concentration down to 12.82 μ g/m³. The slight difference between the two studies can be attributed to the different outdoor PM_{2.5} concentrations used in these two studies. While in other cities especially in US and European countries where the outdoor air pollution level is low, the recommended filtration efficiency is much lower. For example, an effective filtration efficiency of 45% could be sufficient to reduce the burden of disease around 38% in European countries (Hänninen and Asikainen, 2013).

4.2 In response to high indoor emission in China

The Chinese cooking style is another important factor that greatly influences the modelling results. The cooking emission rate used in our study represents typical Chinese stir-fry cooking style (Gao *et al.*, 2013) and is much higher than that of 1.7mg/min (Ozkaynak *et al.* (1996), which has been widely

adopted in western studies. To compare the impact of indoor emission strength, we conduct an extra modelling with the cooking emission rate as 1.7mg/min. The results of total economic benefits for typical emission duration (20/40/40 mins) are shown in Fig.6. Two distinct features could be observed for the two cooking styles (Figure 6 versus Figure 5): (1) For the scenarios without mechanical ventilation, increase of air tightness can achieve positive economic benefits with Western cooking style, while the Chinese cooking style leads to negative outcomes; (2) For the scenarios with mechanical ventilation, the economic benefits with western cooking style are much smaller than those with Chinese cooking style, and some scenarios with low filtration efficiency become negative (e.g. A3F50, A3F70, A5F50).

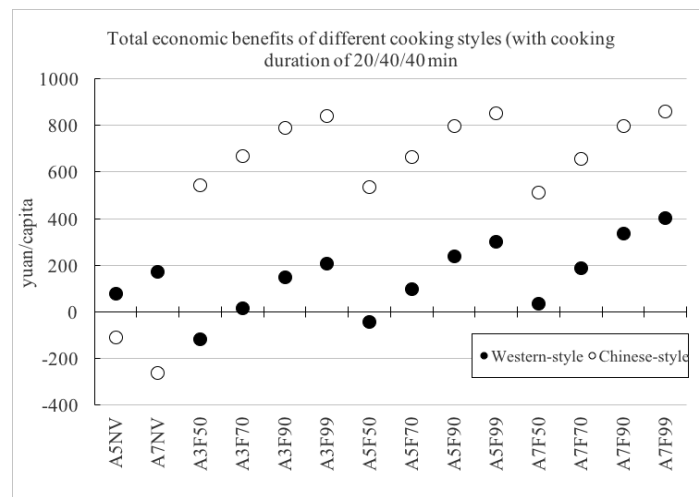


Fig.6: Comparison of annual economic benefits with two types of indoor emission: Western style versus Chinese style

The impacts of indoor emissions in this study are broadly consistent with several existing studies. By a simulation of London's domestic housing stock, Shrubsole *et al.* (2012) showed that cooking contributed most of the indoor exposure to PM_{2.5}, and the reductions of envelope permeability without mechanical ventilation would increase the indoor PM_{2.5} concentrations. The simulation conducted by Milner *et al.* (2015) revealed that even with mechanical ventilation, a higher level of air-tightness might still increase the pollutant concentrations due to indoor emissions. Both Milner *et al.* (2015) and Spilak *et al.* (2014) showed that mechanical ventilation with high filtration efficiency can reduce the indoor PM_{2.5} exposure.

4.3 Discussion on the different building ventilation interventions

According to Fig.4(a), which represent the impact of the interventions on indoor $PM_{2.5}$ exposure of outdoor origin only, increasing the envelope air-tightness can significantly reduce the indoor exposure to $PM_{2.5}$ of outdoor origin. This finding is generally consistent with the modeling results from six unoccupied office buildings (no indoor source) in Beijing and Guangzhou measured for two months in winter (Chen *et al.*, 2016). It can also be seen from Fig.4(a) that with the same air tightness, implementing mechanical ventilation with $PFE \leq 70\%$ will increase indoor exposure to $PM_{2.5}$ of outdoor origin compared to buildings without mechanical ventilation. According to the experiment conducted by Stephens and Siegel (2012), the improper installation of residential mechanical ventilation systems without effective filtration might lead to inadvertent increases in human exposure to outdoor air pollution comparing to the infiltration-only scenario. All the three studies, including ours, suggest that the filtration efficiency of residential mechanical ventilation is very important to prevent the ingress of outdoor-generated pollution.

Our study shows that most of the health benefits of mechanically ventilated scenarios without indoor emissions are lower than the energy costs, including 4 scenarios with negative health outcomes. For the scenarios with positive health benefits, the benefit-to-cost ratios vary from 0.08 to 4.24. This finding can be discussed with the theoretical studies on building interventions for reducing indoor exposure to PM of outdoor origin in Singapore (Zuraimi, 2007) and Toronto (Zuraimi and Tan, 2015). The study in Singapore aimed at indoor PM_{10} exposure found that the monetary health benefits of all assessed interventions (including filter efficiency enhancement, adopting air conditioning, etc.) were significantly higher than the costs in residential and office buildings. However, the study in Toronto, Canada found that the costs of retrofitting existing homes and implementing different residential building regulations were estimated at 2.3-2.9 times of the monetary health benefits of reducing indoor $PM_{2.5}$ exposure. It should also be noticed that the cost analysis was different in the three studies: our study only considered the energy costs in operation; the study of Singapore included costs of air-conditioners, energy consumption, etc.; while the study of Toronto included both capital and operational costs of the building retrofits. Despite the cost items, the variation of the benefit-cost relations among the three studies might also be due to different GDPs in different countries.

Considering the diversity of climates and differences in atmospheric environment status, the effects of the building ventilation interventions in different regions in China should be estimated in a further study.

5 Limitations

In our study, we provided only general assessments and central estimates of the magnitude of various uncertainties. Sensitivity analysis has not been conducted in this study. In fact, in the modelling to evaluate the effect of building ventilation interventions, the most uncertain input parameter is the indoor emission condition. The cooking time setting, as listed in Table 2, has taken the reasonable household cooking durations into account. There are some inherent limitations for the adopted mass-balance model assuming e.g. complete mixing, and using a single compartment approach does not capture short-term variations in the actual exposure concentrations very well (McGrath et al, 2017), however, from the point of view of quantifying the overall exposure processes the accuracy is considered good (Hänninen and Asikainen, 2013). Other parameters such as penetration factor and deposition rate may give rise to uncertainty as well. According to the studies on indoor PM of Beijing, the influence of deposition rate is much stronger than penetration factor (Ji and Zhao, 2015(a); Shi *et al.*, 2017). However, the annual characteristics of penetration factor and deposition rate are influenced by many factors such as the geometry features of indoor space and instant indoor/outdoor air speeds (Chen and Zhao, 2011), while the long-term study on these two parameters is still absent in China. Therefore, we adopted values of penetration factor and deposition rate that have been widely used in other international studies. The comprehensive sensitivity analysis can be included in future research to refine uncertainty.

The modelling of health impacts is limited by the absence of two basic data sets. Firstly, since the concentration-response (C-R) coefficient of long-term PM_{2.5} exposure is largely absent in China at present (Shang *et al.*, 2013), we use the C-R coefficient from the study conducted in the U.S. by Pope *et al.* (2002), which has been widely recognized around the world and used by several studies in China (Xie *et al.*, 2014; Lü and Li, 2016). However, according to some studies, the C-R relationship

in China may be different from that in developed countries due to different pollution levels, local population sensitivity, age distribution and, especially, different air pollution components (Cao *et al.*, 2011; Zhang *et al.*, 2014). Secondly, the value of a statistical life (VSL) applied in this study is derived from a survey in 2010 (Xie, 2011). With the rapid economic growth and urban development, the population structure and public health concerns in 2015 (the studied year) may be different from 6 years earlier, resulting in a changed VSL. However, research on these two parameters is beyond the scope of this paper, while the adopted values are the most reliable at present.

Finally, the intervention costs in this modelling have not included the capital costs for material and labour costs, which vary greatly and are strongly influenced by the actual forms of windows and mechanical ventilation systems. In China, the initial investment in building ventilation interventions is often paid by the government or included in the residence prices, while the operation costs are usually paid by the users. However, though the capital costs are reasonable for not being included in the modelling of economic benefits, these cost items should be considered in any further study if the benefits are discussed from the viewpoint of different stakeholders, such as the government, property developers and residents.

6 Conclusion

This study provides new insights into the economic benefits of building ventilation interventions for reducing indoor PM_{2.5} exposure from both indoor and outdoor origins in urban Beijing - one of the most polluted cities in the world. The modelling results demonstrate that with the variety of indoor PM_{2.5} emission sources, the cost-effectiveness of different building ventilation interventions can be different.

Without indoor PM_{2.5} emission, increasing envelope air-tightness can significantly reduce indoor PM_{2.5} exposure and achieve health and economic benefits. However, if indoor emissions are present, the economic benefits of increasing air-tightness alone (without mechanical ventilation) will be negative. If indoor emission and mechanical ventilation coexist in the building, increasing air-tightness will only slightly contribute to the positive economic benefits.

For the buildings with indoor $PM_{2.5}$ emission sources, the annual economic benefits of installing mechanical ventilation range from 200yuan/capita to 800yuan/capita. However, if there is no indoor emission, the annual economic benefits of installing mechanical ventilation will be above 200yuan/capita only when the $PM_{2.5}$ filtration efficiency is no less than 90% and the envelope air-tightness is above National Standard Level 7. Mechanical ventilation with $PM_{2.5}$ filtration efficiency below 70% will carry substantial amounts of $PM_{2.5}$ into the indoor space and lead to negative economic benefits if there is no $PM_{2.5}$ source in the building.

According to the comparison with other studies, the economic impact of different building interventions in different climates and locations may vary significantly. Considering the diversity of climates and the differences in atmospheric environment status across China, further study should be conducted in different regions to provide effective building intervention strategies and achieve health and economic benefits nationwide.

7 Acknowledgement

The present study is funded by EPSRC-GCRF (Global Challenge Research Fund) grant (EP/P511018/1) and the National Key Research and Development Program of China (2017YFC0702201).

References

- AQSIQ, SAC, 2008(a). Air filters (GB/T14295-2008). National Standard of China
- AQSIQ, SAC, 2008(b). Graduations and test methods of air permeability, water tightness, wind load resistance performance for building external windows and doors (GB/T7106-2008). National Standard of China
- AQSIQ, SAC, 2008(c). High efficiency particulate air filter (GB/T13554-2008). National Standard of China
- AQSIQ, SAC, 2010. The minimum allowable value of the energy efficiency and energy efficiency grades for room air conditioners (GB12021.3-2010). National Standard of China

540 AQSIQ, SAC, 2011. Range hood (GB/T17713-2011). National Standard of China

541 AQSIQ, SAC, 2013. Water-source (ground-source) heat pumps (GB/T19409-2013). National

542 Standard of China

543 Beijing Municipal Bureau of Statistics, NBS Survey Office in Beijing, 2016. Beijing statistical

544 yearbook 2016. <http://www.bjstats.gov.cn/nj/main/2016-tjnj/zk/indexeh.htm>

545 BMCUP, BMAQTS, 2012. Design standard for energy efficiency of residential buildings (DB11/891-

546 2012). Local Standard of Beijing

547 Cao, J., Yang, C., Li, J., Chen, R., Chen, B., Gu, D., Kan, H., 2011. Association between long-term

548 exposure to outdoor air pollution and mortality in China: A cohort study. *J Hazard Mater.* 186,

549 1594-1600

550 Chen, Z., Chen, C., Wei, S., Wu, Y., Wang, Y., Wan, Y., 2016. Impact of the external window crack

551 structure on indoor PM_{2.5} mass concentration. *Build Environ.* 108, 240-251

552 Cohen, A.J., Brauer, M., Burnett, R., Anderson, H.R., Frostad, J., Estep, K., *et al.*, 2017. Estimates

553 and 25-year trends of the global burden of disease attributable to ambient air pollution: An

554 analysis of data from the Global Burden of Diseases Study 2015. *Lancet.* 389, 1907-1918

555 Dimitroulopoulou, C., Ashmore, M.R., Hill, M.T.R., Byrne, M.A., Kinnersley, R., 2006. INDAIR: A

556 probabilistic model of indoor air pollution in UK homes. *Atmos Environ.* 40, 6362-6379

557 Fabian, P., Adamkiewicz, G., Levy, J.I., 2012. Simulating indoor concentrations of NO₂ and PM_{2.5} in

558 multifamily housing for use in health-based intervention modelling. *Indoor Air.* 22, 12-23

559 Fang, D., Wang, Q., Li, H., Yu, Y., Lu, Y., Qian, X., 2016. Mortality effects assessment of ambient

560 PM_{2.5} pollution in the 74 leading cities of China. *Sci Total Environ.* 569-570, 1545-1552

561 Gao, J., Cao, C., Wang, L., Song, T., Zhou, X., Yang, J., Zhang, X., 2013. Determination of size-

562 dependent source emission rate of cooking-generated aerosol particles at the oil-heating stage in

563 an experimental kitchen. *Aerosol Air Qual Res.* 13, 488-496

564 Hänninen, O., Asikainen, A., 2013. Efficient reduction of indoor exposures - Health benefits from

565 optimizing ventilation, filtration and indoor source controls. ISBN 978-952-245-822-3 (online

566 publication)

567 He, C., Morawska, L., Hitchins, J., Gilbert, D., 2004(a). Contribution from indoor sources to particle
568 number and mass concentrations in residential houses. *Atmos Environ.* 38, 3405-3415

569 He, L., Hua, M., Huang, X., Yu, B., Zhang, Y., Liu, D., 2004(b). Measurement of emissions of fine
570 particulate organic matter from Chinese cooking. *Atmos Environ.* 38, 6557-6564

571 Huang, D., Zhang, S., 2013. Health benefit evaluation for PM_{2.5} pollution control in Beijing-Tianjin-
572 Hebei region of China. *China environmental science.* 33, 166-174

573 Ji, W., Zhao, B., 2015(a). Contribution of outdoor-originating particles, indoor-emitted particles and
574 indoor secondary organic aerosol (SOA) to residential indoor PM_{2.5} concentration: A model-
575 based estimation. *Build Environ.* 90, 196-205

576 Ji, W., Zhao, B., 2015(b). Estimating mortality derived from indoor exposure to particles of outdoor
577 origin. *PLoS ONE* 10(4): e0124238. doi:10.1371/journal.pone.0124238

578 Kan, H.D., Chen, B.H., 2004. Particulate air pollution in urban areas of Shanghai, China: health-based
579 economic assessment. *Sci Total Environ.* 322(1-3), 71-79

580 Klepeis, N.E., Nelson, W.C., Ott, W.R., Robinson, J.P., Tsang, A.M., Switzer, P., Behar, J.V., Hern,
581 S.C., Engelmann, W.H., 2001. The national human activity pattern survey (NHAPS): a resource
582 for assessing exposure to environmental pollutions. *J Expo Anal Env Epid.* 11, 231-252

583 Lee, S.C., Li, W.M., Chan, L.Y., 2001. Indoor air quality at restaurants with different styles of
584 cooking in metropolitan Hong Kong. *Sci Total Environ.* 279, 181-193

585 Long, C.M., Suh, H.H., Koutrakis, P., 2000. Characterization of indoor particle sources using
586 continuous mass and size monitors. *J Air Waste Manage.* 50(7), 1236-1250

587 Lü, L., Li, H., 2016. Health Economic Evaluation of PM₁₀ and PM_{2.5} Pollution in Beijing-Tianjin-
588 Hebei Region of China. *Acta Scientiarum Naturalium Universitatis Nankaiensis.* 49(1), 69-77

589 McGrath, J.A., Sheahan, J.N., Dimitroulopoulou, C., Ashmore, M.R., Terry, A.C., Byrne, M.A., 2017.
590 PM exposure variations due to different time activity profile simulations within a single dwelling.
591 *Build Environ.* 116, 55-63

592 Milner, J., Hamilton, I., Shrubsole, C., Das, P., Chalabi, Z., Davies, M., Wilkinson, P., 2015. What
593 should the ventilation objectives be for retrofit energy efficiency interventions of dwellings?.
594 *Build Serv Eng Res T.* 36(2), 221-229

595 MEP, 2016. China Environmental Status Bulletin 2015. <http://www.zhb.gov.cn/hjzl/zghjzkgb/>
596 [lnzghjzkgb/](http://www.zhb.gov.cn/hjzl/zghjzkgb/)

597 MOHURD, 2010. Design standard for energy efficiency of residential buildings in severe cold and
598 cold zones (JGJ26-2010). Industry Standard of China

599 MOHURD, 2012. Ventilators (JG/T391-2012). Construction industry Standard of China

600 Montgomery, J.F., Reynolds, C.C.O., Rogak, S.N., Green, S.I., 2015. Financial implications of
601 modifications to building filtration systems. *Build Environ.* 85, 17-28

602 Ozkaynak, H., Xue, J., Spengler, J., Wallace, L., Pellizzari, E., Jenkins, P., 1996. Personal exposure to
603 airborne particles and metals: results from the particle team study in Riverside, California. *J*
604 *Expo Anal Env Epid.* 6(1), 57-78

605 Pope III, C.A., Burnett, R.T., Thun, M.J., Calle, E.E., Krewski, D., Ito, K., Thurston, G.D., 2002.
606 Lung cancer, cardiopulmonary mortality, and long-term exposure to fine particulate air pollution.
607 *JAMA-J Am Med Assoc.* 287(9), 1132-1141

608 Shang, Y., Sun, Z., Cao, J., Wang, X., Zhong, L., Bi, X., Li, H., Liu, W., Zhu, T., Huang, W., 2013.
609 Systematic review of Chinese studies of short-term exposure to air pollution and daily mortality.
610 *Environ Int.* 54, 100-111

611 Shi, S., Chen, C., Zhao, B., 2015. Air infiltration rate distributions of residences in Beijing. *Build*
612 *Environ.* 92, 528-537

613 Shi, S., Chen, C., Zhao, B., 2017. Modifications of exposure to ambient particulate matter: Tackling
614 bias in using ambient concentration as surrogate with particle infiltration factor and ambient
615 exposure factor. *Environ Pollut.* 220, 337-347

616 Shrubsole, C., Ridley, I., Biddulph, P., Milner, J., Vardoulakis, S., Ucci, M., Wilkinson, P., Chalabi,
617 Z., Davies, M., 2012. Indoor PM_{2.5} exposure in London's domestic stock: Modelling current and
618 future exposures following energy efficient refurbishment. *Atmos Environ.* 62, 336-343

619 Song, C., He, J., Wu, L., Jin, T., Chen, X., Li, R., Ren, P., Zhang, L., Mao, H., 2017. Health burden
620 attributable to ambient PM_{2.5} in China. *Environ Pollut.* 223, 575-586

Spilak, M.P., Karottki, G.D., Kolarik, B., Frederiksen, M., Loft, S., Gunnarsen, L., 2014. Evaluation of building characteristics in 27 dwellings in Denmark and the effect of using particle filtration units on PM_{2.5} concentrations. *Build Environ.* 73, 55-63

Stephens, B., 2015. Building design and operational choices that impact indoor exposures to outdoor particulate matter inside residences, *Sci Technol Built En.* 21(1), 3-13

Stephens, B., Brennan, T., Harriman, Lew., 2016. Selecting ventilation air filters to reduce PM_{2.5} of outdoor origin. *ASHRAE JOURNAL.* 58(9), 12-20

Stephens, B., Siegel, J.A., 2012. Comparison of test methods for determining the particle removal efficiency of filters in residential and light-commercial central HVAC systems. *Aerosol Sci Tech.* 46, 504-13

Stephens, B., Siegel, J.A., Novoselac, A., 2010. Energy implications of filtration in residential and light-commercial buildings. *ASHRAE Trans* 2010. 116, 346-57

Viscusi, W.K., Aldy, J.E, 2003. The value of a statistical life: A critical review of market estimates throughout the world. *J Risk Uncertainty.* 27(1), 5-76

Wan, M., Wu, C., To, G.S., Chan, T., Chao, C.Y.H., 2011. Ultrafine particles and PM_{2.5} generated from cooking in homes. *Atmos Environ.* 45, 6141-6148

World Health Organization (WHO), 2006. WHO Air quality guidelines for particulate matter, ozone, nitrogen dioxide and sulfur dioxide: Global update 2005: Summary of risk assessment

Xie, X., 2011. The value of health: environmental valuation and control strategy study of urban air pollution. Doctoral dissertation of Peking University

Xie, Y., Chen, J., Li, W., 2014. An Assessment of PM_{2.5} Related Health Risks and Impaired Values of Beijing Residents in a Consecutive High-Level Exposure during Heavy Haze Days. *Environmental Science.* 35(1), 1-8

Zhang, L., Chen, X., Xue, X., Sun, M., Han, B., Li, C., Ma, J., Yu, H., Sun, Z., Zhao, L., Zhao, B., Liu, Y., Chen, J., Wang, P.P., Bai, Z., Tang, N., 2014. Long-term exposure to high particulate matter pollution and cardiovascular mortality: A 12-year cohort study in four cities in northern China. *Environ Int.* 62, 41-47

648 Zhao, D., Azimi, P., Stephens, B., 2015. Evaluating the long-term health and economic impacts of
 649 central residential air filtration for reducing premature mortality associated with indoor fine
 650 particulate matter (PM_{2.5}) of outdoor origin. *Inter J Env Res Pub Heal*. 12, 8448-8479
 651 Zhou, B., Zhao, B., 2012. Population inhalation exposure to polycyclic aromatic hydrocarbons and
 652 associated lung cancer risk in Beijing region: Contributions of indoor and outdoor sources and
 653 exposures. *Atmos Environ*. 62, 472-480
 654 Zuraimi, M.S., 2007. Estimates of associated outdoor particulate matter health risk and costs
 655 reductions from alternative building, ventilation and filtration scenarios. *Sci Total Environ*. 377,
 656 1-11
 657 Zuraimi, M.S., Tan, Z., 2015. Impact of residential building regulations on reducing indoor exposures
 658 to outdoor PM_{2.5} in Toronto. *Build Environ*. 89, 336-344