

Control and Schedule Adjustments of Battery Based Energy Storage in Low-Voltage Distribution Networks



Maximilian J. Zangs
School of the Built Environment
University of Reading

A thesis submitted for the degree of
Doctor of Philosophy in Electronic Engineering

2018

It is not a dream. It is a simple feat of scientific electrical engineering. Electric power can drive the world's machinery without the need of coal, oil or gas. Although perhaps humanity is not yet sufficiently advanced to be willingly lead by the inventor's keen searching sense. Perhaps it is better in this present world of ours where a revolutionary idea may be hampered in its adolescence. All this that was great in the past was ridiculed, condemned, combatted, suppressed only to emerge all the more triumphantly from the struggle. [...] Our duty is to lay the foundation for those who are to come and to point the way, yes humanity will advance with giant strides. We are whirling through endless space with an inconceivable speed, all around everything is spinning, everything is moving, everywhere there is energy.

— Nicola Tesla

Abstract

British Distribution Network Operators (DNOs) are facing challenges due to the energy sectors transitioning into a low carbon economy. This thesis aims to present novel methods to aid DNOs in operating their Low-Voltage (LV) networks despite this ongoing transition and its entailed challenges. The presented methods are realised with the use of Battery Energy Storage Solutions (BESS) and they develop BESS energy management algorithms whilst focusing on communication regimes and sub-half-hourly volatility in demand. Consequently, improving LV network operation mainly considers the reduction of peak power flow, but also includes reducing energy losses, voltage deviation, the magnitude of neutral currents and phase unbalance. Without these methods, DNOs would have to rely on traditional network reinforcements so that LV networks are kept within statutory voltage bands, for example. Extending current literature with methods to control a single energy resource and a distributed BESS - whilst considering requirements for communication systems that effect BESS control - is the main contribution of this thesis.

The BESS control algorithm developed in this thesis is designed to incorporate half-hourly forecasts and sub-half-hourly load volatility. Resulting key network parameters and their interplay are identified and daily load peaks, caused by load volatility, could be reduced by an average of 3.8kW (from 45kW). Methods are developed and address challenges for controlling a single BESS. Neglected challenges are addressed in the subsequent BESS control methods where a desynchronised Multi-Agent Network

(MAS) and communication-less BESS control fill this gap. Results show how internal algorithm behaviour changes when desynchronising the communication environment, but without impacting the global performance of the distributed BESS. Also, real-time performance of the communication less control algorithm is studied on different basis to show how effects from uncoordinated Low-Carbon Technologies (LTCs) like Electric Vehicle (EV) charging, can be successfully mitigated. All objectives aligning with the aforementioned achievements have been met and the comparable storage control techniques in literature are either met or exceeded in performance when subjected to the available datasets.

Declaration

I confirm that this is my own work and the use of all material from other sources has been properly and fully acknowledged.

Maximilian J. Zangs

Dedication

In gratitude to my British higher education, I dedicate this thesis to my parents.

Acknowledgements

I would like to begin by thanking my two PhD supervisors and tutors Dr Ben Potter and Professor William Holderbaum for their continuing support, help and guidance throughout my PhD. In addition, I would like to thank the *University of Reading* and sponsors of the *NTVV Project* for providing the funding for my research. Also, I would like to thank the *ITNG* members of the former *School of Systems Engineering* for providing and maintaining the vital computational resources, and I would like to thank our industrial project partner, *Scottish and Southern Electricity Networks*, for providing their network models and datasets; both were vital necessities to conduct and complete my research.

I would like to thank members of the *School of the Built Environment*, the *School of Biological Sciences* and the *School of Psychology and Clinical Language Sciences* for taking their time to share, exchange and discuss ideas and for challenging my thinking and expertise throughout the journey towards the PhD. In particular I would like to express special thanks to individuals in the *Energy Research Laboratory*: Dr Timur Yunusov, Ana Rodriguez-Arguelles and Peter Adams; individuals from the *SUSPORTS Project*: Dr Ian Harrison and Stefano Pietrosanti; an individual in the *Brain Embodiment Laboratory*: Asad Malik; and individuals at the *TSBE Centre* and the *School of Construction Management and Engineering*: Alice Gunn and Vicky Papaioannou.

There are many current and past colleagues, researchers and friends who have

not only technically aided my research, but have also reminded me of life outside academia. Through their willingness to listen, motivate, support and (sometimes) distract me, they have made my time as a PhD student considerably more enjoyable; so thank you.

Last but not least, I would like to express my greatest gratitude and thanks to my family for all of their support and understanding throughout my PhD and time at university; it is much appreciated and I could not have done it without you.

Contents

Abstract	iii
Declaration	v
Dedication	vii
Acknowledgements	ix
Table of Contents	xi
Table of Figures	xvi
Nomenclature	xxv
1 Introduction	1
1.1 Background and motivation	2
1.1.1 Topology and challenges of the UK electricity network	5
1.1.2 Solutions to mitigate impact of LCT	8
1.1.3 Smart control	10
1.2 Problem statement and research objectives	12
1.3 Contributions to knowledge	14
1.4 Publications	15
1.5 Thesis structure	16

2	Literature Review	19
2.1	Overview	19
2.2	Role of energy storage - a survey	20
2.3	Energy storage research for LV application	26
2.3.1	Voltage control	28
2.3.2	Power flow management	30
2.4	Control of energy storage and its applications	33
2.4.1	Off-line and on-line control	34
2.4.2	Centralised and distributed control	37
2.4.3	Communication-less control	42
2.5	Summary of gaps in literature	44
3	Improving network performance by adjusting battery operation at sub-half-hourly resolution	47
3.1	Overview	47
3.2	Key network parameters and derived cost functions	49
3.2.1	Voltage related cost functions	51
3.2.2	Power related cost functions	56
3.2.3	Current related cost functions	60
3.3	Data, models and storage scheduling	62
3.3.1	Load profiles	62
3.3.2	Network model	63
3.3.3	Battery model	65
3.3.4	ESMU scheduling	68
3.4	Optimisation method	72
3.4.1	Closed-loop schedule adjustment	73
3.4.2	Execution and result assessment procedure	75
3.5	Results and Discussion	77

3.5.1	Time Series Analysis	78
3.5.2	Difference Analysis	85
3.5.3	Probability Density Analysis	90
3.6	Summary	92
4	Real-Time Adjustment of Battery Operation using MPC Guided Schedule Deviation	95
4.1	Overview	95
4.2	System Explanation	97
4.2.1	ESMU model	99
4.2.2	Load data and ESMU scheduling	99
4.3	Control of ESMU	104
4.3.1	Dynamic control	105
4.3.2	Model predictive control	109
4.4	Case studies	111
4.5	Results and discussion	113
4.5.1	Time-series analysis	113
4.5.2	Daily peak reduction	115
4.5.3	Probability of peak reduction	118
4.5.4	Impact of varying the model's length	120
4.6	Summary	121
5	Effects of Desynchronising Information Propagation when Distribut- ing Smart-Charging	125
5.1	Overview	125
5.2	Coordination of EV charging	128
5.2.1	EV Demand	128
5.2.2	Baseline Load	129

5.2.3	Scheduling Algorithm	130
5.3	Distributed Systems	137
5.3.1	MAS Implementation	139
5.3.2	MAS Desynchronisation	140
5.3.3	Cases and Performance Metrics	141
5.4	Results and Discussion	146
5.4.1	Algorithm performance for synchronised operation	146
5.4.2	Algorithm performance for desynchronised operation with reg- ular timing	153
5.4.3	Algorithm performance for desynchronised operation with ir- regular timing	155
5.5	Summary	158

6 Cooperative Battery Operation without Need for Communication

	Infrastructures	161
6.1	Overview	161
6.2	Related Work	163
6.3	System Modelling	165
6.3.1	Assumptions	165
6.3.2	EV charging behaviour	166
6.3.3	Battery Modelling	171
6.3.4	Network Models	173
6.4	Storage Control	175
6.4.1	Algorithm Parameters	175
6.4.2	AIMD Algorithm Structure	177
6.4.3	Reference Voltage Profile	178
6.5	Scenarios and Comparison Metrics	179
6.5.1	Test Cases and Scenarios	179

6.5.2	Performance Metric Definition	180
6.5.2.1	Parameter for Voltage Improvement	181
6.5.2.2	Parameter for Line Overload Reduction	182
6.5.2.3	Parameter for the Improvement of Battery Cycling	183
6.6	Results and Discussion	184
6.6.1	Voltage Violation Analysis	185
6.6.2	Line Overload Analysis	188
6.6.3	Battery Utilisation Analysis	191
6.7	Summary	195
7	Discussion and Conclusion	197
7.1	Overview of Main Findings	198
7.2	Contribution to Knowledge	202
7.3	Research Limits	205
7.3.1	Energy storage model	205
7.3.2	Electric vehicle charging	206
7.3.3	Data	207
7.3.4	Network models and Power Flow Simulations	208
7.3.5	Different Control Methods	209
7.3.6	Communication System	210
7.4	Future Work	210
7.4.1	Modelling	211
7.4.2	Realisation considerations for DNO	213
7.5	Conclusion	214
	References	217
A	Additional Results	245

A.1	Improving operation performance of battery schedules at sub-half-hourly resolution	245
A.1.1	Additional Time Series Analysis	245
A.1.2	Additional Difference Analysis	254
A.1.3	Probability Density Analysis	263
B	Multi-Agent Systems	269
B.1	FIPA Implementation	269
B.2	Communication Protocols	270
B.2.1	FIPA Query Protocol	270
B.2.2	FIPA Brokering protocol	272
B.2.3	FIPA ContractNet Protocol	273

List of Figures

1.1	Change in residential annual electricity demand excluding electric vehicles from FES2017 [1]	3
1.2	Rise in energy demand due to the uptake of electric vehicles as predicted by FES 2017 [1]	4
1.3	Change in annual peak power demand as predicted by FES2017 [1]	4
2.1	Energy storage applications and corresponding value for various discharge durations [2]	21
2.2	Energy Storage Management Unit overview: (a) 12.5kWh Energy Storage Unit, (b) Power Electronics Unit, (c) deployed 12.5kWh system, (d) deployed 25kWh system - pictures are taken from the NTVV close down report [3]	32
3.1	Cost function $\zeta_{\text{voltage}}(v_\phi)$ values for different substation voltages	53
3.2	Sketch of the benefits that occur when ESMU injects power into the feeder in order to mitigate the voltage drop along the cable	54
3.3	Voltage at the loads in the IEEE LV Test Case network for a total load of 440kVA against distance between the corresponding load and substation: for the quadratic fit $R^2 = 58.76\%$	55
3.4	Sample network imbalance for different phase loadings as defined in ANSI/NEMA MG 1-2011	58

3.5	Losses against increasing power demand	60
3.6	Cost of line or fuse utilisation against network current	61
3.7	A power flow plot of the IEEE-PES European Test Case Feeder, i.e. a LV distribution network in the UK [4].	64
3.8	Flowchart to calculate the next SOC (i.e. $SOC(t + \Delta t)$) based on current ESMU power (i.e. $s_{ESMU}(t)$ which is predefined) and current SOC (i.e. $SOC(t)$ which is predefined).	67
3.9	Highly variable and volatile demand profile vs half-hourly demand (i.e. a forecast under perfect foresight conditions)	69
3.10	Impact of half-hourly ESMU schedule on sub-half-hourly power profile	71
3.11	ESMU schedule adjustment flow diagram	74
3.12	Method execution and results assessment flowchart	75
3.13	Voltage level modifications as noted at the ESMU's PCC by adjusting its schedule	78
3.14	Voltage level improvements at all buses in the entire distribution net- work due to the ESMU schedule adjustment.	80
3.15	Reduction of the network's phase unbalance due to the adjustment of the ESMU schedule.	81
3.16	Neutral power reduction due to the ESMU schedule adjustments . . .	82
3.17	Power factor cost improvements due to the adjustment of the ESMU schedule	83
3.18	Instantaneous losses of the distribution network when adjusting the ESMU schedule in order to reduce the former (energy lost: 4.55kWh for base; 4.47kWh for normal; 4.19kWh for minimised).	83
3.19	Improvement of the worst line utilisation across the entire network when adjusting the ESMU schedule correspondingly.	84

3.20	Cost improvement spread, when comparing against the <i>normal</i> ESMU operation case and when optimising for the underlying cost (a separate y-axis is introduced for the optimisation of “neutral power”).	86
3.21	Relative cost improvement spread, when comparing against the <i>normal</i> ESMU operation case and when optimising for the underlying cost. .	87
4.1	(4.1a) Traditional forecast driven BESS control; (4.1b) Traditional on-line system; (4.1c) Proposed dynamic control system	97
4.2	An example of applying a half-hourly ESMU schedule to the half-hourly substation load (Subfig. 4.2a) and the actual, sub-half-hourly daily load, measured at the substation (Subfig. 4.2b).	103
4.3	Dynamic controller breakdown as previously shown in Figure 4.1c. . .	104
4.4	Underlying time-series based compensation strategy for compensator PID ₂	106
4.5	Example of exogenous auto-regressive model that is used for model predictive control. Here, $t - \Delta t$ indicates the time delay by one sample period.	110
4.6	Time series performance over a single day when using realistic load forecasts: (4.6a) total day; (4.6b) zoomed in on critical period	114
4.7	Daily peak reduction when using realistic forecasts as: (4.7a) peak power values; (4.7b) percentage of original case B	116
4.8	Peak load probability for different prediction mechanisms.	118
4.9	Probability of peak load reduction for different prediction mechanisms.	119
4.10	Probability of peak load reduction for different prediction mechanisms and different AR/ARX model lengths.	121
4.11	Visualisation of the peak power distribution for different AR/ARX model lengths.	122

5.1	Example of agent synchronisation process before re-scheduling their EVs charging profile.	131
5.2	Charging power (green line) allocation on top of base network load (black line) for valley-filling behaviour. Here $n = 1$ for Fig. 5.2a, $n = 2$ for Fig. 5.2b, $n = 3$ for Fig. 5.2c, and $n = N$ for Fig. 5.2d. . .	133
5.3	A simplified MAS structure containing virtual seller and buyer agents (white), that negotiate power/charging profiles for physical entities (grey).	138
5.4	The implementation of FIPA on <i>HTCondor</i>	139
5.5	Example of agent desynchronisation when running through algorithm iterations in their respective execution loop. Here, communication events are in quick succession, but never at the exact same time. . . .	142
5.6	Synchronised time series evolution for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.	147
5.7	Synchronised time series evolution for $\alpha = 1.00$ and $\beta = 1.00$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.	148
5.8	Full range analysis of α and β for the synchronised MAS where, (a) shows the final ζ_{PAR} , (b) shows the convergence, b , for ζ_{PAR} , (c) shows the final ζ_{TRA} , and (d) shows the convergence, b , for ζ_{TRA} (red indicates missing data).	151
5.9	Desynchronised time series evolution for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.	152
5.10	Full range analysis of α and β for the desynchronised MAS where, (a) shows the final ζ^{PAR} , (b) shows the convergence, b , for ζ^{PAR} , (c) shows the final ζ^{TRA} , and (d) shows the convergence, b , for ζ^{TRA} (red indicates missing data).	154

5.11	Desynchronised time series evolution when using irregular loop delays for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$	156
5.12	Full range analysis of α and β for the desynchronised MAS with ir- regular loop delays where, (a) shows the final ζ^{PAR} , (b) shows the convergence, b , for ζ^{PAR} , (c) shows the final ζ^{TRA} , and (d) shows the convergence, b , for ζ^{TRA} (red indicates missing data).	157
6.1	The probability of starting a trip at a particular time during a weekday, extrapolated into three normal distributions (RMS error: 9.482%). . .	168
6.2	The probability of a trip being of a particular distance during a week- day, extrapolated into a Weibull distribution (RMS error: 3.791%). .	170
6.3	Excerpt from the aggregated 50 EVs; charging powers that were each generated from the empirical models.	170
6.4	Sample OpenDSS power networks, where consumers are indicated as red crosses and 11/0.416-kV substations are marked with a green square. Here, (a) is the IEEE PES EU LV test feeder, and (b) is a SSEN Com- mon Information Model (CIM) based feeder	173
6.5	An example plot showing the difference between the fixed voltage threshold (AIMD) and the reference voltage profile (AIMD+) against the load's distance to its feeding substation.	179
6.6	Mean voltage profiles for all four test cases over a single day.	185
6.7	Voltage level probability distribution for the entire feeder where $\zeta_{\text{C}}^* = -0.153$ and $\zeta_{\text{D}}^* = -0.135$	186
6.8	Comparison of voltage improvement indices for (a) ζ_{C}^* indices (AIMD); (b) ζ_{D}^* indices (AIMD+).	186
6.9	Average ζ_{C}^* and ζ_{D}^* values recorded against the corresponding storage uptake.	187

6.10	Line utilisation probability distribution of all lines in the simulated feeder where $\zeta_{\mathbf{C}}^{**} = -0.360$ and $\zeta_{\mathbf{D}}^{**} = -0.518$	188
6.11	Comparison of line utilisation improvement indices for (a) $\zeta_{\mathbf{C}}^*$ indices (AIMD); (b) $\zeta_{\mathbf{D}}^*$ indices (AIMD+).	189
6.12	Average $\zeta_{\mathbf{C}}^{**}$ and $\zeta_{\mathbf{D}}^{**}$ values recorded against the corresponding storage uptake.	190
6.13	Battery power profiles of each load's battery storage device over four days for (a) Case C and (b) Case D	192
6.14	Each load's battery cycling compared for (a) each BESS and (b) the two cases, where $\zeta_{\mathbf{C}}^{***} = 3.89$ and $\zeta_{\mathbf{D}}^{***} = 2.54$	193
6.15	Peak-to-Average Ratios (PAR) of the battery cycling profiles of each load's battery storage device over four days for (a) Case C and (a) Case D	193
6.16	The performance index $\zeta_{\mathbf{C}}^{***}$ for AIMD storage and $\zeta_{\mathbf{D}}^{***}$ for AIMD+ storage control against storage uptake.	194
A.1	Additional substation voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.	246
A.2	Additional ESMU voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.	247
A.3	Additional voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.	248
A.4	Additional phase unbalance cost comparison between base, normal and the case where the ESMU's schedule was adjusted.	249
A.5	Additional power factor cost comparison between base, normal and the case where the ESMU's schedule was adjusted.	250
A.6	Additional comparison of the substation fuse utilisation between base, normal and the case where the ESMU's schedule was adjusted.	251

A.7	Additional line utilisation comparison between base, normal and the case where the ESMU's schedule was adjusted.	252
A.8	Additional comparison of distribution loss cost between base, normal and the case where the ESMU's schedule was adjusted.	253
A.9	Cost difference spread, based on the ESMU schedule adjustment to minimise substation voltage deviation	254
A.10	Cost difference spread, based on the ESMU schedule adjustment to minimise ESMU's PCC voltage deviation	255
A.11	Cost difference spread, based on the ESMU schedule adjustment to minimise the maximum voltage deviation on any bus of the network .	256
A.12	Cost difference spread, based on the ESMU schedule adjustment to minimise the network's phase unbalance	257
A.13	Cost difference spread, based on the ESMU schedule adjustment to minimise the network's power flow in the neutral conductor	258
A.14	Cost difference spread, based on the ESMU schedule adjustment to minimise the network's offset to unity power factor	259
A.15	Cost difference spread, based on the ESMU schedule adjustment to minimise the substation's fuse utilisation	260
A.16	Cost difference spread, based on the ESMU schedule adjustment to minimise the maximum line utilisation of any line in the network . . .	261
A.17	Cost difference spread, based on the ESMU schedule adjustment to minimise distribution losses	262
A.18	Raw time-series that are supposed to be compared.	264
A.19	Rescaled time-series that are supposed to be compared.	264
A.20	Averaged log-scaled time-series.	265
A.21	Splitting of the conditioned data into two stationary sections	265
A.22	Difference of the two pre-conditioned time-series.	266

A.23 Auto-correlation of signal for (A.23a) morning and (A.23b) afternoon	
sections	266
B.1 FIPA Query Protocol flow chart	271
B.2 FIPA Brokering Protocol flow chart	272
B.3 FIPA ContractNet Protocol flow chart	273

Nomenclature

Acronyms

ACL	Agent Communication Language
ADMD	After Diversity Maximum Demand
AIMD	Additive Increase Multiplicative Decrease
AR	Auto-Regressive
ARMAX	Auto-Regressive Moving-Average Exogenous
ARX	Auto-Regressive Exogenous
BES	Battery Energy Storage
BESS	Battery Energy Storage System
CAES	Compressed Air Energy Storage
CREST	Centre for Renewable Energy Systems Technology
DER	Distributed Energy Resource
DG	Distributed Generation
DNO	Distribution Network Operator
DOD	Depth of Discharge
DSM	Demand Side Management
DSR	Demand Side Response
ENW	Electricity North West
EPRI	Electric Power Research Institute
ERL	Energy Research Laboratory
ESMU	Energy Storage Management Unit

ESQCR	Electricity Supply Quality and Continuity Regulations
ESS	Energy Storage Solution
EV	Electric Vehicle
FCES	Fuel Cell driven Energy Storage
FES	Future Energy Scenarios
FIPA	Foundation for Intelligent Physical Agents
FIPA	Foundation for Intelligent Physical Agents
GB	Great Britain
ICT	Information and Communication Technology
IoT	Internet of Things
IoT	Internet of Things
JADE	JAVA Agent Communication Language
JADE	Java Agent Development Environment
LCT	Low Carb on Technology
MPC	Model-Predict Control
NARX	Nonlinear Auto-Regressive Exogenous
NTVV	New Thames Valley Vision
OLTC	On-Line Tap-Changer
P2N	Phase to Neutral
P2P	Phase to Phase
PCC	Point of Common Coupling
PID	Proportional Integrating Derivative (control)
PMU	Power Management Unit
PV	Photovoltaic
SCADA	Supervisory Control And Data Acquisition
SMU	Storage Management Unit
SOC	State of Charge

SPC	Set-Point Control
SQP	Sequential Quadratic Programming
SSEN	Scottish and Southern Electricity Networks
TES	Thermal Energy Storage
UK	United Kingdom
UoR	University of Reading
V2G	Vehicle to Grid
VPP	Virtual Power Plant

Definition variables and dimensionality

\mathbb{C}^B	The B -dimensional set of all complex numbers (for example $\mathbb{Z}^{N \times 3}$ is $N \times 3$ dimensional)
\mathbb{R}_B^A	The A -dimensional set of all real numbers that lie within a range defined in B (for example $\mathbb{R}_{\geq 0}^{N \times 3}$ is $N \times 3$ dimensional set of all real numbers greater than or equal to zero)
\mathbb{Z}_B^A	The A -dimensional set of all integers that lie within a range defined in B (for example $\mathbb{Z}_{\geq 0}^{N \times 3}$ is $N \times 3$ dimensional set of all integers greater than or equal to zero)
$\mathbf{x} = (x(t))$	The element $x(t)$ is part of the vector \mathbf{x}
\mathbf{X}	A matrix named \mathbf{X} where $\mathbf{X} = (\mathbf{x}_i)$
\mathbf{x}	A vector named \mathbf{x} where $\mathbf{x} = (x(t))$
\mathbf{x}_i	A column vector named \mathbf{x} at index i where $\mathbf{X} = (\mathbf{x}_i)$
$x \in (0, 1)$	Scalar named x can take any number within in the exclusive range between zero and one
$x \in [0, 1]$	Scalar named x can take any number within in the inclusive range between zero and one
$x \in \{0, \dots, N\}$	Scalar named x can take any number within the discrete set of numbers of the sequence $\{0, \dots, N\}$
x	A scalar named x

Symbols used in Chapter 3

$\Delta E_{\text{bat}}(t)$	Change in stored energy at time t , where $\Delta E_{\text{bat}}(t) \in \mathbb{R}$
----------------------------	---

$\delta s_{\text{ESMU},\phi}(t)$	Three-phase apparent ESMU power adjustment vector at time t , where $(\delta s_{\text{ESMU},\phi}(t)) = \delta \mathbf{s}_{\text{ESMU}}(t)$ and $\delta s_{\text{ESMU},\phi}(t) \in \mathbb{C}$
Δt	Sample time, where $\Delta t \in \mathbb{Z}_{\geq 0}$
$\delta \mathbf{s}_{\text{ESMU}}(t)$	Three-phase apparent ESMU power adjustment vector at time t , where $(\delta s_{\text{ESMU},\phi}(t)) = \delta \mathbf{s}_{\text{ESMU}}(t)$ and $\delta \mathbf{s}_{\text{ESMU}}(t) \in \mathbb{C}^\Phi$
η	Round-trip efficiency of power electronics, where $\eta \in (0, 1]$
μ	Self-discharge losses of battery, where $\mu \in (0, 1]$
Φ	Number of phases, where $\Phi \in \mathbb{Z}_{>0}$ here $\Phi = 3$
ϕ	Phase number, where $\phi \in \{1, \dots, \Phi\}$
$\mathbf{i}_{\text{line}}(t)$	Multi-phase line currents at time t , where $\mathbf{i}_{\text{line}}(t) = (i_{\text{line},l,\phi}(t))$, and $\mathbf{i}_{\text{line}}(t) \in \mathbb{R}^{L \times \Phi}$
$\mathbf{i}_{ss}(t)$	Multi-phase substation current at time t , where $\mathbf{i}_{ss}(t) \in \mathbb{R}^\Phi$
$\mathbf{s}_{\text{net}}^*$	Half-hourly network load, where $\mathbf{s}_{\text{net}}^* \in \mathbb{C}^{\frac{T_{\text{sch}}}{K}}$
$\mathbf{s}_{\text{ESMU}}(t)$	Three-phase apparent ESMU power at time t , where $\mathbf{s}_{\text{ESMU}}(t) = (s_{\text{ESMU},\phi}(t))$ and $\mathbf{s}_{\text{ESMU}}(t) \in \mathbb{C}^\Phi$
$\mathbf{s}_{\text{load}}(t)$	Apparent load power vector of all loads at time t , where $\mathbf{s}_{\text{load}}(t) \in \mathbb{C}^I$
$\mathbf{s}_{ss}(t)$	Apparent multi-phase power at substation level at time t , where $\mathbf{s}_{ss}(t) \in \mathbb{C}^\Phi$
$\mathbf{v}_{\text{ESMU}}(t)$	Multi-phase voltage vector at ESMU at time t , where $\mathbf{v}_{\text{ESMU}}(t) = (v_{\text{ESMU},\phi}(t))$ and $v_{\text{ESMU},\phi}(t) \in \mathbb{C}^\Phi$
$\mathbf{V}_{\text{load}}(t)$	Multi-phase load voltage vector at time t , where $\mathbf{V}_{\text{load}}(t) = (v_{\text{load},i,\phi}(t))$ and $\mathbf{V}_{\text{load}}(t) \in \mathbb{C}^{I \times \Phi}$
$\mathbf{v}_{ss}(t)$	Phase voltage vector at time t , where $\mathbf{v}_{ss}(t) \in \mathbb{R}^\Phi$
$\text{UF}(\mathbf{x})$	Function calculating the Unbalance Factor (UF) for any multidimensional vector \mathbf{x} , where $\mathbf{x} = (x_n)$, $n \in \mathbb{Z}_{>0}$ and $\text{UF}(\mathbf{x}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{fuse utilisation}}(\mathbf{i}_{ss}(t))$	Fuse utilisation cost, derived from multi-phase substation current vector \mathbf{i}_{ss} at time t , where $\zeta_{\text{fuse utilisation}}(\mathbf{i}_{ss}(t)) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{load voltage}}(\mathbf{v}(t))$	Voltage deviation cost for load voltage vector \mathbf{v} at time t and $\zeta_{\text{load voltage}}(\mathbf{v}(t)) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{losses}}(s(t))$	Losses based cost function, where $\zeta_{\text{losses}}(s(t)) \in \mathbb{R}_{\geq 0}$

$\zeta_{\text{MMD}}(\mathbf{s})$	Cost of the underlying power profile \mathbf{s} , based on the Minimum-Maximum Difference (MMD), where $\zeta_{\text{MMD}}(\mathbf{s}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{neutral load}}(\mathbf{s}(t))$	Neutral load cost function for multi-phase apparent power vector \mathbf{s} at time t , where $\zeta_{\text{neutral load}}(\mathbf{s}(t)) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{PAR}}(\mathbf{s})$	Cost of the underlying power profile \mathbf{s} , based on the Peak to Average Ratio (PAR), where $\zeta_{\text{PAR}}(\mathbf{s}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{PF}}(\mathbf{s}(t))$	Power Factor (PF) cost function for multi-phase apparent power vector \mathbf{s} at time t , where $\zeta_{\text{PF}}(\mathbf{s}(t)) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{TRA}}(\mathbf{s})$	Cost of the underlying power profile \mathbf{s} , based on the power transients (TRA), where $\zeta_{\text{MMD}}(\mathbf{s}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{unbalance}}(\mathbf{s}(t))$	Power unbalance for multi-phase apparent power vector \mathbf{s} at time t , where $\zeta_{\text{unbalance}}(\mathbf{s}(t)) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{voltage}}(\mathbf{v}(t))$	Voltage deviation cost for voltage vector \mathbf{v} at time t , where $\zeta_{\text{voltage}}(\mathbf{v}(t)) \in \mathbb{R}_{\geq 0}$
C_{bat}	Battery capacity, where $C_{\text{bat}} \in \mathbb{R}_{>0}$
C_f	Charge factor or “C-factor” of the battery, where $C_f \in \mathbb{R}_{>0}$
$E_{\text{bat}}(t)$	Energy stored in battery at time t , where $E_{\text{bat}}(t) \in \mathbb{R}_{>0}$
I_{fuse}	Nominal fuse rating at substation, where $I_{\text{fuse}} \in \mathbb{R}$
$i_{\text{line},l,\phi}(t)$	Single-phase line current for phase ϕ of line l at time t , where $i_{\text{line},l,\phi}(t) \in \mathbb{R}$
$I_{\text{nom},l}$	Nominal line current for line l , $I_{\text{nom},l} \in \mathbb{R}$
$i_{\text{ss},\phi}(t)$	Single-phase substation current for phase ϕ at time t , where $i_{\text{ss},\phi}(t) \in \mathbb{R}$
K	Number of sample periods over which the sub-half-hourly is to be downsampled, where $K \in \mathbb{Z}_{>0}$ and $\frac{T_{\text{sch}}}{K} \in \mathbb{Z}_{>0}$
$k(t)$	Synchronisation function used to downsample the sub-half-hourly profile
L	Number of lines, where $L \in \mathbb{Z}_{>0}$
l	Line number, where $l \in [1, \dots, L]$
$p_{\text{bat}}(t)$	Single-phase active battery power at time t , where $p_{\text{bat}}(t) \in \mathbb{R}$
$s_{\text{net}}^*(t)$	Half-hourly network load, where $\mathbf{s}_{\text{net}}^* = (s_{\text{net}}^*(t))$ and $s_{\text{net}}^*(t) \in \mathbb{C}$

$s_{\text{losses}}(t)$	Total apparent power losses in the network $s_{\text{losses}}(t) \in \mathbb{C}$
$s_{\text{net}}(t)$	Apparent network load at time t , where $s_{\text{net}}(t) \in \mathbb{C}$
S_{rating}	Rating of battery's power electronics, where $S_{\text{rating}} \in \mathbb{R}_{>0}$
$s_{\text{ESMU},\phi}(t)$	Single-phase apparent ESMU power for phase ϕ at time t , where $\mathbf{s}_{\text{ESMU}}(t) = (s_{\text{ESMU},\phi}(t))$ and $s_{\text{ESMU},\phi}(t) \in \mathbb{C}$
$s_{\text{load},i}(t)$	Apparent load power for load i at time t , where $\mathbf{s}_{\text{load}}(t) = (s_{\text{load},i}(t))$ and $s_{\text{load},i}(t) \in \mathbb{C}$
$s_{\text{ss},\phi}(t)$	Apparent single-phase power at substation level for phase ϕ at time t , where $\mathbf{s}_{\text{ss}}(t) = (s_{\text{ss},\phi}(t))$
$SOC(t)$	State of charge at time t , where $SOC(t) \in (0, 1)$
T	Length of simulation, where $T \in \mathbb{Z}_{\geq 0}$
t	Time-steps of the simulation, where $t \in \{1, \Delta t, 2\Delta t, \dots, T\}$
T_{sch}	Scheduling horizon, where $T_{\text{sch}} \in \mathbb{Z}_{>0}$
V_{ss}	Nominal substation voltage, where $V_{\text{ss}} \in \mathbb{R}$
V_h	High-voltage threshold of statutory voltage band, where $V_h \in \mathbb{R}$
V_l	Low-voltage threshold of statutory voltage band, where $V_l \in \mathbb{R}$
$v_{\text{ESMU},\phi}(t)$	Phase voltage at ESMU for phase ϕ at time t , where $\mathbf{v}_{\text{ESMU}}(t) = (v_{\text{ESMU},\phi}(t))$ and $v_{\text{ESMU},\phi}(t) \in \mathbb{C}$
$v_{\text{load},i,\phi}(t)$	Phase voltage of load i for phase ϕ at time t , where $\mathbf{V}_{\text{load}}(t) = (v_{\text{load},i,\phi}(t))$ and $v_{\text{load},i,\phi}(t) \in \mathbb{C}$
$v_{\text{ss},\phi}$	Phase voltage at substation for phase ϕ at time t , where $\mathbf{v}_{\text{ss}}(t) = (v_{\text{ss},\phi}(t))$

Symbols used in Chapter 4

α	PID weight vector for SOC compensator PID ₁ , where $\alpha = \{\alpha_P, \alpha_I, \alpha_D\}$ and $\alpha \in \mathbb{R}^3$
β	PID weight vector for predictor compensator PID ₂ , where $\beta = \{\beta_P, \beta_I, \beta_D\}$ and $\beta \in \mathbb{R}^3$
Δt	Sub-half-hourly sample period, where $\Delta t \in \mathbb{Z}^{>0}$
η	Round-trip efficiency of power electronics, where $\eta \in (0, 1]$
$\hat{p}_{\text{net}}(t + \Delta t)$	Predicted next network power at sample t

μ	Self-discharge losses of battery, where $\mu \in (0, 1]$
\mathbf{a}	Weight vector for compensator input regression of the AR model, where $\mathbf{a} = \mathbb{R}^N$
\mathbf{b}	Weight vector for compensator output regression of the AR model, where $\mathbf{b} = \mathbb{R}^N$
\mathbf{p}	ESMU power vector, where $\mathbf{p} = (p(t))$
\mathbf{p}_{for}	Half-hourly load forecast vector that is used for computing the ESMU schedule, where $\mathbf{p}_{\text{for}} = (p_{\text{for}}(k(t)))$
\mathbf{p}_{sch}	Half-hourly schedule vector that is generated from the load forecast, where $\mathbf{p}_{\text{sch}} = (p_{\text{sch}}(k(t)))$
\mathbf{p}_{bat}	Battery power vector, where $\mathbf{p}_{\text{bat}} = (p_{\text{bat}}(t))$
$\zeta(\mathbf{p})$	Global cost for a given power profile \mathbf{p}
$\zeta_{\text{MMD}}(\mathbf{p})$	Cost of a power profile \mathbf{p} , based on the difference between minimum and maximum power, where $\zeta_{\text{MMD}}(\mathbf{p}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{PAR}}(\mathbf{p})$	Cost of a power profile \mathbf{p} , based on Peak-to-Average Ratio (PAR), where $\zeta_{\text{PAR}}(\mathbf{p}) \in \mathbb{R}_{\geq 0}$
$\zeta_{\text{TRA}}(\mathbf{p})$	Cost of a power profile \mathbf{p} , based on largest power transient, where $\zeta_{\text{TRA}}(\mathbf{p}) \in \mathbb{R}_{\geq 0}$
C_{bat}	Battery capacity in kWh, where $C_{\text{bat}} \in \mathbb{Z}^{>0}$
C_f	Charge factor or “C-factor” of the battery, where $C_f \in \mathbb{Z}^{>0}$
$E_{\text{SOC}}(t)$	Error in state of charge at sample t , where $E_{\text{SOC}}(t) \in \mathbb{R}$
$E_p(t)$	Difference between current and predicting network power at sample t , where $E_p(t) \in \mathbb{R}$
$k(t)$	Sampling time conversion function, linking sub-half hourly samples t at sampling period Δr to half-hourly period $30\Delta t$
N	Number of regressors of the AR model, where $N \in \mathbb{Z}_{>0}$
$p(t)$	ESMU power at time t , where $\mathbf{p} = (p(t))$ and $p(t) \in \mathbb{Z}$
$p_1(t)$	Corrective ESMU power components from PID ₁ , where $p_1(t) \in \mathbb{R}$
$p_2(t)$	Corrective ESMU power components from PID ₂ , where $p_2(t) \in \mathbb{R}$
$p_{\text{for}}(k(t))$	Half-hourly load forecast that is used for computing the ESMU schedule, where $p_{\text{for}}(k(t)) \in \mathbb{Z}$

$p_{\text{net}}(t)$	Most recent network demand at sample t , where $\mathbf{p}_{\text{net}} = (p_{\text{net}}(t))$ and $p_{\text{net}}(t) \in \mathbb{R}$
$p_{\text{sch}}(k(t))$	Half-hourly schedule that is generated from the load forecast, where $p_{\text{sch}}(k(t)) \in \mathbb{Z}$
P_{bat}	ESMU power electronic rating, where $P_{\text{bat}} \in \mathbb{Z}^{>0}$
$p_{\text{bat}}(t)$	Battery power at time t , which is derived from $p(t)$, where $\mathbf{p}_{\text{bat}} = (p_{\text{bat}}(t))$ and $p(t) \in \mathbb{Z}$
$SOC(t)$	Scheduled state of charge at sample t
$SOC^*(t)$	Battery's state of charge at sample t , where $SOC^*(t) \in [0, 1]$
SOC_{tol}	SOC tolerance, i.e. maximum deviation from the prescheduled SOC profile, where $SOC_{\text{tol}} \in [0, 0.5]$
T	Number of samples during the entire simulation, where $T \in \mathbb{Z}_{>0}$
t	Discrete sample of time, where $t \in \{0, \Delta t, \dots, T\Delta t\}$
T_{sch}	Length of scheduling horizon, where $T_{\text{sch}} \in \mathbb{Z}_{>0}$ and $T \geq T_{\text{sch}}$

Symbols used in Chapter 5

α	Undoing parameter to remove a portion of the temporary energy demand, $\hat{E}_{u,n}$, where $\alpha \in (0, 1]$
β	Allocation parameter to assign a portion of the temporary energy demand, $\hat{E}_{u,n}$, where $\beta \in (0, 1]$
Δt	Sample period for EV scheduling, where $\Delta t \in \mathbb{R}^{>0}$
$\hat{\mathbf{p}}_{u,n}^{\text{EV}}$	Temporary charging vector during iteration number n , for EV u , where $\hat{p}_{u,n}^{\text{EV}}(t) \in \hat{\mathbf{p}}_{u,n}^{\text{EV}}$
$\hat{\mathbf{p}}_{\text{base},n}$	Temporary demand vector, i.e. the aggregate of all EV charge vector and the baseline load vector, where $\hat{p}_n^{\text{base}}(t) \in \hat{\mathbf{p}}_{\text{base},n}$
$\hat{p}_n^{\text{base}}(t)$	Temporary demand at time t , i.e. the aggregate of all EV charge vector and the baseline load vector, where $\hat{p}_n^{\text{base}}(t) \in \mathbb{Z}^{\geq 0}$
$\hat{p}_{u,n}^{\text{EV}}(t)$	Temporary charging power during iteration number n , for EV u , at time t , where $\hat{p}_{u,n}^{\text{EV}}(t) \in \mathbf{Z}^{\geq 0}$
$\mathbf{p}_n^{\text{base}}$	Baseline load vector, where $p_n^{\text{base}}(t) \in \mathbf{p}_n^{\text{base}}$
$\mathbf{p}_{u,n}^{\text{EV}}$	Scheduled EV charging power vector, for EV u at algorithm iteration n , where $\mathbf{p}_{u,n}^{\text{EV}} = (p_{u,n}^{\text{EV}}(t))$

N	Number of algorithm iterations to schedule multiple EVs, where $N \in \mathbb{Z}^{>0}$
n	Iteration number of EV scheduling algorithm, where $N \in [1, \dots, N]$
$p_n^{\text{base}}(t)$	Baseline load at time t , where $p_n^{\text{base}}(t) \in \mathbb{Z}^{\geq 0}$
$p_{u,n}^{\text{EV}}(t)$	Scheduled EV charging power, for EV u at algorithm iteration n for time t , where $p_{u,n}^{\text{EV}}(t) \in \mathbb{R}^{\geq 0}$
P_u^{min}	Maximum EV charging power
P_u^{min}	Minimum EV charging power
T^{sch}	Scheduling horizon for EV charging, where $T^{\text{sch}} \in \mathbb{Z}^{>0}$
U	Number of EVs that need to be scheduled, where $U \in \mathbb{Z}^{>0}$
u	EV unit number, where $u \in [1, \dots, U]$

Symbols used in Chapter 6

α	Control parameter that regulates the additive increase, where $\alpha \in [0, 1]$
β	Control parameter that regulates the multiplicative decrease, where $\beta \in [0, 1]$
Δt	Sampling period, where $\Delta t \in \mathbb{Z}_{>0}$
$\Delta \text{SOC}(t)$	Change in SOC during time period Δt , where $\Delta \text{SOC}(t) \in [-1, 1]$
$\delta^{**}(c)$	Scaling function for a current c , which is used in the metric to quantify improvements in line utilisation for a case named \mathbf{X} , where $\delta^{**}(c) \in \mathbb{R}$
$\delta^*(v)$	Scaling function for a voltage v , which is used in the metric to quantify improvements in voltage levels for a case named \mathbf{X} , where $\delta^*(v) \in \mathbb{R}$
η	Energy conversion efficiency, where $\eta \in (0, 1]$
$\hat{\eta}$	Direction dependent energy conversion efficiency, where $\hat{\eta} \in (0, 1]$
$\hat{n}_x(t)$	Predicted EV demand data, where $n_r(t) \in \mathbb{R}$
μ	Self-discharge loss factor, where $\mu \in (0, 1]$
$\text{SOC}(t)$	Battery state of charge at time t , where $\text{SOC}(t) \in [0, 1]$
SOC_{max}	Maximum rated SOC for limited battery operation, where $\text{SOC}_{\text{min}} < \text{SOC}_{\text{max}}$ and $\text{SOC}_{\text{max}} \in [0, 1]$

SOC_{\min}	Minimum rated SOC for limited battery operation, where $\text{SOC}_{\min} < \text{SOC}_{\max}$ and $\text{SOC}_{\min} \in [0, 1]$
$\zeta_{\mathbf{C}}^{***}$	Equality metric of using distributed BESS for Case C
$\zeta_{\mathbf{C}}^{**}$	Metric quantifying improvements in line utilisation for Case C , where $\zeta_{\mathbf{D}}^{**} \in \mathbb{R}$
$\zeta_{\mathbf{C}}^*$	Metric quantifying improvements in voltage levels for a Case C (i.e. AIMD), where $\zeta_{\mathbf{C}}^* \in \mathbb{R}$
$\zeta_{\mathbf{D}}^{***}$	Equality metric of using distributed BESS for Case D
$\zeta_{\mathbf{D}}^{**}$	Metric quantifying improvements in line utilisation for Case D , where $\zeta_{\mathbf{D}}^{**} \in \mathbb{R}$
$\zeta_{\mathbf{D}}^*$	Metric quantifying improvements in voltage levels for a Case D (i.e. AIMD+), where $\zeta_{\mathbf{D}}^* \in \mathbb{R}$
C	Battery capacity, where $C \in \mathbb{R}_{>0}$
C_{\min}	Minimum necessary line loading to take the changes into account, where $C_{\min} \in [0, 1]$
$n_s(t)$	Probability of starting a trip, where $n_s(t) \in [0, 1]$
$P_{\mathbf{B}}(c)$	Probability distribution of line utilisation for Case B (i.e. baseline case), where $P_{\mathbf{B}}(c) \in \mathbb{R}_{\geq 0}$
$P_{\mathbf{B}}(v)$	Probability distribution of voltage levels for case Case B (i.e. baseline case), where $P_{\mathbf{B}}(v) \in \mathbb{R}$
$P_{\mathbf{C}}(c)$	Probability distribution of line utilisation for Case C (i.e. AIMD), where $P_{\mathbf{C}}(c) \in \mathbb{R}_{\geq 0}$
$P_{\mathbf{C}}(v)$	Probability distribution of voltage levels for case Case C (i.e. AIMD), where $P_{\mathbf{C}}(v) \in \mathbb{R}$
$P_{\mathbf{D}}(c)$	Probability distribution of line utilisation for Case D (i.e. AIMD+), where $P_{\mathbf{D}}(c) \in \mathbb{R}_{\geq 0}$
$P_{\mathbf{D}}(v)$	Probability distribution of voltage levels for case Case D (i.e. AIMD+), where $P_{\mathbf{D}}(v) \in \mathbb{R}$
$p_{\text{bat}}(t)$	Battery power at time t , where $p_{\text{bat}}(t) \in \mathbb{R}$
P_{\max}	Power rating of battery, where $P_{\max} \in \mathbb{R}_{>0}$
U	Number of BESS units in the network
$v_{\text{bat}}(t)$	The current BESS voltage at time t , where $v_{\text{bat}}(t) \in \mathbb{R}$

$w_x(t)$ Trip distance probability for weekends ($w_{we}(t)$) and week-days ($w_{wd}(d)$), where $w_x(t) \in [0, 1]$

Chapter 1

Introduction

The aim of the work that is presented in this thesis is to make a contribution in control of Battery Energy Storage Systems (BESS) that can aid Distribution Network Operators (DNOs) in improving the operation and reliance of their Low-Voltage (LV) networks. By adjusting sub-half-hourly operation and communication regimes of the BESS grid operation, performance is improved by mainly considering peak power flow; but performance criteria also include voltage deviation, phase imbalance, distribution losses and the magnitude of neutral currents.

Providing BESS based network support is expected to become a vital necessity since the predicted increase in electricity demand and its volatility will negatively effect the performance of the UK distribution networks. Due to the design and topology of the network higher and more volatile demand is predicted to cause issues including voltage deviation, asset overloads, equipment damage and (in the worst case) service disruptions. As discussed in this thesis, BESS is a suitable alternative to traditional network reinforcements. However, successfully combining fast system response capabilities (at sub-half-hourly resolution) with traditional operation schedules (at half-hourly resolution) to yield the best impact on network performance is still an open research challenge. Also, with the proliferation of household-connected

BESS and Electric Vehicles (EVs), the development of control methods (particularly in respect to communication and synchronisation requirements that are needed to coordinate BESS operation) is also an ongoing research challenge.

In Chapter 1, the background and motivation for the conducted research are presented. Then, on the basis of the identified challenges and opportunities for battery energy storage in the electricity distribution network, the problem statement and all research objectives are outlined. At the end of this chapter, all contributions and publications are summarised, and the structure of the rest of this thesis is presented.

1.1 Background and motivation

Today's society and economy are highly dependent on the continuous availability of energy or more specifically: electric energy. In the UK, demand for electricity has increased over the past decades and this trend is expected to continue into the future [5]. This increase is only accelerated since a major focus of UK energy policies has been put on transitioning towards a low carbon economy [6]. Particularly the decarbonisation of heat and transport sectors are two areas of significant strategic focus and Low Carbon Technology (LCT) such as Photovoltaic (PV) installations, Electric Vehicles (EVs) and heat pumps are expected to contribute significantly to the energy mix of this transition.

As the uptake of LCTs continues and they start penetrating power distribution networks, stress on these networks will also continue to increase, resulting in issues that in the worst case will lead to additional service disruptions. Furthermore, the uptake of LCTs is not expected to progress evenly throughout the entire power network, but instead clusters of early adopters are predicted to form, leading to certain LV networks exceeding their operational constraints even at a relatively low national rate of LCT adaption [7]. The scale of this energy transition becomes becomes par-

ticularly apparent when referring to the UK’s 2017 Future Energy Scenarios (FES) comparing the predicted future load scenarios for the upcoming decades [1].

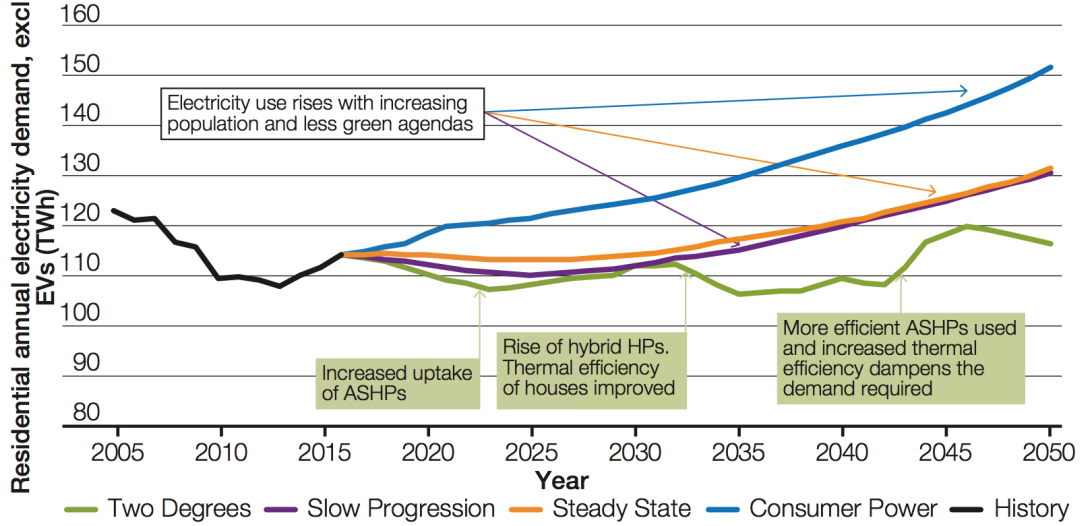


Figure 1.1: Change in residential annual electricity demand excluding electric vehicles from FES2017 [1]

Figure 1.1 shows the predicted increase in annual residential electricity demand. Here, the market driven scenario or the “Consumer Power” scenario shows the largest increase until 2050. When putting more emphasis on environmental concerns, the “Two Degrees” scenario is considered instead. This scenario refers to the intention of limiting global temperature increase to two degrees; in previous FES reports this scenario was referred to as “Gone Green“. According to the FES 2017 those two scenarios enable a continuing growth of the UK economy, but put very different emphasis on decarbonisation targets. Although the rise in demand for electricity is projected to differ by more than 30TWh in 2050 (for instance if the “Two Degrees” scenario is achieved), the aforementioned uptake of LCTs like EVs is expected to put additional load onto the power network in both scenarios.

When focusing on the electrification of personal transport, for example by introducing EVs into the electricity demand, Figure 1.2 shows that both the “Consumer Power” as well as the “Two Degrees” scenario will add more than 35TWh of annual

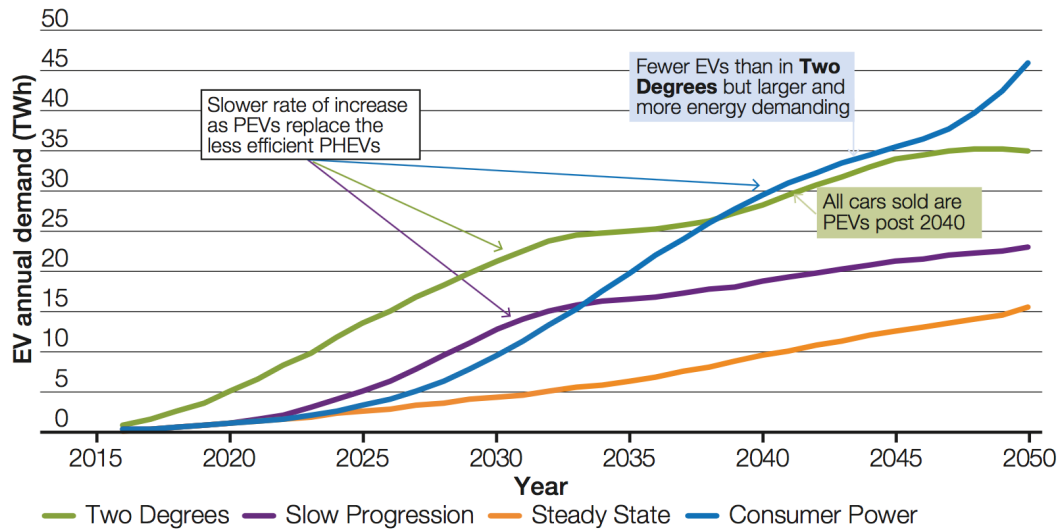


Figure 1.2: Rise in energy demand due to the uptake of electric vehicles as predicted by FES 2017 [1]

energy demand by 2045. Since most of these EVs were expected to charge at home and (at least in the beginning) at similar times, aggregating effects will not only exhaust national energy supply capabilities but also power distribution capacities.

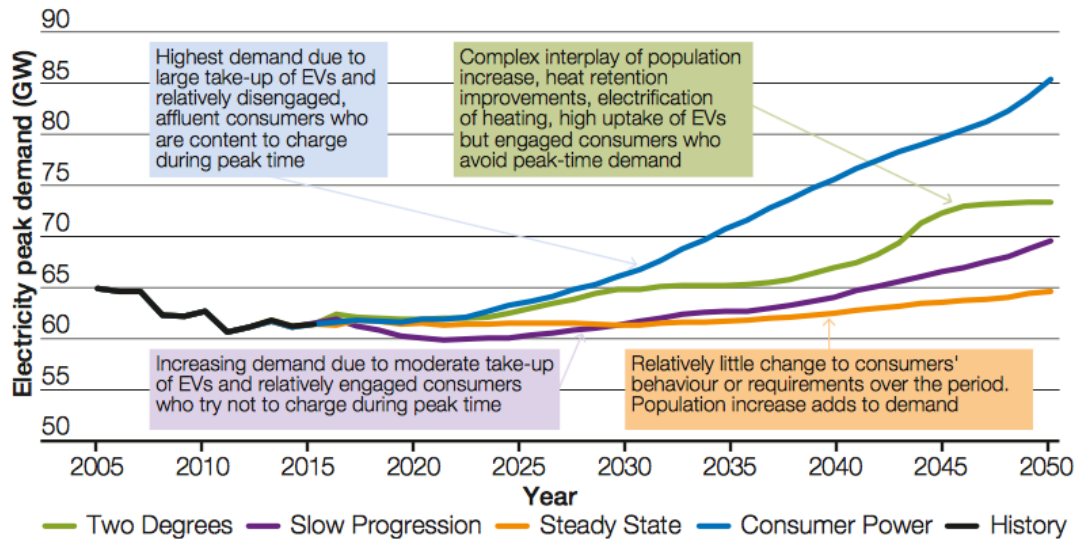


Figure 1.3: Change in annual peak power demand as predicted by FES2017 [1]

Figure 1.3 highlights this fear since uncontrolled proliferation of LCTs and EVs, as shown in the “Consumer Power” scenario, will add more than 20GW of power

demand onto the present peak power level. Such a rise in peak power exceeds today’s supply capacities since the new energy mix and decommissioning of fossil fuelled power plants have resulted in the present capacity margin to only lie between 3.7GW and 4.9GW [8] (this equates to a 7.2% margin whilst in for example 2010 this margin was at 15% with 11.7GW [9]).

Although FES 2017 expects the “Two Degrees” scenario to also show an increase in peak power, better coordination and control is expected to mitigate half of the 20GW peak increase. From this point of view, today’s narrow capacity margins could already cater for nearly half of the increase in peak demand that is expected to occur over the next 33 years (i.e. until 2050). Whilst UK power transmission networks are being upgraded and will therefore be capable of handling this increased power demand, the increasing stress on the distribution network still remains. This stress is due to the fact that loads in the residential and commercial sectors are typically situated at the network edge in the LV distribution network and reinforcing these networks can result in costly service disruptions.

1.1.1 Topology and challenges of the UK electricity network

The UK electricity network in its present form has grown over the past century and is based on an interconnected high-voltage network. Its largest part is also known as the transmission network, which connects remote power stations to distribution networks. Typically those distribution networks supply electricity to all loads across the mainland of the UK, including industrial, urban and rural customers¹. However, larger customers that are not situated within the distribution network need not be supplied by said network.

The entire structure of the electricity network is a three-phase Alternating Current

¹Some small and remote UK islands like the Shetland islands are not connected to this national grid and have their separate electricity infrastructure. Therefore they are not considered as part of this thesis since the study of this kind of network lies outside the research scope.

(AC) system, allowing easy voltage level conversion with the use of transformers and without the need for power electronics. In the UK, the highest voltage level for generation and transmission is 400kV. Such a high voltage requires a relatively small current to transmit the generated bulk power, which in turn reduces conduction losses and maximises the efficiency of the network. Regional supply points step-down this high voltage to 132kV² to deliver power to Distribution Network Operators (DNOs). From the primary level of the distribution network and onwards, this so called medium-voltage is stepped down to 33kV, then 11kV and finally 400V phase to phase (P2P), in order to cater for heavy industry, medium clients and household sized customers, respectively. In the UK, all households are connected to one of the three phases of the distribution network and therefore are supplied at a nominal voltage of 230V (phase to neutral - P2N). To achieve a balanced network, each customer's phase allocation is chosen at pseudo-random³.

This LV part of the electricity network is its weakest part, since its assets were designed to cater for small powers between 315kVA to 500kVA [12]. Despite this capacity limitation, DNOs aim to maintain distribution level voltages within their statutory operating bands of 230V +10% -6% for the LV network. This band is defined by the Electricity Supply Quality and Continuity Regulation (ESQRC) [13] and Engineering Recommendation G59 [14]. Primary substations in the UK are equipped with regulation equipment, like On-Line Tap-Changers (OLTC), to increase or decrease the voltage on the secondary transformer side depending on the current level of demand. Secondary transformers do not have such regulating equipment and instead apply a constant voltage conversion ratio which is set according to the network's typical demand.

A project based on the findings from *Electricity North West* (ENW) in [15] em-

²In some cases regional supply points provide 127kV instead of 132kV.

³Guidance for customer phase allocation is not explicitly specified in the network's design framework [10]. Therefore, choosing the "top phase" qualifies as pseudo-random phase allocation with statutory compliance [11].

phases the issues that result from residential increase in demand for electricity. In summary, their findings highlight issues regarding voltage deviation due to an uptake of LCTs. More specifically however, in the ENW lead project 200 LV networks in the UK were monitored to assess the capacity for LCT adoption. Initial findings showed that even in the present distribution networks, 15% of all monitored substations experienced reverse power flow, 4.5% substations reported high voltages (i.e. above 253V), and only 2% substations reported occasional low voltages (i.e. below 216V). With the voltage drop assumption however, it was believed that customers in these network were still operating at BSEN50160 compliant voltage levels. Models to assess the LCT headroom indicated that the first issue will always be voltage deviation and the thermal/capacity limits are of second concern. This finding is based on the fact that LV networks are highly resistive and rarely managed in an active manner. Therefore, as the number of PV installations is expected to grow the voltage deviation magnitude and frequency will increase [16]. Since the expected voltage deviation was caused despite a relatively low adaptation of residential LCTs, strict precautionary regulation has been put in place to assure continuous operation without violating any operational constraints. Otherwise additional voltage deviation, unbalanced network operation or asset overloads would be the result.

Traditional network planning approaches that have been used by DNOs to expand and install network assets were designed to circumvent such issues in order to follow the aforementioned standards and regulations. The most common approach follows the commonly used practice of aggregating a large number of customers and designing the power delivery network to cater for their largest probable demand. This method is called the After Diversity Maximum Demand (ADMD) method [17] and uses historical load analysis and standard growth assumptions that are both no longer valid in this unprecedented LCT uptake scenario [18]. To make things worse, LV networks in the UK are generally unmonitored once installed [18]. Distribution Network

Operators (DNOs) have become aware of this issue and are developing updated planning strategies involving “smart” and “flexible” electricity grids [19]. However, in situ equipment that will become subject to the same adaptation of LCT needs to be managed actively via innovation in the use of existing and new technologies. Otherwise both frequency of service disruptions and customer minutes lost will increase alongside the proliferation of LCTs [20]. One such innovative technology, which is the main focus of the presented thesis, is the installation and management of battery storage [21]. The following section is going to introduce the two favoured solutions to address network issues and explain why battery energy storage was chosen as part of the presented research.

1.1.2 Solutions to mitigate impact of LCT

The two most favoured solutions that allow DNOs to support LV network operation are: 1. the reinforcement of in situ network assets or 2. the deployment of network support equipment. Whilst network reinforcement certainly addresses the immediate issues of current network capacity constraints, this approach is also the more expensive and disruptive option. More specifically, certain customers need to deal with outages during periods of asset upgrades (for example transformer upgrade and line re-conductoring after secondary transformers’ tap settings have been adjusted). Therefore, alternatives to defer or avoid network reinforcements have been pursued and assessed [22–25]. Most promising alternatives are to install flexible and controllable Distributed Energy Resources (DERs) or, more specifically, Battery Energy Storage Solutions (BESS) [26]. After all, BESS has not only seen significant advancements in technology, but also received increasing attention in both academic studies and industry trials [27].

Installing BESS at a strategic location in the LV network brings several advantages, for instance to better control the network performance. Roles for and advan-

tages of energy storage technology are extensively reviewed in Section 2.2. Nonetheless, a few examples of benefits from BESS are highlighted here. For instance, they include the regulation of voltages in order to to operate within statutory voltage bands [28], they allow shaving peak loads to relieve stress from the installed network assets [29], and enable the reduction of phase unbalance to increase network efficiency [30]. These three examples all implement a similar control paradigm where BESS is charged during periods of low demand and discharged at peak demand periods in order to achieve the best possible impact. Whilst the questions regarding locating and scaling of BESS have mostly been addressed, BESS control can still be split into two complementing yet unmarried approaches:

1. “off-line” control, using load forecasts and BESS schedules [31–34], and
2. “on-line” control, using Set-Points Control (SPC), Model Predictive Control (MPC) or similar dynamic control methods [35–38].

These two control approaches are reviewed in detail in Section 2.4.1. Also, with the anticipated uptake of household BESSs and DERs, mechanisms to control and coordinate multiple storage systems have also grown in popularity [39–42]. An example in [42] proposes to store solar energy in order to support charging of EVs and is particularly interesting since it shows a well coordinated home storage system that does not impose any additional load onto the power distribution network. These results also highlight that without rooftop PV installations (or any co-located energy resource for that matter), distributed storage systems need to work in a cooperative manner to avoid adding network straining. Control methods that are capable of coordinating DERs by letting devices make intelligent control decisions have been summarised under the keyword “smart control”.

1.1.3 Smart control

As already mentioned in the previous section, Section 1.1.2, off-line and on-line control strategies exist to manage BESS. This traditional control often dealt with the dispatch of a single energy entity, but due to the distributed nature of the expected LCT uptake, methods to manage cooperative behaviour needed to be developed, too. With the penetration of smart meters and communication-enabled devices in for example the “Internet of Things” (IoT), power systems have the potential of becoming interlinked networks of smart devices. Therefore “smart control” mechanisms can complement the traditional off-line and on-line control strategies and are of great research interest to enable the uptake of distributed LCTs since these strategies remove the single point of failure, reduce computational burden from centralised controllers and allow individual devices to respond intelligently and quickly to local events like sudden voltage drops or capacity notifications.

For example the key term “smart charging” summarises EV charging mechanisms where the limited distribution network capacity causes multiple EVs to share the available resource amongst themselves [43–45]. However without any network load information EV coordination still exhausts the network’s capacity, even when EVs are intelligently limiting their maximum charging rates. Limiting their charge rates based upon the current network demand as well as their own energy needs is a more sophisticated control option [46]. A similar key term is the “smart grid” where DER communicate and cooperate in order to, for example, shed load using Demand Side Response (DSR) or maintain microgrid operation in fault situations [47–49]. However, the fundamental requirement for the successful realisation of any such smart control method is the reliable exchange of information amongst the participating entities that physically operate within the power network.

Therefore smart control does not only require robust control mechanisms, but also a robust communication infrastructure. In Section 2.4.2, literature that reviews and

compares centralised control methods with distributed control paradigms will show the implicit need to synchronise the coordination of multiple smart devices to achieve their promised benefits. It will be shown that all underlying control mechanisms dealing with the coordination of distributed energy resources either explicitly or implicitly assume a robust communication infrastructure where communication is synchronised. For instance, this requirement is assumed whenever messages are received and executed immediately (i.e. without delay) after they have been dispatched or whenever a single control instruction result in the synchronised reaction of all controlled entities. In reality however, the strength of the communication link does vary with weather or current network traffic, so that fixed message delays and exact device synchronisation can no longer be guaranteed. Therefore, not only smart control algorithms, but also their sensitivity to the strength of the underlying communication infrastructure is of interest. As a result the research question can be risen whether communication desynchronisation can result in equal or better coordination performance; i.e. in reducing peak load.

The alternative to relying on telecommunication in order to coordinate DERs is to remove the requirement for device communication altogether. For instance, communication-less control of multiple power devices has been of particular interest in noisy environments like ships [50] or islanded power networks that do not have strong telecommunication capabilities [51]. Whilst these control methods support network operation they have not been designed to take device operation into account. More specifically, in a network where devices like household-connected BESS are no longer owned by DNOs, the interest of guaranteeing a certain lifetime is likely to surpass the need to provide network support operation. Therefore distributed and communication-less control strategies need to assure a more equal device utilisation to spread to burden onto the entire collection of DERs. Otherwise, batteries situated at the end of the distribution network experience the largest voltage swing and are

therefore likely to cycle more than those batteries located closer to the substation where voltages are more stable. Hence, following the review of several communication-less control methods in Section 2.4.3, an improved distributed and communication-less BESS control algorithm is proposed that takes this neglected network inequality into account.

1.2 Problem statement and research objectives

The focus of the research presented in this thesis is put on aiding DNOs to manage and operate their power distribution networks by installing energy storage into their distribution networks in order to counteract the effects from electrification of heat and transport sectors as well as the decarbonisation of the grid itself. Therefore BESS control is the main focus of this work since BESS is a rapidly improving technology that has the potential to defer or even mitigate costly network reinforcements. Modern battery technology allows the storage of electrical energy in ever-decreasing form factors, whilst power electronics technology becomes more efficient at integrating batteries into power networks. As shown in the literature review in Chapter 2, methods to control BESS, for instance, in order to optimise power flow, have been and still are of great research interest.

Therefore, the aim of this thesis is to present a contribution in BESS control to improve grid operation and reliance, when deploying it in the UK LV distribution network. Given the already established control approaches of “off-line” and “on-line” control, merging the two in order to take advantage of BESS schedules and real-time information is still an open research challenge. Subsequently, applying real-time corrections to BESS schedules in order to decrease peak demand whilst obeying to technical and operational constraints is also an identified research challenge. Since the expected uptake of distributed LCTs and DERs through proliferation of household-

connected storage solutions (for example to support PV integration or to counteract EV impacts) requires “smart” coordination mechanisms. When requiring communication to implement this smart coordination, another challenge exists in developing algorithms that function despite communication disturbances (i.e. through message desynchronisation). Lastly, in the case where communication-less coordination of distributed devices is sought, the challenge of assuring equal device usage whilst providing network support (for example to guarantee a minimum lifetime) has also been identified.

These research challenges are extensively reviewed in the literature review in Chapter 2, and in accordance to these identified key challenges that motivate the conducted research, a set of objectives is presented in order to achieve the aim of contributing to the existing field:

Objective 1 Develop a control mechanism for a single BESS to further improve three-phase network operation without changing half-hourly real power schedules by adjusting BESS power phasors and reactive power injection.

Objective 2 Develop a control mechanism that dynamically adjusts half-hourly schedules on a sub-half-hourly basis, hence modifying the half-hourly schedule to reduce daily load peaks by combining control elements from both off-line and on-line control.

Objective 3 Develop and compare operation of a scheduling algorithm that manages the charging behaviour of multiple BESS by submitting it to performance analysis in a synchronised and desynchronised communication environment.

Objective 4 Develop a communication less control strategy for distributed BESS by modifying the traditional and robust Additive Increase Multiplica-

tive Decrease (AIMD) algorithm by introducing a threshold dependent scaling of the additive term and by individually assigning control parameters.

1.3 Contributions to knowledge

The literature that is reviewed in Chapter 2 introduces the key contributions surrounding the control of energy storage in power distribution networks, and therefore supports the thesis problem statement that was presented in Section 1.2. This review concludes by identifying gaps in literature which are used as starting points to formulate the research objectives and resulting research contributions. Those contributions can be summarised as follows:

- An iterative closed-loop power adjustment method is presented that controls a DNO owned storage devices in such a way that its three-phase power flow improves LV network operation. This contribution is the result of **Objective 1** and is achieved by using the device's flexibility in assigning active power to the three phases, and by using the remaining capacity of power electronics to inject or absorb reactive power. Meanwhile the BESS is obeying its underlying half-hourly schedule.
- A dynamic control method to merge off-line BESS scheduled control with an on-line power prediction mechanism (i.e. Model Predictive Control) is developed to minimise both the imminent sub-half-hourly load peaks as well as the day-ahead half-hourly load peaks. This contribution is the result of **Objective 2** and is achieved by merging schedules that are based on real load forecasts with an autoregressive model that is fed by real load data.
- A robust charge scheduling algorithm for multiple, distributed entities is developed to prevent charging spikes from adding excessive stress onto the dis-

tribution network which would otherwise experience capacity shortages. This contribution is the result of **Objective 3** and is achieved by implementing a “Multi-Agent System” (discussed in the literature review in Section 2.4.2) on a compute cluster to compare algorithm performance for both synchronised and desynchronised message exchange.

- A communication-less distributed control method is developed that improves the traditional Additive-Increase Multiplicative-Decrease (AIMD) algorithm to achieve cooperative behaviour of distributed BESS in order to mitigate the impact of co-located “dumb-charging” EVs. This contribution is the result of **Objective 4** and is achieved by individually assigning control parameters to all BESS to infer the current network status whilst only using local voltage measurements.

In line with the NTVV project some of the algorithms presented in this thesis were field trialed by SSEN in the town of Bracknell UK. Preliminary results show however the inherent difficulty caused by control systems relying on communication. As such, lessons learnt from Chapter 5 of this thesis might have provided insight ahead of system trialing. Project results and lessons learnt may be taken from: <http://www.thamesvalleyvision.co.uk/our-project/>.

1.4 Publications

- **First-authored publications:**

- M. J. Zangs, P. B. E. Adams, T. Yunusov, W. Holderbaum, and B. A. Potter, “Distributed energy storage control for dynamic load impact mitigation,” *Energies*, vol. 9, no. 8, 2016.

- M. J. Zangs, T. Yunusov, W. Holderbaum, and B. Potter, “On-line adjustment of battery schedules for supporting LV distribution network operation,” in 2016 International Energy and Sustainability Conference, IESC 2016, 2016.
- **Co-authored publications:**
 - T. Yunusov, M. J. Zangs, and W. Holderbaum, “Control of Energy Storage,” *Energies*, vol. 10, no. 7, p. 1010, 2017.
 - T. Yunusov, M. J. Zangs, and W. Holderbaum, “Online Control Algorithm for Sub-Half-Hourly Operation of LV-Connected Energy Storage Devices Owned by DNO”, in 24th International Conference & Exhibition on Electricity Distribution (CIRED), CIRED 2017, 2017
- **In preparation:**
 - M. J. Zangs, T. Yunusov, W. Holderbaum, and B. Potter, “Battery control algorithm for peak load shaving in low-voltage power network with high demand volatility,” *Energies*
 - M. J. Zangs, T. Yunusov, W. Holderbaum, and B. Potter, “Improved Estimation Method of Customer Voltages in Low-Voltage Networks with Sparse Network Measurements using Mutual Information Theory,” *IEEE Transactions on Smart Grid*
 - M. J. Zangs, T. Yunusov, W. Holderbaum, and B. Potter, “Assessing the Effects of Desynchronising Information Propagation when Distributing Smart-Charging,” *IEEE Transactions on Smart Grid*

1.5 Thesis structure

The structure of this thesis is organised as follows:

- **Chapter 2** carries out an extensive review of the literature surrounding the field in order to support the problem statement and proposed contribution.
- **Chapter 3** develops a BESS scheduling mechanism and identifies key network parameters that are used in their corresponding cost functions to improve network operation. Then, this chapter address **Objective 1** by presenting a method that assigns a BESS schedule to the three-phase power distribution network whilst minimising the aforementioned cost functions; therefore improving network operation. Results are compared against a “baseline” and a “normal” (or traditional) operation case by assessing them on a temporal and probabilistic level.
- **Chapter 4** then extends the work in Chapter 3 by presenting a dynamic control method that adjusts a half-hourly BESS schedule at sub-half-hourly temporal resolution in order to reduce both volatile and the daily load peak. This is achieved by combining two PID compensated control loops with a MPC and BESS schedule. Therefore, this chapter addresses **Objective 2**.
- **Chapter 5** addresses **Objective 3** by presenting a cooperative battery charging algorithm that is deployed on a Multi-Agent System and assessed in both a synchronised and desynchronised communication environment. In this chapter, both algorithm convergence and algorithm performance is compared between its implementation in the synchronised and desynchronised scenario.
- **Chapter 6** develops a stochastic EV demand model that is based on real vehicle mobility data, and it will develop a control algorithm for distributed BESS to mitigate the negative impact from the resulting EV demand. This chapter address **Objective 4**, the final research objective, by extending the Additive-Increase Multiplicative-Decrease algorithm to enable cooperating BESS operation under the absence of a shared communication infrastructure.

- **Chapter 7** presents a detailed conclusion that relates all findings back to the initial problem statement and the overarching aim of the presented PhD thesis. Also, this chapter highlights potential future work based on the findings from the conducted research.

Chapter 2

Literature Review

2.1 Overview

With the ongoing electrification and decarbonisation of the heat and transport sectors in the UK demand across the electricity network is expected to double by 2050 [52]. One contributor towards this increasing demand is the expected uptake of LCTs as they start penetrating power distribution networks. As discussed in Chapter 1 of this thesis, conventional reinforcement to upgrade the network's infrastructure in order to counteract capacity shortages is effective but costly. Instead, this PhD research focuses on the improvement of grid operation by controlling BESS in the LV distribution network, and together with recent availability of load information due to the distribution and installation of smart-meters, the opportunity arises for DNOs to develop energy storage control strategies in order to achieve the best possible performance and add most benefits to their distribution networks.

In fact, energy storage as an alternative to grid reinforcement has seen an increasing interest in industry since there are more than 1200 energy storage projects worldwide according to the Department of Energy's global energy storage database [53]. More specifically, as of 2016, 27 store projects were installed in the UK and they

accumulate to an energy storage capacity of 33GWh [54]. Out of all global energy storage projects, 61% use “electro-chemical energy storage technology” (i.e. rechargeable batteries) and 49% of those BESS are rated at less than 250kW. Their sizes and ratings make such BESS suitable for deployment in distribution networks, and the figures in the energy storage database indicate that worldwide 131 of these projects are indeed used for support of the secondary distribution network [53].

The range of applications for energy storage in the electricity grid has grown significantly over the past decades. Therefore, the first section of this chapter, Section 2.2, presents an extensive survey of roles for electrical energy storage solutions and narrows the focus on those roles that are applicable for the conducted PhD research. Section 2.3 then provides an extensive review of already conducted BESS research projects that support LV network operation; i.e. that are concerned with voltage control and power flow management. Next, Section 2.4 presents and reviews different control methods for grid connected energy resources that have either been used in the already discussed BESS research projects or that have been studied on a theoretical basis. Particular focus is put on comparing off-line and on-line control, centralised and distributed control and communication-less control. In the end of this chapter, in Section 2.5, the gaps and research opportunities are summarised to link to the research contributions and to support the problem statement of this thesis.

2.2 Role of energy storage - a survey

The idea of using energy storage in the electricity grid has been discussed for quite some time, and its important role in future energy systems has already been identified in the 70s [55]. As the name suggests electrical energy storage systems have the ability to consume, store and release electrical energy by converting it into a different form of energy. Depending on the rate at which energy can be consumed and

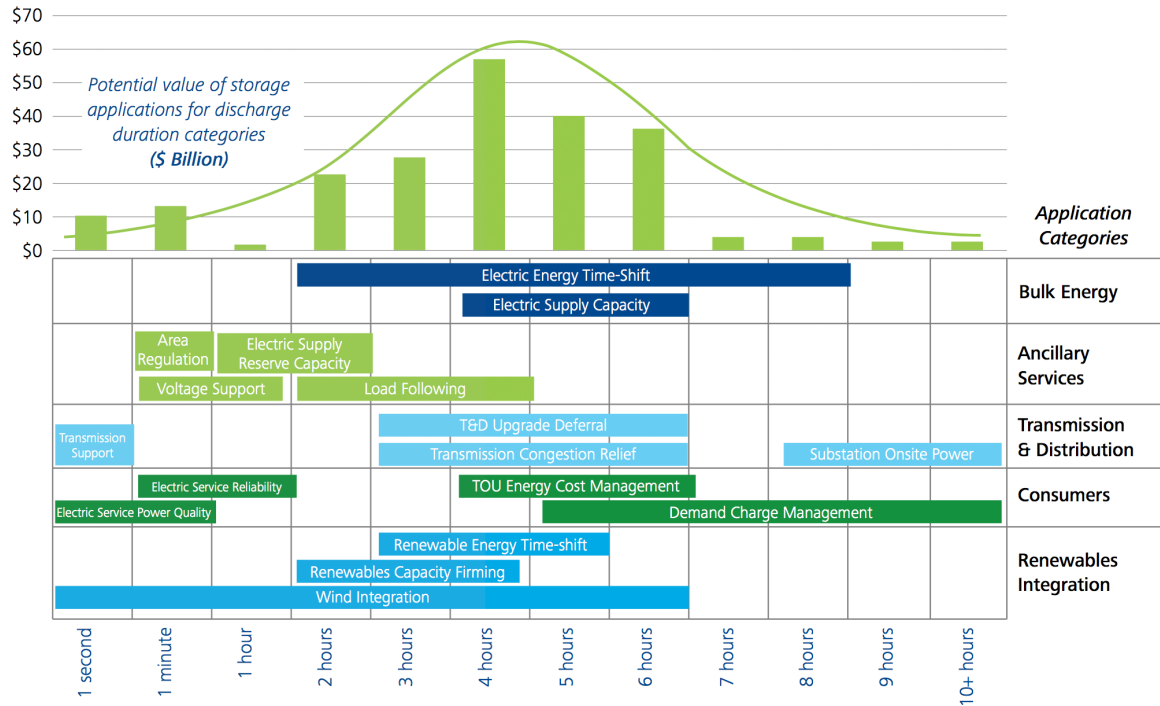


Figure 2.1: Energy storage applications and corresponding value for various discharge durations [2]

released (i.e. the system’s power rating) as well as the amount of energy that can be stored (i.e. system’s capacity) different functions can be provided. A Canadian and US based study for the Department Of Energy (DOE) showed that (when correctly exploited) these functions can yield direct financial benefits of \$157.56 billion on a national level over an estimated 10 year system lifecycle [56]. Figure 2.1 shows these benefits in relation to the storage system’s typical discharge period, and links them to their associated functions, too. Here, Time Of Use (TOU) energy cost management yields the largest economic profit, yet from a historical point of view, bulk energy storage has played the most important role in the energy system.

Nowadays, storage can also tap into emerging revenue streams and perform additional functions. As identified in several review articles [21, 57, 58], the key roles and applications of energy storage systems, regardless of profitability in the current market situation, can be identified as follows:

- **Energy shifting** (arbitrage): This function uses the difference in energy price to yield revenue. More specifically, as energy pricing is expected to become more dynamic and responsive to current energy demand and generation, storage is controlled to charge when energy prices are low and discharge when energy prices are high [21, 59]. Such dynamic pricing schemes are expected to emerge due to significant changes in demand at morning and evening peaks [60]. However, small storage need not be sufficient to justify energy shifting in LV networks. (Time-of-use energy charges): A hurdle to DSM through flexible tariffs or TOU tariffs is the reason that consumers would have to adjust their energy consumption based on external price signals, which many are do not want to do. Energy storage could however decouple the consumer from these tariffs and allow them to continue with their normal lifestyle [61]. Additionally, when exploiting the energy price difference, storage could even supply arbitrage functions to some customers and reduce their electricity bill [62]. For customers with local generation (for example through a PV installation) their bill can be reduced even further. This would be done by storing the generated energy until a period of high energy prices arises. At this time energy storage could release the energy to maximise self-consumption [63]. (Renewables integration): Unlike traditional energy sources, renewables have are highly volatile and have limited availability. Since their availability (for example for PV installations) does not always align with periods of high demand (i.e. during morning and evening) arbitrage functions can be provided to maximise the use of renewable generation - i.e. renewables “shifting” [64]. Furthermore, by discharging energy storage during times of low renewable generation (for example due to cloud cover or varying wind speeds [65]) a continuous supply of energy can be assured - i.e. renewables “smoothing”. And lastly, if a renewable resource was committed for longer periods of time, yet the associated energy forecasts overestimated its

generation capacity, storage can supply the gap to avoid balancing charges - i.e. renewables “firming” [66].

- **Supply capacity:** In order to meet future energy demand, energy suppliers commit their resources in advance. Doing so allows them to plan for their operation and solve the economic dispatch problem. With increasing demand, the supply volume will have to increase, too. However, it is predicted that energy storage can defer or even avoid investments in power plants, assuming they are sized accordingly (i.e. several 100MW) [67]. Bulk energy storage was the first choice to support supply capacity. One example is pumped hydro-electric energy storage, which has seen a global growth of 127GW since 1979 [68–70].
- **Ancillary services:** These services are of interest to transmission and distribution system operators since they support the operation of their networks. For example, load following and frequency regulation are two complementing applications of that address the imbalance between demand and supply [71]. In case of a severe imbalance that resulted in network outage, black start is also a function that can be supplied by energy storage [72, 73]. Since modern energy storage systems can absorb and inject both active and reactive power, they can also provide voltage support [74].
- **Grid stability:** To make the grid more resilient to network faults (for example short-circuit or loss of a large generator), or to overcome scheduled network outages, energy storage can be used as an intermittent energy source [75]. To provide optimal operation conditions for energy generators, storage can support rotor angle stability and voltage stability by injecting active and reactive power at the point of common coupling [66, 76]. Furthermore, sub-synchronous resonance and harmonic interference can also be reduced [77]. This coupling resonance can occur between electrical and mechanical systems and can damage

the mechanical structure due to repetitive stresses and strains.

- **Upgrade deferral:** As already stated in Section 1.1.2, both transmission and distribution systems would have to be upgraded unless energy storage could provide network-support functions. By deferring network upgrades, network assets will be used more efficiently, and customer supply disruptions will be avoided [56,78]. Furthermore, in areas where the expected load has already been met and growth has levelled out, deployed energy storage is flexible enough to provide alternative functions (unlike other network assets) [79]. Equally, high congestion at substations of heavily loaded transmission or distribution lines can be tackled by co-located energy storage units [74,80]. This can be achieved by, for example, shaving peak load or relaxing the energy requirements from distributed generation [81,82].
- **Transmission charges:** In scenarios where generators are charged to use transmission systems (due to the capacity limitations of the transmission system), energy storage could take advantage of the price structure to maximise the profit from the generated energy [59,78].
- **Service reliability:** In areas where a strong grid connection is needed to assure for example industry operations, an “uninterruptible power supply” is required. Traditionally, these power supplies were diesel backup generators, but modern energy storage technology can provide similar services at lower cost [83] (particularly when including alternative revenue streams).
- **Demand charges:** Larger customers (i.e. industrial and commercial loads) are not only charged for their total energy demand, but also for their largest continuous power demand [84,85]. Therefore, a factory that uses a relatively small amount of energy over a comparatively short amount of time, is billed accordingly. After all, the infrastructure to deliver the required power needs

to be installed and maintained. In this scenario, energy storage could reduce the intermittent power demand without significantly increasing the total energy demand, and therefore reduce demand charges for larger customers [86].

- **Power quality:** In addition to the above-mentioned benefits, power electronics provided with the BESS can be used beneficially. Sub-cycle and harmonic distortions for instance can severely deteriorate power quality, since they have unwanted effects on connected equipment (similar to the issue of sub-synchronous resonance at the generation side). Energy storage with modern power electronics could be capable of providing power filtering functions that suppress those distortions [87]. This feature could be of particular interest to LV networks in the UK, since customers are arbitrarily connected to a single phase of a three-phase network. Therefore, the discrepancy of power quality between the phases is even larger, yet available energy storage resources could even address this issue [88] (especially when considering household connected units).

This extensive list of possible applications for energy storage systems emphasises the potential for energy storage solutions in the future energy market. However, as also stated by Taylor et al. in [89]: “*The market for use [of electrical energy storage] is motivated by the need to increase the efficiency of the grid by the integration of RES*”. For this very reason, upgrade deferral, congestion relief, ancillary services (i.e. voltage support) and renewable integration are the key challenges that are of interest to DNOs. This finding is also supported by the motivation of research projects and field trials that were conducted with energy storage solutions in the LV distribution networks. These research projects are reviewed in the subsequent section, Section 2.3.

2.3 Energy storage research for LV application

The challenge for DNOs to manage their distribution networks is caused by the DER's and LCT's difficult predictability, their volatile nature, and the weakness of the network into which they are deployed. If left unmanaged, voltage fluctuations caused for example by PV systems [16, 90] or capacity shortages due to additional loads like EVs [91, 92] will threaten the power system's stability. Improved network management methods that are summarised under the term "smart grid" have thus become increasingly popular to counteract the negative impact from DERs and LCTs [93]. However, when deferring the reinforcement or retrofitting of network assets to construct such a smart grid, deployment of BESS can provide a significant contribution to the integration of DERs and LCTs. For instance, Grillo et al. in [94] showed how probabilistic price driven storage control successfully supports renewable integration. Their simulated and validated BESS model provides arbitrage functions through generation shifting and was able to achieve a daily gain of more than €130. But such an immediate financial benefit can only be achieved when their dynamic pricing is implemented and the repetitive discharge to 20% does not shorten the BESS lifetime. Focusing on grid support instead, Rowe et al. in [95] showed how a BESS schedule can maximise the peak reduction capability in order to free system resources. Since their BESS schedules were based on sometimes unreliable demand forecasts, they had to implement filtering operations to vary the forecast's peak magnitude, peak width and peak shape. This filtering maximised the resulting peak reduction performance to a median peak reduction between 5kW to 7kW (instead of 0kW when no forecast filtering was implemented). Similarly Hosseina et al. in [96] also used residential load forecasts to schedule BESS operation in order to level demand by shaving peak load. Their BESS was installed in the medium voltage distribution network since their redox flow-battery was significantly larger than the lithium-ion battery that was used by Rowe et al. (i.e. 34MWh instead of 25kWh). Apart from the difference in scale,

both pieces of research used residential load forecasts only whilst Li et al. solved a stochastic unit commitment and economic dispatch problem to maximise renewable integration in [97]. Unlike traditionally scheduled BESS operation, Li et al. also simulated real-time operation but assumed perfect demand and pricing knowledge at the time of operation. As a result they achieved a financial gain of more than \$34000, but did not guarantee the BESS impact on the underlying power distribution network.

Over the past decade electricity DNOs and supplier branches from the Big Six (i.e. the UK's six major energy suppliers) begun trialling of BESS across their distribution network to better their understanding and potential contribution. This was done since the BESS benefits had only been estimated and not thoroughly studied through field trials. Showcase examples from some DNOs include:

- Scottish and Southern Electricity Networks (SSEN) in [98] where BESSs were deployed in Bracknell distribution networks to uphold voltage stability and power quality;
- EDF Energy Networks in [26] where BESS was installed in the 11kV distribution network for power flow management and to validate and improve system models;
- UK Power Networks (UKPN) in [99] where BESS was installed to shave load peaks and level supply volatility from an adjacent wind farm;

and showcase examples from some of the energy suppliers include:

- E.ON UK in [100] where a 5MWh BESS was colocated with a combined heat and power plant to stabilise its energy supply; and
- Scottish Power in [101] where 1MWh of distributed batteries were installed in households to support grid operation through flexible tariffs.

Nonetheless, from lessons learnt and aiming to meet statutory and physical restrictions under the future load changes, voltage control and the power flow problem have

been identified as the two key challenges for DNOs [102, 103].

2.3.1 Voltage control

LV distribution networks in the UK operate at 230V Phase to Neutral (P2N) or 400V Phase to Phase (P2P) and have a statutory tolerance band of +10% and -6%. But these voltages can deviate significantly due to the varying load on the network. Although today's deviations infrequently exceed high-voltage or low-voltage thresholds, conduction losses and imperfect network conditions result in a lower overall system efficiency. Traditionally, On-Line Tap Changers (OLTCs) are used to raise and lower voltages across the entire LV distribution network in order to counteract voltage deviations [104]. However, such a hierarchical voltage control with OLTCs has its limited applicability, especially in cases where the voltage deviation significantly differs along individual branches of a feeding network [105]. More specifically, if voltages diverge along different branches or different phases of a feeder due to asymmetric loads then the adjustment of transformer taps will lead to high or low voltage violations regardless of the tap change direction. Installing a BESS at a strategic location (i.e. closer to the regions where voltage deviation takes place) and controlling the device to best suit the network's requirements is generally more applicable and commercially the more viable alternative [106].

As stated by Wade et al. [107], allocation of the BESS's limited storage capacity so it can solve the voltage problem most effectively is still a sophisticated challenge. Nonetheless, by installing a 200kWh unit that is rated at 600kW in a project that was carried out with *EDF Energy*, they showed the potential of BESS in a network to provide targeted voltage support [26]. Their results for a 0.4MWh BESS achieved a reduced voltage variation by 2.4% which resulted in a complete elimination of any "out-of-limit" voltage events, and a 70.96% reduction of all network events (including power events) over the annual simulation period. A demonstration project in Germany that

was titled “More Microgrids” used four 180kWh batteries and demonstrated how both voltage stability as well as grid independence could be improved [108]. In this “More Microgrids” project a collection of holiday homes were fitted with a distributed PV system that is capable of generating a peak power of 315kW, and BESS was used to maximise the utility from this generation. However, due to the relatively small size of the network, due to the different behavioural patterns of holiday home occupants, and due to the different means of connecting customers to the German three-phase network, voltage deviation and phase unbalance issues were not as big a concern as they are for UK distribution feeders. An equally sized German project entitled “GROWDERS” also used multiple BESS in the LV network, but instead of focusing at grid independent network operation, they mainly contributed to frequency and thermal constraints as well as voltage stability [109].

BESS that are sized between 100kWh to 200kWh (as those in the aforementioned projects [26, 107–109]) can easily address network issues, especially even when operating in a grid independent or “islanded” mode. Results from these early field trials show how BESS store the excess renewable power for usage during later times. But neither high nor low voltage events could be omitted once capacity limits were reached. An oversized BESS would be less likely to meet its operating limits, but the associated cost makes this oversizing unfeasible. Findings therefore indicate that not only the sizing, but also the BESS control method is of significant importance. Nonetheless, continuous voltage violations that require strong voltage support have not yet been encountered in any of these projects, and instead occasional violations accumulating to less than an average of 1.1 minutes (instead of 2.3 minutes) per day are the norm [110]. Also, the majority of recorded low-voltage events on the UK distribution networks (i.e. when voltage levels fall below 216.2V) are caused by anomalous network events or are due to failures of the measurement equipment [111]. Therefore the complementing task of choosing correct control methods to optimally

manage the network's power flow is also important.

2.3.2 Power flow management

Interest in BESS control for power flow management has grown since improved measurement equipments in LV substations is more reliable and precise than traditional smart meter readings, but also since excessive power flow is the main cause for operational issues which do eventually lead to system overloads and outages¹ [114,115]. To prevent future power flow from exceeding the system's capacity, BESS has been proposed to function as an instantaneous reserve [116,117]. Resulting methods like BESS droop control use local voltage and frequency measurements to infer the latest loading and stress on the network to issue corresponding BESS control instructions [118]. The initial simulations in [118] showed how droop control can effectively remove reactive power demand and thus free the corresponding resource. Conventional droop control was designed to inject reactive power into high voltage transmission lines to counteract voltage drops and inject active power to counteract phase shift [119]. This control mechanism works since the impedance of high voltage transmission networks is more inductive than resistive. LV distribution networks on the other hand are more resistive in nature. Droop control for the LV applications is therefore founded on the assumption that network frequency will drop as demand begins to exceed supply, and that voltages along the distribution feeder drop more significantly when load is increased. Yet as already stated in Section 1.1.1, reversed power flow can raise voltage levels which makes such droop control methods less reliable and potentially unsuitable for LV network support. This problem was also encountered by Riffonneau et al. in [120], where they control BESS to solve an optimal power flow problem for grid connected

¹In fact, according to the UK energy regulator *OFGEM*, on average 45% of all customers experienced service disruptions in the period 2015-16 [112]. Unanticipated outages due to severe winter weather did lead to £39 million worth of damages. Whilst the resulting planned outages (i.e. for network repairs and upgrades to prevent future failures) also took place, unanticipated outages do still make up the larger amount of customer interruptions and customer minutes lost [113].

PV systems. Ultimately, they were able to achieve a 13% reduction of electricity bills by implementing a rule-based dynamic programming optimiser, and they reduced peak power by successfully integrating PV. However, they do not consider reactive power within their power management method although it could free additional network resources and yield benefits to the distribution network, better voltage control and lower phase imbalance. The reason behind excluding it from their study was due to the potential conflicts that arise with the proposed voltage control method which heavily relies on voltage measurements. Using BESS to reallocate PV generation for maximised self-consumption [121] or to achieve “peak-shaving” behaviour [29, 122] has seen continued interest in the field of BESS power flow management.

Aiming to address both voltage and power flow problems, *Scottish and Southern Electricity Networks* (SSEN) became the first UK network operator to trial street-level BESS deployment in the LV network, and they installed 500kWh worth of storage in Bracknell, UK [123]. This capacity was achieved by 25 Energy Storage Management Units (ESMUs), like those pictured in Figure 2.2. Each ESMU had cascadable 12.5kWh Energy Storage Units (ESUs), and the ESUs were connected to the distribution network via a three-phase 36kW Power Electronic Unit (PEU) to both manage the batteries and perform filtering operations. The aim of this so called *New Thames Valley Vision* (NTVV) project was to understand potential benefits, practicalities and costs of installing street-level BESS. In the beginning the main problem of finding an optimal deployment location for the ESMUs to achieve their best possible impact on system voltages had to be addressed. Yunusov et al. and Rowe et al. worked in collaboration with *SSEN*, and they assessed different BESS locations in several networks [18, 95, 124]. They found that a location $4/7$ to $2/3$ down the feeder yields the best overall impact on voltage levels and power flow. However, their findings also show that this location can vary significantly when not focusing on voltage support exclusively; i.e. proximity to the feeding substation was of greater importance when



Lithium ion battery modules, battery monitoring system

(a)



Inverter, G59 relay, CTR1, CB2 and CB1, GLR 1 and GLR2, Comm's equipment

(b)



(c)



(d)

Figure 2.2: Energy Storage Management Unit overview: (a) 12.5kWh Energy Storage Unit, (b) Power Electronics Unit, (c) deployed 12.5kWh system, (d) deployed 25kWh system - pictures are taken from the NTVV close down report [3]

reducing the system’s overloads or distribution losses. Also, the chosen control system had significant impact on the BESS performance, which is why more emphasis has been put on BESS control instead of locating or constructing BESS. Therefore, a review of BESS control methods including those that are implemented in the NTVV project are presented in the next section, Section 2.4.

2.4 Control of energy storage and its applications

Installing BESS at a strategic location in the LV network brings several advantages to DNOs’ control over the network’s performance. Regulating voltages to stay within statutory operating bands [28], improving power quality by optimising its power factor [125], shaving peak load to relieve stress from the installed network assets [29] or reducing phase unbalance to increase network efficiency [30] are only a few examples of recent research in this field. Whilst the questions regarding locating and scaling of BESS have mostly been addressed, BESS control still remains an open question and can be split into two complementing yet unmarried approaches:

1. “off-line” control, using load forecasts and BESS schedules; and
2. “on-line” control, using Set-Points Control (SPC), Model Predictive Control (MPC) or similar dynamic control methods.

These two control approaches have evolved from two different fields of active network management. Nonetheless, both approaches hold significant benefits to the operational performance of power distribution networks and neither of the two can be neglected. Therefore, Section 2.4.1 addresses and discusses the two control approaches and their missing link.

The current form of the NTVV project focuses on controlling a single BESS in the LV distribution network. However, the uptake of household connected BESS

will increase the number of distributed systems, which need to be managed cooperatively. Therefore, Section 2.4.2 reviews and discusses different control approaches for distributed BESS since the control of multiple single-phase storage units in a three-phase network is inherently more challenging than controlling one three-phase device.

2.4.1 Off-line and on-line control

Off-line control uses historic data to predict future load patterns which are used to schedule BESS operation accordingly. Early approaches by Oudalov et al. [84], who used dynamic programming to generate BESS schedules had relatively high forecast errors due to the inherent difficulty of predicting future loads. These errors ultimately limit the ability of any given BESS schedule to effectively reduce peaks. This is why recent research begun including uncertainty, like the work done by Baker et al. [126] where uncertainty of wind power was taken into account when scheduling and sizing BESS. Other work frequently re-evaluates BESS schedules to control and adjust its schedules after completing individual decision epochs [127]. Nonetheless, load forecasting remains a key component for BESS scheduling despite those load forecasts (and the resulting BESS schedules) being imperfect. This fact was emphasised by Rowe et al. in [95], and they developed a filtering mechanism for scheduling algorithms to reduce peak load in LV networks due to the presence of forecast errors. They also highlight the fact that most day-ahead load forecasts only predict at a temporal resolution down to half-hourly periods which makes estimating errors at higher temporal resolution less dominant. The reason behind choosing this half-hourly forecasting period was pointed out by Haben et al. in [7, 128], as they argue that forecasts at half-hourly resolution yield the best compromise between high accuracy and high temporal resolution. Therefore, half-hourly forecasts have become the standard for generating any resource commitment and resource operation schedules.

However, sub-half-hourly load volatility imposes the biggest stress on the network and it is this volatility that cannot be addressed when relying on half-hourly forecast alone. In conclusion, on-line control has been considered as an alternative to off-line control.

One flavour of on-line control is the Set-Point Control (SPC) which is a robust technique that can immediately respond to network changes. SPC achieves this behaviour by measuring some properties of the power system (for example voltage level or frequency) and comparing those values to an internal target value, i.e. the set-point. Droop control, as mentioned in Section 2.3.2, was one of the first control methods that followed the SPC paradigm. A single set-point is however not suitable for a network that changes dynamically which is why droop control was extended to become adaptive as done by Tayab et al. in [119]. Their research shows how conventional droop control runs the risk of allowing system frequency to drop to 48.4Hz (from a nominal 50Hz), whereas adaptive droop was capable of frequency restoration with little to no observable frequency variation. However, their solution relied on PV and gas turbines to provide active power injection and could only injected reactive power into the system when these are not available - a comparable scenario can occur when BESS completely discharges. Therefore, voltage compensation can still be realised, but frequency remains unchanged. Conventional droop control does therefore run the risk of reaching energy shortage or surplus if the set-points and system dynamics are chosen too low or high. Modifications like hysteresis control and ramp-rate control were proposed to yield an adaptive SPC [129–132]. Hysteresis control prevents the device from oscillating between different power states even when small changes in the network are detected and would otherwise trigger an SPC change. When implementing a dead-band around the controller’s set-point as well as utilising a ramp-rate control, as done by Such et al. in [132], BESS can correct its internal energy state and therefore prevent hitting its operational limits. Furthermore, Such et al. showed

how reverse power flow can be completely omitted through the use of on-line BESS control. However, this kind of on-line control is less effective when addressing daily demand peaks since pure SPC can only react to present network demand and does not respond to general trends or upcoming load events.

In order to address these shortcomings SPC has been extended by using short-term load predictions through the implementation of Model Predictive Control (MPC) [133, 134]. Some MPC examples include Auto-Regressive (AR) models [135, 136], fuzzy logic models [137, 138], genetic algorithms [139, 140] or Artificial Neural Networks (ANN) [81, 141–146]. Advancements in computational power allowed ANN to gain traction, and as shown in the study by Quan et al. in [142] ANN is becoming a promising method to generate load forecasts. In fact, in their study, Quan et al. proved how ANN can outperform AR and fuzzy logic models given that the ANN was optimally trained. Therefore, MPC can yield a acceptable prediction performance for linear systems when its complexity is sufficiently increased. For instance, Reihani et al. in [81] used the most recent 20 minutes of load information with a complex-valued ANN to predict the next 20 minutes of minutely load variations. Since their raw forecasts were more erratic than the actual load profile, a Kalman filter was implemented to smoothen the MPC’s output, yet this step introduced significant discrepancies between the actual and the forecasted load. Therefore they increased MPC complexity even further by taking into account parallel time-series, i.e. they considered the same 20 minutes from previous days in the prediction mechanism. This addition produced significantly better results and they shaved daily peaks by around 300kW (from 1.6MW) in the medium-voltage network. Implementing such increasingly complex MPC to support on-line control is therefore a promising research trend, however the computational burden to deliver real-time solutions makes deployment of such systems costly and/or difficult.

Therefore, finding a way of combining both off-line control (i.e. scheduled BESS

operation which is executed at half-hourly resolution) with on-line control (i.e. a mechanism that is responsive to power system changes) allows application of real-time corrections to the BESS schedule. Since this is still an open and ongoing research problem that has not yet been solved, **Objective 1** and **Objective 2**, as outlined in Section 1.2, aim to develop and present a control mechanism that utilises the benefits from scheduled and real-time control. The objectives' corresponding chapters are, respectively, Chapter 3 and Chapter 4, and they address this research problem in two stages. At first the problem is addressed by developing a framework to apply scheduled BESS operation to a three-phase network in a sub-half-hourly manner but without modifying its underlying half-hourly schedule. Secondly, this hard constraint is removed by developing and implementing a dynamic controller that allows an operational tolerance around the pre-computed BESS schedule in order to guide BESS operation without violating its energy storage limits whilst maximising its flexibility to respond to sudden system changes. This a control system does however rely on a communication infrastructure in order to be implemented and deployed in reality. These infrastructures and their underlying control either follow a centralised or distributed networking paradigm. Both paradigms entail their specific costs and benefits which are addressed in the subsequent section, Section 2.4.2.

2.4.2 Centralised and distributed control

It is important to understand the topology of an on-line control system since most of them have to gather power system information from multiple locations in order to make intelligent control decisions. This is particularly true if the control system consists of multiple entities that are distributed across the power network. The monitoring and control of such a distributed system (and hence of any power network) includes four systems that are inherently linked [147]:

1. The *managed system* itself, like a power network, that needs to be controlled;

2. a *monitoring system* that generates data through sensors and measuring equipment that is installed in the *managed system*;
3. a *decision making system* that uses the provided data to generate certain aims, to improve the system state; and
4. a *control system* to generate control actions for the *managed system*.

In traditional power system control, systems 1 and 2 are grouped into the distributed measuring system and systems 3 and 4 are grouped into a centralised controller [148]. Therefore a bidirectional flow of information must exist in order to control and assure operation of the underlying physical network. Supervisory Control And Data Acquisition (SCADA) is the typical control architecture that enables the implementation of this bidirectional information flow. Tokyo is a showcase of successfully implementing such a centralised control system on a very large scale. In 1990, *Tokyo Electric Power Co.* (TEPCO) and *Toshiba* presented their latest installation of a centrally managed power distribution network that could deliver 43GW of power to the entire city of Tokyo [149]. All control instructions were generated from TEPCO’s central dispatching centre, which took into account measurements from a network of 819 nodes and 938 branches. Since Tokyo has grown significantly over the past decades, computational burden to relay data and act upon the information has increased, too. The UK transmission system is also a centrally managed system that has seen an increase in complexity, yet in 2017 “*the network is 99.9999% reliable - a statistic we’re proud of*” [150].

But with the deployment of smart meters, network enabled appliances and controllable LCTs that can be part of the so called “Internet of Things” (IoT) system complexity is expected to increase beyond the capabilities of a single central management centre. This reason is why research began focusing on distributed control mechanisms [151–160]. For example, Vovos et al. in [151] compared centralised and

distributed systems for voltage control and showed how they can yield a 86% gain (using centralised control) and 72% gain (using distributed control) in connectible capacity. Adding distributed BESS into the energy mix, Toledo et al. in [154] evaluated its impact on the IEEE-14 bus network when subjected to PV energy injection. Their developed voltage index showed how voltages can deviate from nominal levels. In their results this index was 0.074%, 2.823%, and 3.471% for a release of system capacity of 500kW, 1000kW, and 1500kW, respectively. In their work a higher index represents a larger voltage deviation in comparison to a predefined base case without PV or BESS. To counteract this voltage rise, research like that by Marra et al. in [155] used coordinated EV charging to maximise self-consumption and thus alleviate grid power injection by PV. Focusing on the LV network's voltage issues, Marra et al. showed how high voltage incidents are completely avoided by charging at strategic times throughout the day, and at relatively low charging powers of 3.5kW. In fact, the majority of existing literature that uses BESS in distribution networks focuses on voltage security [39, 110, 154, 155, 158], power flow management [152, 160] and management of flexible loads [156, 157]. For instance, the approach used by Mokhtari et al. in [39] relies on bus voltage and network load measurements to prevent system overloads, and Marra et al. in [155] go even further and use information sharing between PV and BESS in order to limit voltage deviation. Both research teams were able to stabilise the network, and Marras et al. even increased the voltage margin by an additional 6.1V. The reasons why the usage of distributed and hierarchical control systems have become this attractive include lighter computational load for all control systems through abstraction at higher control levels and improved system stability, security and redundancy [161, 162].

Approaches and topologies to manage the flow of information within these control systems are classified by Bidram et al. in [153] where they separate the real network (i.e. the *physical layer*) from Information and Communication Technology

(ITC) (i.e. the *cyber communication layer*). This separation allowed them to represent any distributed power system as a system of multiple cooperating entities, i.e. intelligent agents that form a so called Multi-Agent System (MAS). The technology of MAS comes from computer science and is well established in theory and practice of intelligent agents [163]. As stated by Wooldridge et al. in [164] intelligent agents are flexible and autonomous entities that are defined by three fundamental properties:

1. *Reactivity*, which allows an agent to respond to changes in its observed environment,
2. *Pro-activeness*, which makes an agent act to meet its own or a collaborative goal, and
3. *Social-ability*, which enables the agent to coordinate its action with other agents.

Computer scientists would describe an agent as a component that gathers and collaboratively reacts to information about its environment. But distributed control systems in power distribution networks share the same characteristics. For this very reason MAS has seen increasing attention in the power and energy engineering disciplines. Some MAS applications are focusing on integration of DERs [165–169], matching of demand and supply [170], restoring the power distribution network [171], reconfiguring the network to reduce unbalance [172], integration of EVs [46, 173–175] and providing voltage support [176]. For example, Dou et al. in [167] proposed a MAS that coordinates DERs in as a so called Virtual Power Source (VPS). This VPS is an aggregate of all distributed entities and responds to voltage events throughout the LV distribution systems. In the case where generation increase would raise voltage levels beyond their statutory limits their VPS control could maximise power sharing and thus limit voltage overshoot to stay within voltage tolerance. This VPS is typically referred to as a Virtual Power Plant (VPP), which has also been implemented as a MAS by Vasirani et al. in [168]. In their work Vasirani et al. propose a distributed

control strategy that utilises EVs as an energy storage medium to maximise profits from operating distributed renewable energy sources. Their findings suggest that when providing 12kWh of the EV's energy storage capacity for renewable integration an annual EV profit of more than €250 (at 40% depth of discharge) can be achieved. However, research involving MAS or any distributed control for that matter does require strong and standardised communication mechanisms.

A standard for MAS was established by the Foundation for Intelligent Physical Agents (FIPA) since the underlying versatility of different MAS would otherwise make integration very challenging. This challenge was also raised by Catterson et al. in [177], where they tried to merge the Condition Monitoring Multi-agent System (COMMAS) [178] with the Protection Engineering Diagnostic Agents (PEDA) system [179]. They showed the inherent difficulty of combining different ontologies despite the similar underlying goals. Also, as the number of independent elements becomes ubiquitous requirements for a strong telecommunication infrastructure become equally important [134]. So far synchronisation amongst agents has been taken for granted, yet MAS on multilayer networks need not automatically be synchronised [180]. The impact of desynchronised information exchange on the performance of a MAS driven energy scheduling algorithm still remains an open research question. Therefore, assessing the impact of introducing such a desynchronisation has become part of the research that is presented in this thesis, and **Objective 3** as outlined in Section 1.2 aims to answer this research question. Regardless of the synchronised or desynchronised nature of the distributed control, they both do however require some kind of communication infrastructure which need not always be present. Therefore, the next section, Section 2.4.3, introduces control mechanisms where communication between devices is no longer a strong requirement.

2.4.3 Communication-less control

Lastly, developing control methods for distributed system that do not rely on a communication infrastructure is also an important research topic since this infrastructure need not always be available; despite this being a common assumption [134]. So called communication-less systems are typically collections of multiple “dumb” devices that follow their own control instructions without any external inputs. The current procedure of charging EVs is a perfect example of such a system since their charging typically commences immediately after they have been plugged into the grid. At the current rate of EV uptake so called “dumb charging” (or any “dumb action” for that matter) has high potential of causing significant network issues [181,182]; i.e. voltage deviations, equipment overloads, asset damage and system outages. This issue is amplified since the EV uptake is anticipated to increase as driving range increases, cost of purchase decreases and the emphasis on leading an environmentally-friendly lifestyle is favoured more [183]. ICT reliant distributed control methods aim to circumvent these issues by using Demand Side Management (DSM) strategies. In [184] for example, Mohsenian-Rad et al. based developed a DSM mechanism that was based on game theory where multiple users engaged in the energy market to minimise the Peak-to-Average Ratio (PAR) of the resulting demand profile. Their results show that both minimising financial cost or the PAR of the resulting demand profile resulted in a 21.9% reduction in PAR when compared to a scenario without scheduling the energy consumer. But minimising PAR resulted in only a 7.31% reduction in energy cost, whilst minimising cost directly lead to a 19.6% reduction, despite the similar improvements in demand profile. However, this approach highly relies on ICT, as do similar DSM approaches that use for example time-of-use tariffs [185,186] or other pricing signals [187]. None of them can be implemented without ICT and instead an indirect method must be sought.

A communication-less form of controlling Distributed Energy Resources (DERs) is

the already mentioned Set-Point Control (SPC) [188]. Using traditional SPC on multiple identically-configured DERs can provide an optimal operation conditions, if each DER’s control parameters (bus voltage) were shared [189]. But in a communication-less environment this requirement cannot be satisfied which is why DER control algorithms have to be improved to prevent for example devices located furthest from the substation from being used more frequently than others. The algorithm that is to be extended to control several BESS in a LV network is the Additive Increase Multiplicative Decrease (AIMD) algorithm. Unlike traditional SPC or hysteresis control like in [190], where a fuel-cell’s bus voltage was used as input to a ramp control for active power sharing, AIMD (like MAS) has its roots in computer science. Originally, AIMD algorithms were applied to congestion management in telecommunication networks using the TCP protocol [191] to maximise utilisation while ensuring a fair allocation of data throughput amongst a number of competing users [192]. The same AIMD-type algorithms have previously been applied to power sharing scenarios in low voltage distribution networks where the limited resource is the availability of power throughput capacity of the substation’s transformer. One of the first proposed implementations for DER management was by Stüdli et al. [193], yet their system still required a one-way communication infrastructure to broadcast a so called “capacity event” [194, 195]. Later their work was extended to include Vehicle to Grid (V2G) applications with reactive power support [196], but this work still relied on a functioning and robust ICT infrastructure. Therefore, the question whether a truly communication-less dynamic control method can be developed (i.e. mitigating voltage deviation and capacity limitations) is still a remaining research problem. More specifically, this control method should not only avoid to impose any ICT requirements, but it should also aim to equalise the utilisation of all controlled devices which is not guaranteed by the traditional AIMD algorithm. **Objective 4**, as outlined in Section 1.2 aims to solve this research problem by extending AIMD to AIMD+, where

natural voltage drops are taken into account to correctly skew the algorithm's control decisions for individual control entities. Previous research is therefore extended since previous work has only utilised common SPC thresholds for controlling each of the DERs or previous work relied still on some form of communication infrastructure. In strong contrast to the former objectives of this thesis where substation monitoring was used, the proposed AIMD+ algorithm does not require this information or any communication infrastructure for that matter.

2.5 Summary of gaps in literature

In this chapter, Chapter 2, the current and future roles for energy storage have been laid out. When focusing on BESS applications that support DNO owned networks, i.e. to enable the integration of LCTs and DERs within the LV distribution network without the need for network reinforcements, two key functions have emerged: 1. limiting voltage deviation to within statutory regulations, and 2. avoid thermal constraints by solving the power flow problem. Since DNOs had little experience with using BESS in their LV networks, several research projects and field trials were undertaken over the past decade. So far this research has already focused on sizing, locating and operating BESS. From the presented literature BESS control methods can be split into two categories that still remain unlinked: off-line control (for example scheduled or forecast driven control) and on-line control (for example SPC or MPC). Whereas off-line control takes into account daily load trends (i.e. at half-hourly resolution) it cannot compensate for load volatility due to DERs and LTCs (i.e. at sub-half-hourly resolution). On-line control methods on the other hand are designed to react quickly when system changes occur (i.e. at sub-half-hourly resolution), but they cannot efficiently include daily or weekly load patterns (i.e. at half-hourly resolution) due to the increase in model complexity. On the basis of the gaps in literature, as highlighted

in the literature review, Chapter 2, and the problem statement of this thesis which is stated in Section 1.2 research **Objective 1** and **Objective 2** were derived. Furthermore, as the number of DERs increases throughout the grid methods to manage them need to become more sophisticated, too. However, all developed algorithms to control DERs either explicitly or implicitly assume synchronisation amongst all controlled entities which need not be the case in reality. Assessing how information desynchronisation impacts the performance of a distributed algorithm is still an open research question that is addressed by **Objective 3**. **Objective 4** then aims to extend a distributed control algorithm by developing a method that no longer depends on communication systems. To summarise, the problems that arises from the identified gaps in literature are:

- how to assign a BESS power profile that is pre-scheduled at half-hourly resolution to the three-phase network that operates at sub-half-hourly resolution in order to yield the largest positive and targeted impact on the underlying network performance parameters (**Objective 1**),
- how to adjust a half-hourly BESS schedule (derived from a realistic but erroneous load forecast) based on sub-half-hourly load variations to minimise daily peak demands at both temporal resolutions (**Objective 2**),
- how large the impact will be on the performance of a scheduling and control algorithm when information exchange or message passing amongst the distributed control entities becomes desynchronised (**Objective 3**), and
- how multiple BESS can be coordinated in a communication-less environment to circumvent the need for ICT whilst contributing to voltage stability and thermal constraints without allocating their energy resources unevenly (**Objective 4**).

Despite some of the literature including aspects of the proposed research, none of them answer the research questions that are identified above. The novelty of the

research in this thesis consists of combining on-line and off-line control, as well as to assess and extend the control of distributed BESS. All contributions, corresponding publications and draft papers, as outlined in Section 1.3 and Section 1.4, reflect upon the novelty of the presented research against the objectives as well as their aim and gaps in literature upon which they are founded.

Chapter 3

Improving network performance by adjusting battery operation at sub-half-hourly resolution

M. J. Zangs, et al., “On-line adjustment of battery schedules for supporting LV distribution network operation,” 2016 International Energy and Sustainability Conference (IESC), Cologne, Germany, 2016, pp. 1-6.

— Available: <http://dx.doi.org/10.1109/IESC.2016.7569485>

3.1 Overview

Due to the trends in energy demand, future network load is expected to increase in both magnitude and volatility. As a result, DNOs have two choices to address the issues that are expected to result from increased network stress. They can either invest in network reinforcement or install network support equipment. For several reasons, like decommissioning cost, installation cost, service disruption, etc., which have been outlined in Chapter 1, the installation of network support equipment was favoured. As also mentioned in Chapter 1 *SSEN* deployed and trialled an Energy

Storage Management Unit (ESMU) in some of their Low-Voltage (LV) power distribution networks. Within the scope of their trials ESMU had to be controlled to benefit the network without exceeding or violating any operational constraints. In order to achieve this kind of operation ESMU operation had to be scheduled. During this kind of operation the system either consumes or injects power according to a predetermined plan that changes at regular intervals. For historic reasons and system compliance this interval was chosen to be of 30 minutes (i.e. at half-hourly period).

Since the ESMU schedule was generated based upon a demand forecast any resulting impact on the LV network operation is therefore based upon two factors:

1. quality of the underlying forecast that is used to generate ESMU schedules, and
2. network parameters that are used to quantify the improvements that would have been expected, when the half-hourly schedule is applied.

The previous research that was conducted by the Energy Research Laboratory (ERL) at the University of Reading (UoR) focused on improving half-hourly network operation to reduce peak load [95, 197]. However, in that research sub-half-hourly demand variability has not been taken into account. Therefore previously used performance parameters and the corresponding measure of success did not effectively quantify the ESMU's capability at mitigating negative impacts from this sub-half-hourly demand.

In conclusion, this chapter addresses **Objective 1** of this thesis (which is outlined in Section 1.2) and a closed-loop optimisation method is proposed that adjusts the ESMU's phase powers at a sub-half-hourly resolution in order to improve network operation whilst maintaining the charging and discharging profile during the corresponding half-hourly period. Unlike previous work in the field, this approach makes the ESMU follow its predetermined ESMU schedule, as well as allowing it to respond to high-resolution variations in three-phase network load.

In order to investigate how network operation can be improved, a collection of commonly used parameters are evaluated in a set of corresponding cost functions. Initially these cost functions are minimised on an individual basis to inspect their separate impact on network performance. Then all cost functions are combined as a weighted sum to form a global cost function which is used in the final analysis. For each optimisation approach power flow simulations are run on a standardised UK power distribution feeder model in the simulation environment OpenDSS. This chapter therefore addresses the research question whether sub-half-hourly adjustments to scheduled ESMU operation can significantly improve measured key network parameters.

The obtainment of key network parameters and their corresponding measure of improvement is explained next, in Section 3.2. All acquired data and the power network models used for this piece of work are shown in Section 3.3. Subsequently, the closed-loop optimisation method is presented in Section 3.4. At the end of this chapter, all results are presented and discussed in Section 3.5, and a concluding summary is presented in in Section 3.6.

3.2 Key network parameters and derived cost functions

Two distinct approaches have emerged to quantitatively improve the performance of a system: either “cost” is reduced or “utility” is maximised. Both approaches rely on a mathematical explanation of underlying features that relate to performance of the system. The choice for the work in this thesis was to associate a cost to each key network parameter for the reason that cost functions can be minimised towards a finite value i.e. zero. Utility maximisation on the other hand is a theoretically unbound problem that can only reach a maximum if its maximum can be estimated

in advance. In other words, solutions to a cost function where the resulting cost is zero are by definition part of the set of optimal solutions. Determining the set of optimal solutions for the maximisation of a utility function is more difficult however.

With this in mind the key network parameters are defined and their corresponding cost functions are introduced. In this chapter, Chapter 3, power flow simulations are run at discrete times, t , which are separated by a sampling period Δt . The model used for these simulations is the IEEE LV Test Case, i.e. a network consisting of 906 three phase buses which resulting in a total of 2718 observable nodes. For each node complex currents and voltages can be obtained making the number of parameters to chose from nearly inexhaustible. In reality however a power distribution network can only be observed at a limited number of measuring points. For the NTVV project these points were at the substation and the ESMU's Point of Common Coupling (PCC). Therefore all derived network parameters that could be obtained in reality are seen as “realistic parameters” despite the fact that all key network parameters are extracted from power flow simulations. The remaining key network parameters (i.e. those that could not easily be obtained in reality) are therefore referred to as “theoretical parameters”¹.

Due to the high number of these theoretical parameters, only a subset of them is used. The choice of parameters is based on their importance, role and impact on the actual network operation. A list of all key network parameters is presented below and in this list all theoretical key network parameters are marked with a dagger (\dagger).

- Voltages at substation transformer's secondary winding, i.e. $\mathbf{v}_{ss}(t)$
- Voltages at ESMU's PCC, i.e. $\mathbf{v}_{\text{ESMU}}(t)$
- Voltages at customer lateral ^{\dagger} , i.e. $\mathbf{V}_{\text{load}}(t)$

¹In literature parameters are usually referred to as being “observable” or “unobservable”. From a technical perspective however all simulated parameters are observable. Therefore a parallel to real life observability and unobservability is drawn with the keywords “realistic” and “theoretical”, respectively.

- Total power flow, i.e. $s_{\text{net}}(t)$
- Substation line utilisation, i.e. $\mathbf{i}_{ss}(t)$
- Maximum line utilisation[†], i.e. $\mathbf{i}_{\text{line}}(t)$
- Distribution losses[†], i.e. $\mathbf{s}_{\text{losses}}(t)$

The following three subsections cover all key network parameters by detailing the cost functions relating to voltages, powers and currents within the simulated LV network.

3.2.1 Voltage related cost functions

In the UK, LV networks operate at a nominal voltage of 230V Phase-to-Neutral (P2N) or 400V Phase-to-Phase (P2P). Substations supply electricity to a three-phase cable (i.e. the feeder) and link to MV distribution networks which operate at 11kV P2P. In an ideal case the voltage measured at the substation transformer’s secondary winding remains constant as load changes. But in reality internal losses (for example conductive losses and magnetic leakage) lead to a dropping voltage level when load increases. Therefore any deviation from the substation’s nominal voltage can be seen as an indication of suboptimal network operation.

The “voltage deviation cost function” $\zeta_{\text{voltage}}(\mathbf{v}(t))$ captures and associates a cost to this suboptimal operation. This cost function is defined for a multi-phase complex voltage vector as $\mathbf{v}(t)$ where $\mathbf{v}(t) = (v_{\phi}(t))$, where ϕ is the phase number and where t the time at which the measurement was taken. Both phase and time are discrete, i.e. $\phi \in \{1, \dots, \Phi\}$ where $\Phi \in \mathbb{Z}_{>0}$ and $t \in \mathbb{Z}_{\geq 0}$. When using the three-phase substation voltage vector, $\mathbf{v}_{ss}(t)$ (where $\mathbf{v}_{ss}(t) = (v_{ss,\phi}(t))$), with this cost function any drop in transformer voltage results in a positive cost.

$$\zeta_{\text{voltage}}(\mathbf{v}(t)) := \sum_{\phi=1}^{\Phi} \begin{cases} \zeta_h(v_\phi(t)) & \text{if } V_{\text{ss}} \leq v_\phi \\ \zeta_l(v_\phi(t)) & \text{otherwise} \end{cases} \quad (3.1)$$

where $\Phi \in \mathbb{Z}_{>0}$

In this voltage cost function, Φ represents the number of phases (i.e. $\Phi = 3$), and $\zeta_h(v_\phi)$ and $\zeta_l(v_\phi)$ are two functions that convert a single voltage value (i.e. v_ϕ) into a normalised positive cost based upon the direction of voltage deviation. High and low voltage thresholds, respectively V_h and V_l , are introduced in order to define these two functions. When choosing these two thresholds, then they must also satisfy the following inequality:

$$V_l < V_{\text{ss}} < V_h \quad (3.2)$$

For the work presented here these two thresholds are based on the UK's nominal LV voltage range of +10% -6% around V_n , i.e. 230V P2N. As a result the following upper and lower threshold functions are subsequently defined in order to form a continuously differentiable cost function with a single zero tangent.

$$\zeta_h(v_\phi) := \left(\frac{v_\phi - V_{\text{ss}}}{V_h - V_{\text{ss}}} \right)^2 \quad (3.3)$$

$$\zeta_l(v_\phi) := \left(\frac{V_{\text{ss}} - v_\phi}{V_{\text{ss}} - V_l} \right)^2 \quad (3.4)$$

Substations can raise their voltage slightly above the nominal LV voltage level since voltage do typically drop continuously along a purely consumptive feeder. The impact on the cost function $\zeta_{\text{voltage}}(\mathbf{v})$ when V_{ss} is increased is shown in Figure 3.1 (for simplicity a single-phase voltage vector is shown, i.e. $\Phi = 1$).

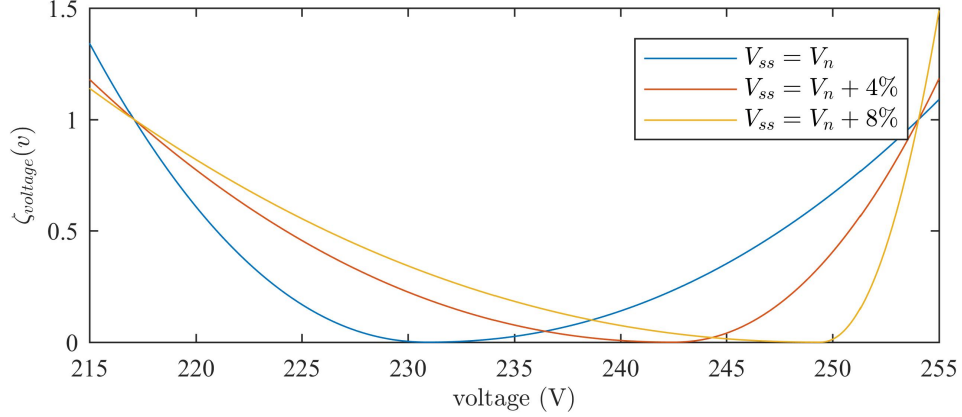


Figure 3.1: Cost function $\zeta_{\text{voltage}}(v_\phi)$ values for different substation voltages

In this figure, it can be seen that $\zeta_{\text{voltage}}(\mathbf{v})$ at the thresholds V_l and V_h equates to one, and to zero at the set substation voltage, even when this voltage is risen. This intentional feature is demonstrated by raising V_{ss} from V_n by +4% and +8%. At the ESMU's Point of Common Coupling (PCC) the device has access to all three phases of the feeder. One can assume that the line voltage along a purely consumptive feeder will drop continuously. Reasons behind this voltage drop are the resistive and inductive losses in the distribution lines which are amplified with proximity to the substation due to aggregated load currents from “down stream” customers. Under heavy load conditions this voltage is likely drop below the statutory operation limit. Yet this limit must not be violated since it is an operational constraint for DNOs.

To mitigate this voltage drop power is injected into the feeder at the ESMU's PCC. Doing so increases the voltage at its PCC and surrounding nodes since the portion of load current that would normally be supplied by the substation is now delivered by the ESMU. This effect when injecting power is sketched in the Figure 3.2 below.

In this figure the expected voltage drop along the entire feeder is sketched. It can be seen how the voltage of the feeder's tailing section can potentially drop below V_l , but ESMU's intervention can alleviate some load and bring voltages back within operational bounds. The three-phase ESMU voltage, $\mathbf{v}_{ESMU}(t)$ (where $\mathbf{v}_{ESMU}(t) =$

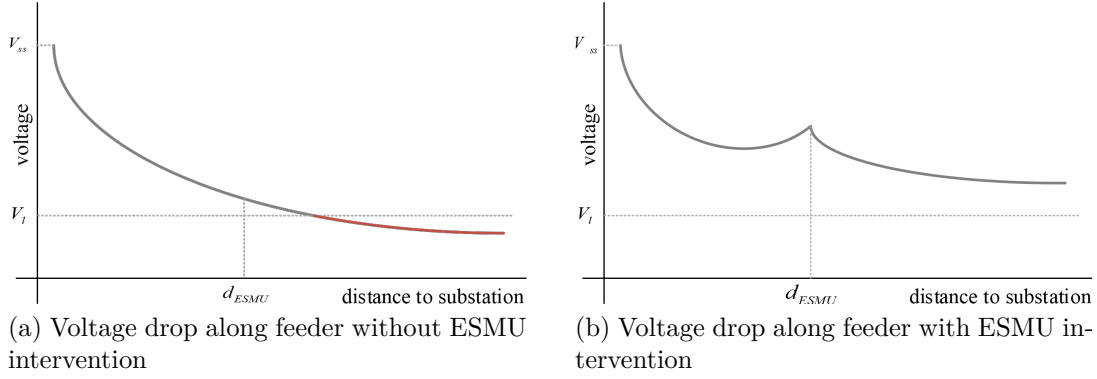


Figure 3.2: Sketch of the benefits that occur when ESMU injects power into the feeder in order to mitigate the voltage drop along the cable

$(v_{ESMU,\phi}(t))$ is seen as a realistic key network parameter which is also used in combination with a cost function. In fact, $\mathbf{v}_{ESMU}(t)$ is used with cost function, $\zeta_{\text{voltage}}(\mathbf{v}(t))$, which was defined in Equation 3.1. This is the same cost function (i.e. $\zeta_{\text{voltage}}(\mathbf{v})$) that was used to assess the deviation in transformer voltage. Therefore, the resulting cost can be formulated as $\zeta_{\text{voltage}}(\mathbf{v}_{ESMU}(t))$.

The Electricity Safety, Quality and Continuity Regulations (ESQCR) define the statutory voltage range at UK electricity customers [13]. However monitoring those voltages to assure they lie within limits is unfeasible since the installation of synchronised voltage measurement equipment at all loads implies significant cost. Therefore these voltages are unknown in reality. Nonetheless, in simulations all load voltages can easily be extracted and since ESMU can impact all voltage levels to some degree they are treated as theoretical key network parameters.

To illustrate this load voltage drop a snapshot OpenDSS simulation was run on the used network model with all load consuming 8kW of power². Figure 3.3 then shows all load bus voltages against their distances to the substation.

In this figure, two observations can be made.

1. It can be seen that phases are significantly unbalanced.

²Whilst historic and recent loads reach values of this magnitude quite infrequently, future customer demand with the aggregated effect home-charging of EVs is expected to yield extreme scenarios like this.

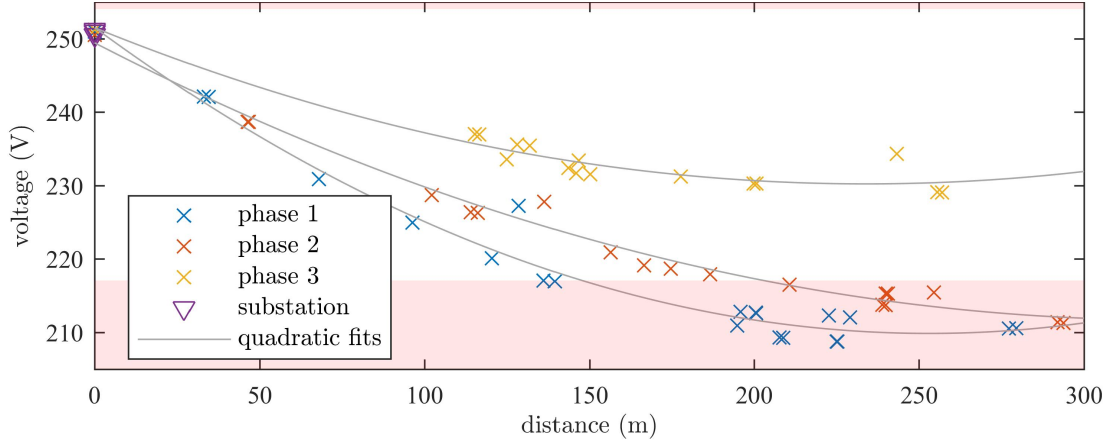


Figure 3.3: Voltage at the loads in the IEEE LV Test Case network for a total load of 440kVA against distance between the corresponding load and substation: for the quadratic fit $R^2 = 58.76\%$

2. Customers further than 200m from the substation are likely to experience low-voltage events for the conducted simulation.

Although ESMU can reduce the number of such low-voltage events, including a cost for each load would add significant difficulty to the minimisation problem. Therefore, to solve this problem more efficiently the previously defined voltage cost function (i.e. Equation 3.1) is expanded to only return a single value for all customer voltages. More specifically, only the worst deviation cost is used. By reducing this number to the worst case any implemented solver thus focuses on the edges of the minimisation problem. This focus is of particular importance especially if the impact of the ESMU on some customer voltages is comparatively low. An aggregated voltage deviation cost would potentially obfuscate this impact and prevent the solver from effectively targeting the worst cases. Therefore, the customer (or load) voltage is defined as $\mathbf{V}_{\text{load}}(t)$, where $\mathbf{v}_{\text{load}}(t) = (v_{\text{load},i,\phi}(t))$, and used in the new cost function, $\zeta_{\text{load voltage}}(\mathbf{V}_{\text{load}}(t))$, which is defined as:

$$\zeta_{\text{load voltage}}(\mathbf{v}(t)) := \max_{i,\phi} (\zeta_{\text{voltage}}(v_{i,p}(t))) \quad (3.5)$$

where $i \in \{1, \dots, I\}$ and $\phi \in \{1, \dots, \Phi\}$ and $I \in \mathbb{Z}_{>0}$ and $\Phi \in \mathbb{Z}_{>0}$

Here, i represents the customer number out of a total customer count I , and ϕ represents the phase, out of the phase count Φ , to which the customer is connected.

3.2.2 Power related cost functions

Beside meeting voltage constraints DNOs need to assure that their distribution networks operates both in an efficient and hence ideal manner. How ideal a three-phase network operates is indicated by its phase unbalance. This disturbance due to unbalanced phase load need not have an immediate impact, but negative long term effects (for example asymmetric load on transformers, rotating machines and increased neutral current) do weaken network assets and cannot be neglected. The approach by which UK customers are connected to the feeder increases the problem of phase unbalance even more because the single phase allocation is performed arbitrarily. Randomly assigning customers' phases was intended to distribute load evenly across all three phases which in theory should balance the three-phase network load. In reality however this is not the case. Even in the unlikely event where the number of customers per phase is the same the probability that all their loads match is very low. Therefore, the probability that LV distribution feeders in the UK are unbalanced is high.

Substation monitoring is capable of providing reliable three-phase power measurements. Hence, they can be used as realistic key network parameters to calculate the network's phase unbalance. The American National Standards Institute's (ANSI) definition of Unbalance Factor (UF) is used to calculate the phase unbalance [198]:

$$\text{UF}(\mathbf{x}) := \frac{\max_n |\bar{\mathbf{x}} - x_n|}{\bar{\mathbf{x}}} \text{ where } \mathbf{x} = (x_n) \quad (3.6)$$

and $n \in \mathbb{Z}_{>0}$

Here, \mathbf{x} can be an arbitrary vector, consisting of scalar values x_n (for example x_n is the voltage, current or power measurement per phase n). In this context x_n is chosen to be the power flow into one of the network's phases. For clarity the notation of $\bar{\mathbf{x}}$ is used to define the mean of the given vector, i.e.:

$$\bar{\mathbf{x}} := \frac{1}{N} \sum_n^N x_i \quad (3.7)$$

Substituting the three-phase substation power vector, $\mathbf{s}_{ss}(t)$ (where $\mathbf{s}_{ss} = (s_{ss,\phi})$), for \mathbf{x} , allows the formulation of another cost, i.e. the “unbalance” cost, $\zeta_{\text{unbalance}}(\mathbf{s}_{ss}(t))$ which is defined as:

$$\begin{aligned} \zeta_{\text{unbalance}}(\mathbf{s}(t)) &:= \text{UF}(\mathbf{s}(t)) - 1 \\ &= \frac{\max_{\phi} |\overline{\mathbf{s}(t)} - s_{\phi}(t)|}{\overline{\mathbf{s}(t)}} - 1 \end{aligned} \quad (3.8)$$

where $\phi \in \{1, \dots, \Phi\}$ and $\Phi \in \mathbb{Z}_{>0}$

Since the lowest value of $\text{UF}(\mathbf{x})$ is one, the corresponding cost function had to be adjusted in order to reach a minimum value of zero instead. A sample illustration that shows how this cost behaves as phase unbalance increases is included in the Figure 3.4.

Here, it can be seen how $\zeta_{\text{unbalance}}(\mathbf{s}(t))$ rises with an increasing separation of the three-phase power values. Additionally, to assess the effective utilisation of the power distribution network deviation from a unity Power Factor (PF) is also formulated

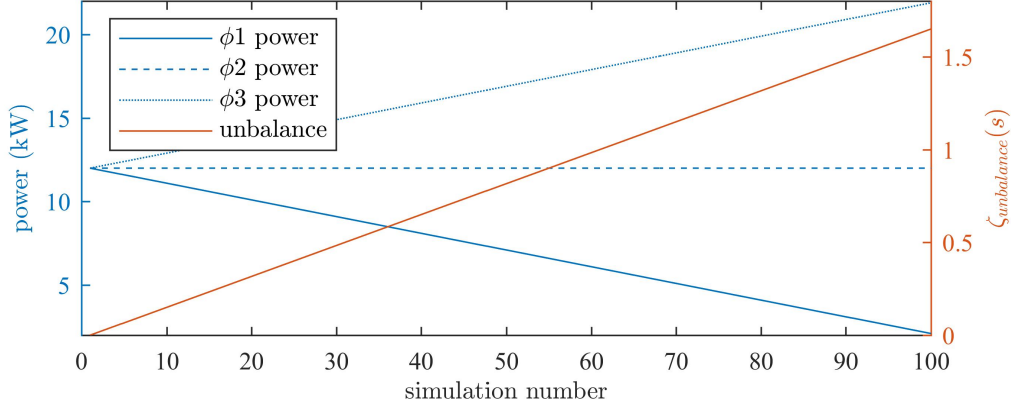


Figure 3.4: Sample network imbalance for different phase loadings as defined in ANSI/NEMA MG 1-2011

as a cost. PF is the ratio between active (p) and apparent power (s), and gives an indication of how much “good” power is being consumed by the system³. Keeping PF of a system close to unity indicates that it only requires active power to operate which implies that it uses the lowest possible amount of power transmission resources. In order to indicate the proximity to unity PF a corresponding cost, $\zeta_{\text{PF}}(\mathbf{s}_{ss}(t))$, is used and which is defined as:

$$\zeta_{\text{PF}}(\mathbf{s}(t)) := \Phi - \sum_{\phi=1}^{\Phi} \frac{\text{Re}(s_{\phi}(t))}{|s_{\phi}(t)|} \text{ where } \mathbf{s}(t) = (s_{\phi}(t)) \text{ and } \Phi \in \mathbb{Z}_{>0} \quad (3.9)$$

Any deviation from a unity PF per phase increases the associated cost whilst achieving a perfect PF for each phase results in a total cost of zero. In perfectly balanced systems that operate at unity PF all three phases are 120° out of phase, and the sum of their instantaneous powers should equate to zero. This zero-sum also indicates that no neutral current is flowing in the system. However, in an unbalanced system that operates at non-unity PF the power transmitted through the neutral conductor can significantly deviate from zero. The negative impact of transmitting current

³Reactive power is used to maintain magnetic fields in rotating machines, yet this can be supplied by local reactive power compensators and thus need not occupy otherwise free power transmission resources.

through the neutral conductor is further amplified since typical power distribution cables often use neutral conductors with significantly smaller cross-section areas than those used as line conductors. Results of any such additional current in the neutral conductor are further deviation of neutral voltages from ground, increased losses and quicker exhaustion of the neutral conductor's power carrying capability (making the system become more prone to failures). A somewhat unconventional approach is used here, since neutral power is estimated instead of neutral current. The mechanism to calculate this power flow in the neutral conductor is however identical to calculating neutral current. To address this last point a “neutral load” cost, $\zeta_{\text{neutral load}}(\mathbf{s}_{ss}(t))$, is defined as follows:

$$\zeta_{\text{neutral load}}(\mathbf{s}(t)) := \left| \sum_{\phi=1}^{\Phi} s_{\phi}(t) e^{\frac{j2\pi\phi}{\Phi}} \right| \text{ where } \mathbf{s}(t) = (s_{\phi}(t)) \text{ and } \Phi \in \mathbb{Z}_{>0} \quad (3.10)$$

Equation 3.10, superimposes the three-phase network powers whilst rotating each power vector by an integer multiple of 120° (i.e. $e^{\frac{j2\pi\phi}{3}}$ where $\phi = \{1, 2, 3\}$) in the complex plane. In a perfectly balanced scenario the summation results in no neutral power (i.e. a value of zero), but for an unbalanced network the magnitude value will be greater than zero. Therefore this magnitude of the neutral's apparent power vector is computed which is then used as the resultant cost.

In comparison to the losses of the HV electricity networks, losses in the LV distribution network are comparably small. After all, a single LV feeder can distribute up to 500kW of power, whilst HV networks transmit more than 60GW. Nonetheless the aggregate effect of reducing those losses could have a noticeable impact on both network efficiency and maximising profit margins (after all, energy suppliers cannot charge for undelivered energy). For example, in the high load scenario that was simulated in in Section 3.2.1 distribution losses were calculated as 58kW. This equates to

12% of the total network power, but losses would be noticeably lower during normal network operation, for instance at a maximum of 5%. The rising proportion of losses as uniform network load is continuously increased is shown in Figure 3.5.

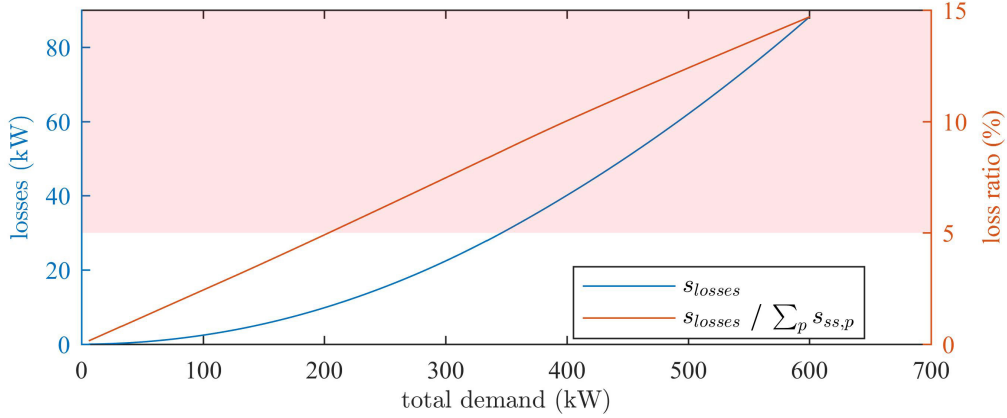


Figure 3.5: Losses against increasing power demand

In Figure 3.5, the region where losses exceed 5% of the total network power is highlighted in red. Whilst these losses are easily obtained from power flow simulations, in reality distribution losses cannot be determined with such ease. Therefore, the network losses, $s_{\text{losses}}(t)$, are seen as theoretical key network parameters and they are used in the final power related cost, $\zeta_{\text{losses}}(s(t))$, which is defined as follows:

$$\zeta_{\text{losses}}(s(t)) := |s(t)| \quad (3.11)$$

3.2.3 Current related cost functions

Although voltage deviation and inefficient network operation have been addressed, physical network limits have not yet been taken into account: i.e. the current carrying capabilities of the cables. Heat (i.e. losses that are caused by the line's impedance) deteriorates the cable over time. Therefore cables have an assigned thermal rating which should not be exceeded in order to minimise permanent cable damage and mitigate possible network failure. At substation level, fuses or reclosers are installed

that will disconnect the network under fault or high current conditions to prevent over-currents. To quantify whether the substation fuse is approaching its tripping point, its nominal fuse rating, I_{fuse} , is used. For the context of this work, I_{fuse} , is a static value which must not be exceeded. Using the three-phase current vector, $\mathbf{i}_{ss}(t)$ (obtained via substation monitoring, where $\mathbf{i}_{ss}(t) = (i_{ss,\phi}(t))$) a cost, $\zeta_{\text{fuse utilisation}}(\mathbf{i}_{ss}(t))$, is formulated and defined as follows:

$$\zeta_{\text{fuse utilisation}}(\mathbf{i}(t)) := \left(\frac{\sum_{\phi=1}^{\Phi} i_{\phi}(t)}{I_{\text{fuse}}} \right)^2 \text{ where } \phi \in \{1, \dots, \Phi\} \text{ and } \Phi \in \mathbb{Z}_{>0} \quad (3.12)$$

In the Figure 3.6, a plot has been included to illustrate how this quadratic cost behaves as substation current increases. For this simple case the substation line rating was set as $i_{\text{fuse}} = 400\text{A}$ and the total substation current is the sum of all three phase currents. The red area indicates the region where current exceeds the fuse's nominal rating.

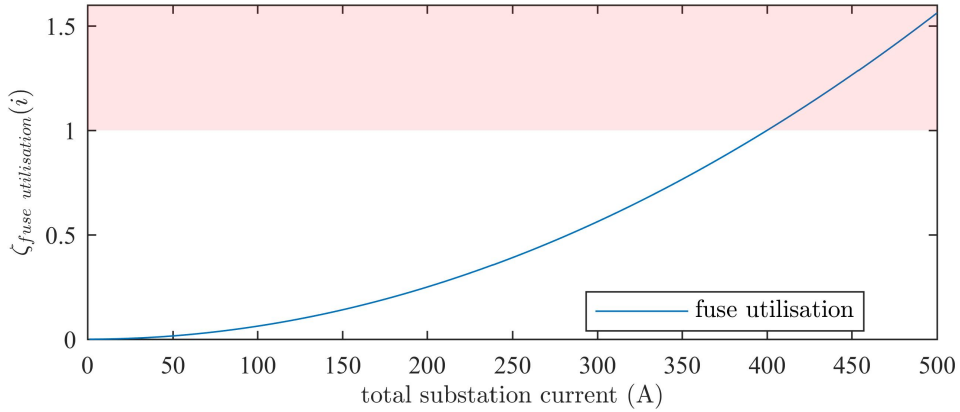


Figure 3.6: Cost of line or fuse utilisation against network current

In addition to the currents flowing through the substation's fuse, currents flowing through all lines in the network are also considered. Just like voltage levels at each customer, line currents are also seen as theoretical key network parameters since they cannot easily be obtained. Generally as the distance to the substation increases

fewer “down stream” customers are connected to a radially expanding feeder and therefore cables can be scaled down (for example to save cost). However with the expected uptake of LCTs, feeders are expected to deliver increasingly larger currents throughout all lines. For smaller lines at the network edge these currents can increase to a magnitude larger than their nominal ratings. Therefore the fuse current cost is expanded to take into account all line currents, $i_{\text{line},l,\phi}(t)$, and their nominal ratings, $I_{\text{nom},l}$. Here l represents the line number and ϕ the phase of that line. Collecting them in $\mathbf{i}_{\text{line}}(t)$ (where $\mathbf{i}_{\text{line}}(t) = (i_{\text{line},l,\phi}(t))$) allows the formulation of an extended line utilisation cost, $\zeta_{\text{line utilisation}}(\mathbf{i}_{\text{line}}(t))$, which is defined as follows:

$$\zeta_{\text{line utilisation}}(\mathbf{i}(t)) := \max_l \left(\frac{\sum_{\phi=1}^P i_{l,\phi}(t)}{I_{\text{nom},l}} \right)^2 \quad (3.13)$$

where $l \in \{1, \dots, L\}$ and $\phi \in \{1, \dots, \Phi\}$ and $L \in \mathbb{Z}_{>0}$ and $\Phi \in \mathbb{Z}_{>0}$

Similar to Equation 3.5, this cost function only considers the maximum line utilisation in order to reduce computational burden without decreasing any parameter sensitivity.

3.3 Data, models and storage scheduling

In this section the used power data is presented first. Then the network model from which all aforementioned key network parameters are extracted and the battery model are explained. In the end the ESMU scheduling procedure is detailed.

3.3.1 Load profiles

Alongside the LV Test Case model the IEEE published 100 minutely demand profiles; each profile lasting 24h. Therefore by assigning one load profile to each customer a series of 1440 snapshot simulations could be run in OpenDSS in order to simulate the

variation and volatility in demand over the entire day. A standardised power factor of 0.95 was used for all loads to calculate their reactive component. The apparent network power, $s_{\text{net}}(t)$, is therefore defined for each time-step, t , as the aggregate of all load apparent powers, $\mathbf{s}_{\text{load}}(t)$:

$$s_{\text{net}}(t) := \sum_{i=1}^I s_{\text{load},i}(t) \text{ where } I \in \mathbb{Z}_{\geq 0} \quad (3.14)$$

However, this demand profile does not take into account the distribution losses since they are only known after performing the power flow simulations. Nonetheless, it functions as a simple time-series to schedule ESMU operation which is detailed in Section 3.3.4.

3.3.2 Network model

The IEEE Power and Energy Society (IEEE-PES) provides several multi-node test cases. These test cases used to be limited to distribution networks in the United States. In 2015 however, they published a standardised model of a LV distribution network for the UK power network. This model is called the “European Low Voltage Test Feeder” [4]. Within the context of the work in this thesis, this feeder is referred to as the “LV Test Case” and a network plot of this feeder has been included for reference.

A substation (triangle in north west) provides power to the feeder and the power magnitude is visualised by the thickness of the feeder’s lines. In total there are 55 single-phase households connected to the substation which represents a medium-sized and unbalanced UK feeder.

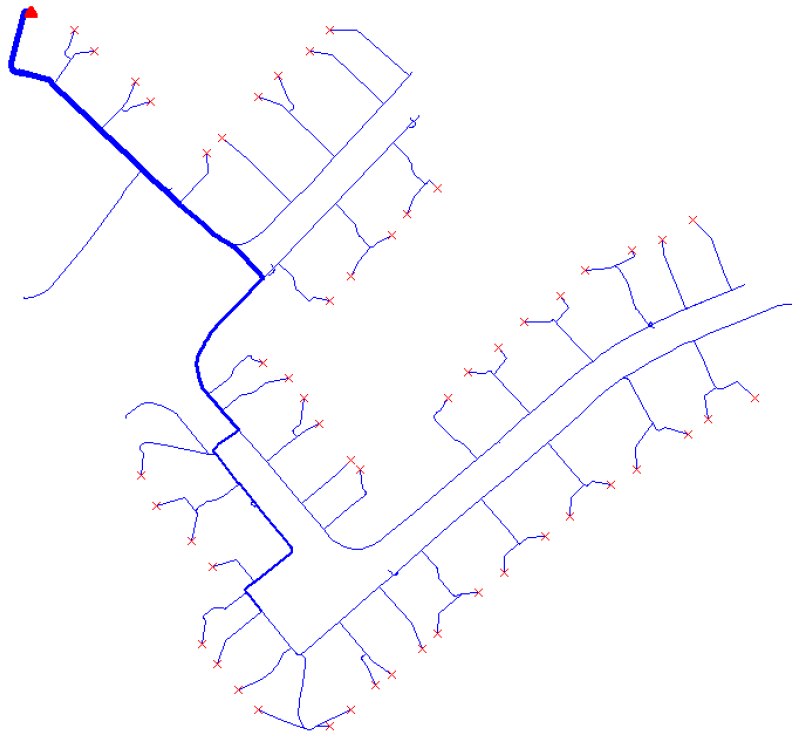


Figure 3.7: A power flow plot of the IEEE-PES European Test Case Feeder, i.e. a LV distribution network in the UK [4].

3.3.3 Battery model

The ESMU systems that were deployed throughout the NTVV project consisted of two parts: the Power Management Unit (PMU) and the Energy Storage Unit (ESU). The PMU controls three-phase powers and links the ESU to the grid. Each PMU's single-phase power rating, S_{rating} , is 12kVA and can also perform filtering functions beside battery charging and discharging (for example to compensate for harmonic distortion, reactive power and phase unbalance). The ESU is a modular container of 12.5kWh of Li-Ion energy storage that can be concatenated to increase the total energy storage capacity. All battery monitoring, conditioning and regulation is performed within the ESU and hence lies outside the scope of this work. However, control instructions that are sent to the ESMU system should not request the device to operate outside its own specifications (i.e. avoid under- or over-charge).

In order to simulate this constrained ESMU system and its energy storing behaviour, in this section, Section 3.3.3, an energy model is developed from the given device specifications. This model includes an charge-discharge efficiency, η , and standby losses, μ . η is related to the efficiency of the PMU's power converters, which are quoted to have a round trip efficiency of 98% (i.e. $\eta = 0.98$) yet the whole range is $\eta \in [0, 1]$. μ on the other hand (where $\mu \in [0, 1]$) is linked to the nominal power drawn by the battery's control system as well as the battery's self-discharge rate. With the charge-discharge efficiency, η , the battery charge-discharge power, $p_{\text{bat}}(t)$, can be calculated for any given ESMU power, $\mathbf{s}_{\text{ESMU}}(t)$ (where $\mathbf{s}_{\text{ESMU}}(t) = (s_{\text{ESMU},\phi}(t))$).

$$p_{\text{bat}}(t) := \begin{cases} \eta \text{Re} \left\{ \sum_{\phi=1}^{\Phi} s_{\text{ESMU},\phi}(t) \right\} & \text{if } \text{Re} \left\{ \sum_{\phi=1}^{\Phi} s_{\text{ESMU},\phi}(t) \right\} \geq 0 \\ \frac{1}{\eta} \text{Re} \left\{ \sum_{\phi=1}^{\Phi} s_{\text{ESMU},\phi}(t) \right\} & \text{otherwise} \end{cases} \quad (3.15)$$

where $\phi \in \{1, \dots, \Phi\}$ and $\Phi \in \mathbb{Z}_{>0}$

Although the ESMU's PSU rating, S_{rating} , allows for a maximum power consumption of 36kVA (i.e. $= 3 \times 12\text{kVA}$) the charging power is internally limited by a charging factor, C_f . This factor is the ratio between the battery's maximum discharge power and its total capacity (i.e. $\max_t(p_{\text{bat}}(t)) \leq C_f \cdot C_{\text{bat}}$). In accordance to the ESMU's specification, C_f was set to 1.6. With those restrictions in mind a charge-discharge power can be applied to charge or discharge the battery. Assuming that this power remains constant during a predefined sample period, Δt , then the change in stored energy can be defined as follows.

$$\Delta E_{\text{bat}}(t) = p_{\text{bat}}(t) \Delta t \quad (3.16)$$

The battery's dynamics can therefore be modelled as the change in energy level from time t to time $t + \Delta t$. Taking into account the standby losses, μ , the next energy level $E_{\text{bat}}(t + \Delta t)$ is defined as:

$$E_{\text{bat}}(t + \Delta t) := \mu (\Delta E_{\text{bat}}(t) + E_{\text{bat}}(t)) \quad (3.17)$$

In an ideal case where $\mu = 1$ no energy would be lost in the storage system. However, to model energy storage dynamics it became common practice to assess the energy storage's charge level as the State of Charge (SOC) instead of using the actually stored energy level. This SOC is defined as the actual energy stored in the ESU, $E_{\text{bat}}(t)$, divided by the total capacity of the system, C_{bat} . i.e.:

$$SOC(t) := \frac{E_{\text{bat}}(t)}{C_{\text{bat}}} \quad (3.18)$$

Similar to the energy dynamics the SOC dynamics can therefore be defined as:

$$SOC(t + \Delta t) := \mu \left(\frac{p_{\text{bat}}(t) \Delta t}{C_{\text{bat}}} + SOC(t) \right) \quad (3.19)$$

When summarising $\hat{s}_{\text{ESMU}}(t) = \text{Re} \left\{ \sum_{\phi=1}^{\Phi} s_{\text{ESMU},\phi}(t) \right\}$ and combining Equation 3.15 with Equation 3.19, then the battery model's full dynamics can be defined as:

$$SOC(t + \Delta t) := \begin{cases} \mu \left(\frac{\eta \hat{s}_{\text{ESMU}}(t) \Delta t}{C_{\text{bat}}} + SOC(t) \right) & \text{if } \hat{s}_{\text{ESMU}}(t) \geq 0 \\ \mu \left(\frac{\hat{s}_{\text{ESMU}}(t) \Delta t}{\eta C_{\text{bat}}} + SOC(t) \right) & \text{otherwise} \end{cases} \quad (3.20)$$

A flowchart to visually represent the developed battery model, is included in Figure 3.8. In this figure all green and blue fields indicate, respectively, model inputs and results. The white states represent operations that are applied to those inputs and results. The flowchart's output is marked as the yellow field.

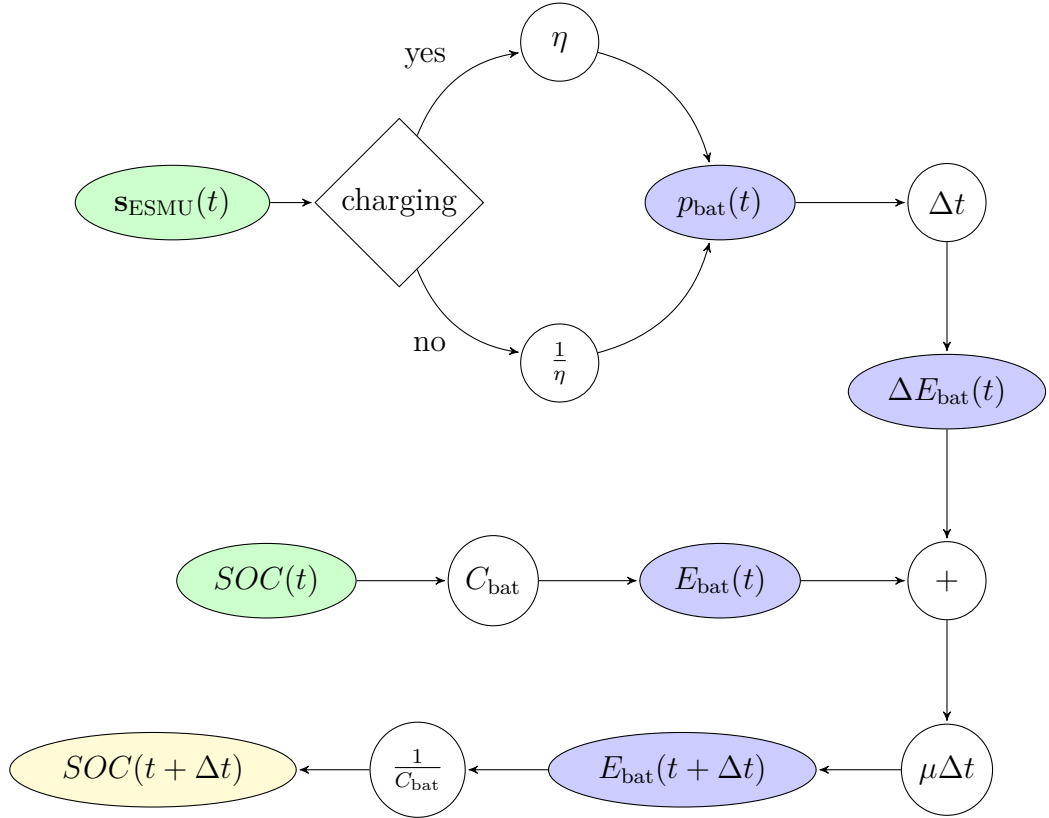


Figure 3.8: Flowchart to calculate the next SOC (i.e. $SOC(t + \Delta t)$) based on current ESMU power (i.e. $s_{\text{ESMU}}(t)$ which is predefined) and current SOC (i.e. $SOC(t)$ which is predefined).

3.3.4 ESMU scheduling

Computing the ESMU's daily schedule at the dataset's temporal resolution (i.e. sub-half-hourly) is ineffective and slow because demand variability due to behavioural unpredictability makes forecasting at high temporal resolution unfeasible. In addition the large number of search parameters makes finding a solutions very computationally demanding. Therefore forecasting and scheduling is generally performed at half-hourly temporal resolution. To obtain such a half-hourly profile the sub-half-hourly profile had to be down-sampled and synchronised. This is done with the synchronisation function $k(t)$ which links the original sub-half-hourly demand to a half-hourly time-series and is defined as follows:

$$k(t) := \left\lfloor \frac{t-1}{K\Delta t} \right\rfloor + 1 \quad (3.21)$$

Here, t is the same positive integer as before to indicate time in minutes, Δt is the sub-half-hourly sampling period of the simulation at minutely time intervals (i.e. 1 minute in this case) and K is the number of the half-hourly time-slot (or number of sub-half-hourly periods) within the half-hourly slot (i.e. 30 slots per minute in this case). It is worth mentioning that the minutely sampling period Δt currently equates to one, yet for flexibility of this equation (for instance when using seconds as a base unit) it remains included. It should be noted that the integer multiple of K has to equate to the scheduling horizon's length, T_{sch} ; i.e. $a := \frac{K}{T_{\text{sch}}}$ where $a \in \mathbb{Z}_{>0}$. Otherwise the sub-half-hourly profile cannot be divided into a set of equal length time-slots where each time-slot is of length $K\Delta t$. Therefore the resulting half-hourly network load, $s_{\text{net}}^*(t)$ (where $\mathbf{s}_{\text{net}}^* = (s_{\text{net}}^*(t))$) is defined as follows:

$$s_{\text{net}}^*(t) = \frac{1}{K} \sum_{\tau=\alpha(t)}^{\beta(t)} s_{\text{net}}(\tau) \text{ where } K \in \mathbb{Z}_{>0} \quad (3.22)$$

where $\alpha(t) := k(t)K$ and $\beta(t) := (k(t) + 1)K - 1$

Now, over the period from $\alpha(t)$ to $\beta(t)$, power values are equal. To illustrate the difference between the original sub-half-hourly network load and the resulting half-hourly demand, both profiles are plotted in Figure 3.9. In this figure it can be observed how the high variability and volatility in power is removed in the half-hourly profile. When generating ESMU schedules these variations are neglected and thus the unwanted peak power demands cannot be sufficiently compensated.

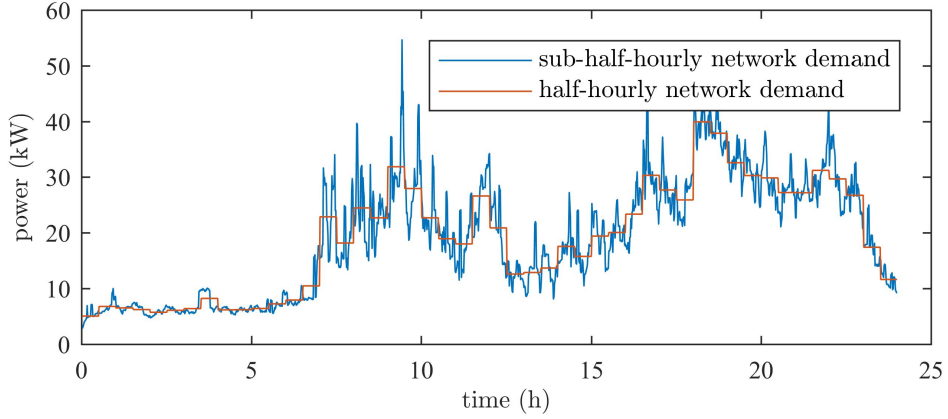


Figure 3.9: Highly variable and volatile demand profile vs half-hourly demand (i.e. a forecast under perfect foresight conditions)

The main goals when scheduling battery operation are to achieve “valley-filling” and “peak-shaving” behaviour. As shown in the literature review in Chapter 2, the Peak-to-Average Ratio (PAR), the min-max-difference (MMD) and the power transients (TRA) are good indicators of such a behaviour. Therefore three half-hourly costs regarding are used as, $\zeta_{\text{PAR}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*)$, $\zeta_{\text{MMD}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*)$, and $\zeta_{\text{TRA}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*)$ are defined as follows:

$$\zeta_{\text{PAR}}(\mathbf{s}) := \frac{\max_t |\mathbf{s}|}{\frac{1}{K} \sum_{t=1}^a s(t)} - 1 \text{ where } \mathbf{s} = (s(t)) \quad (3.23)$$

$$\zeta_{\text{MMD}}(\mathbf{s}) := \frac{\max_t (\mathbf{s}) - \min_t (\mathbf{s})}{\frac{1}{K} \sum_{t=1}^a s(t)} \text{ where } \mathbf{s} = (s(t)) \quad (3.24)$$

$$\zeta_{\text{TRA}}(\mathbf{s}) := \max_t |s(t + \Delta t) - s(t)| \text{ where } \mathbf{s} = (s(t)) \quad (3.25)$$


The half-hourly cost in Equation 3.23 computes the ratio between the maximum network power and the mean network power. One is subtracted from the original PAR function to normalise this value with a minimum value of zero. Equation 3.24 returns the difference between the largest and smallest network power and Equation 3.25 computes the change in network power over time. All three costs functions assess the sum of the half-hourly ESMU schedule, $\mathbf{s}_{\text{ESMU}}^*$, and the half-hourly network load profile, $\mathbf{s}_{\text{net}}^*$, and when they reach a value of zero then a perfectly flat profile (i.e. valley-filled and peak-shaved) is obtained. Combined with all underlying model constraints, the following minimisation problem is defined to aim and obtain such a flat power profile:

$$\begin{aligned} \min_{\mathbf{s}_{\text{ESMU}}^*} \quad & \{\zeta_{\text{PAR}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*) + \zeta_{\text{MMD}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*) + \zeta_{\text{TRA}}(\mathbf{s}_{\text{ESMU}}^* + \mathbf{s}_{\text{net}}^*)\} \\ \text{s.t.} \quad & \begin{cases} p_{\text{bat}}(t) \leq C_f \times C_{\text{bat}} \\ |s_{\text{ESMU},\phi}(t)| \leq S_{\text{rating}} \forall \phi \\ 0 \leq \text{SOC}(t) \leq 1 \end{cases} \end{aligned} \quad (3.26)$$


To solve this minimisation problem, a Sequential Quadratic Programming (SQP) approach was chosen. The resulting half-hourly ESMU power, $\mathbf{s}_{\text{ESMU}}^*$, could then be extrapolated using the same synchronisation function, $k(t)$, to yield a sub-half-hourly

ESMU schedule.

For the work presented in this chapter the supplied half-hourly network load (or forecast) was obtained from sub-half-hourly data. Treating it as a forecast with perfect foresight does not skew the already imperfect schedule performance which is obtained when applying the resulting half-hourly schedule to sub-half-hourly load. Figure 3.10 shows a sample day where the impact of this half-hourly ESMU schedule becomes apparent.

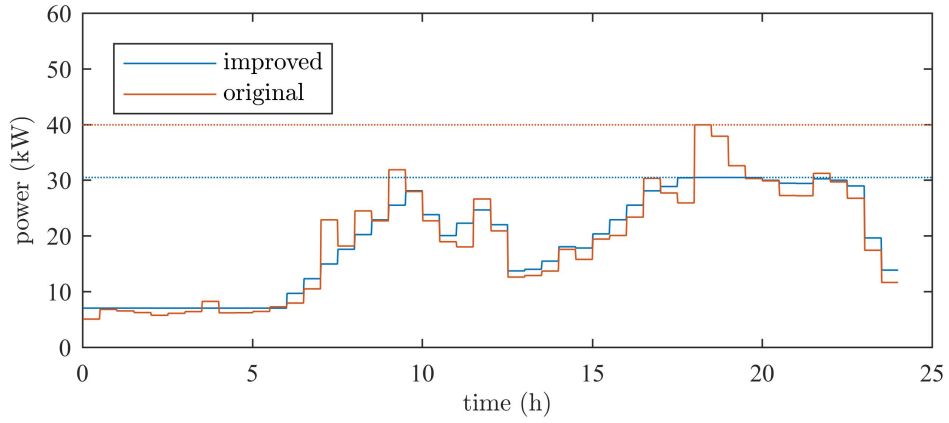

(a) Half-hourly ESMU power impact ($\Delta S = 9.46kW$)

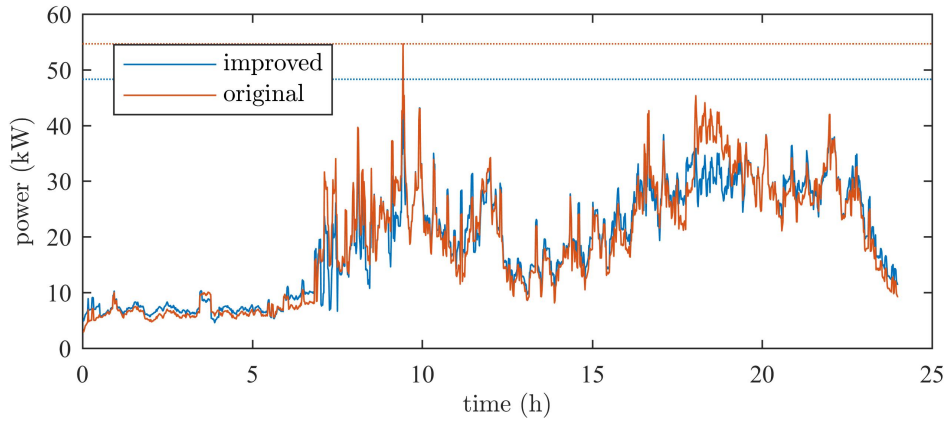

(b) Sub-half-hourly ESMU power impact ($\Delta S = 6.36kW$)

Figure 3.10: Impact of half-hourly ESMU schedule on sub-half-hourly power profile

This figure shows the positive impact on the half-hourly profile (i.e. in Figure 3.10a) which is particularly dominant during the evening peak load. However, the impact on the actual sub-half-hourly demand (i.e. in Figure 3.10b) has a much

larger demand spike during the morning hours which is not that strongly addressed. When compared, the ideal peak power shaving dropped from 9.46kW to only 6.36kW. Nonetheless, the overall improvement yielded by the ESMU schedule can still be noticed. The method of how to adjust the ESMU's phase powers to mitigate the impact of such volatile load spikes is addressed in the following section.

3.4 Optimisation method

Previously, in Section 3.2, the key network parameters and associated cost functions have been established, and the data, models and schedule generation is explained in Section 3.3. A summary of all key network parameters that are used in this work is listed below, but the full notation is defined in the nomenclature of this thesis:

- substation phase voltages, $\mathbf{v}_{ss}(t) = (v_{ss,\phi}(t))$ where $\mathbf{v}_{ss}(t) \in \mathbb{R}^\Phi$,
- ESMU phase voltages, $\mathbf{v}_{\text{ESMU}}(t) = (v_{\text{ESMU},\phi}(t))$ where $\mathbf{v}_{\text{ESMU}}(t) \in \mathbb{C}^\Phi$,
- all load voltages, $\mathbf{C}_{\text{load}}(t) = (v_{\text{load},i,\phi}(t))$ where $\mathbf{V}_{\text{load}}(t) \in \mathbb{C}^{I \times \Phi}$,
- substation apparent phase power, $\mathbf{s}_{ss}(t) = (s_{ss,\phi}(t))$ where $\mathbf{s}_{ss}(t) \in \mathbb{C}^\Phi$,
- substation phase currents, $\mathbf{i}_{ss}(t) = (i_{ss,\phi}(t))$ where $\mathbf{i}_{ss}(t) \in \mathbb{R}^\Phi$,
- all line currents, $\mathbf{I}_{\text{line}}(t) = (i_{\text{line},l,\phi}(t))$ where $\mathbf{I}_{\text{line}}(t) \in \mathbb{R}^{L \times \Phi}$, and
- all network losses, $s_{\text{losses}}(t)$ where $s_{\text{losses}}(t) \in \mathbb{C}$.

In this section, the method of adjusting the predetermined ESMU schedule on a sub-half-hourly basis is presented. This method is designed to improve network performance which in turn is indicated by the aforementioned key network parameters. After detailing the method itself the generation and assessment of all results are explained.

3.4.1 Closed-loop schedule adjustment

A global cost function is generated to summarise and combine all eight costs that were derived from the key network parameters, and that were defined in Equations 3.1, 3.5, 3.8, 3.9, 3.10, 3.11, 3.12, and 3.13. This cost function is defined as follows:

$$\begin{aligned}
\zeta(\mathbf{v}_{ss}(t), \mathbf{v}_{\text{ESMU}}(t), \mathbf{v}_{\text{load}}(t), \mathbf{s}_{ss}(t), \mathbf{i}_{ss}(t), \mathbf{i}_{\text{line}}(t), s_{\text{losses}}(t), \boldsymbol{\alpha}) := \\
\alpha_1 \sum_{\phi=1}^{\Phi} \zeta_{\text{voltage}}(v_{ss,\phi}(t)) + \alpha_2 \sum_{\phi=1}^{\Phi} \zeta_{\text{voltage}}(v_{\text{ESMU},\phi}(t)) + \alpha_3 \zeta_{\text{load voltage}}(\mathbf{v}_{\text{load}}(t)) \\
+ \alpha_4 \zeta_{\text{unbalance}}(\mathbf{s}_{ss}(t)) + \alpha_5 \zeta_{\text{PF}}(\mathbf{s}_{ss}(t)) + \alpha_6 \zeta_{\text{neutral load}}(\mathbf{s}_{ss}(t)) \\
+ \alpha_7 \zeta_{\text{fuse utilisation}}(\mathbf{i}_{ss}(t)) + \alpha_8 \zeta_{\text{line utilisation}}(\mathbf{i}_{\text{line}}(t)) + \alpha_9 \zeta_{\text{losses}}(s_{\text{losses}}(t)) \\
\text{where } \phi \in \{1, \dots, \Phi\} \text{ and } \Phi \in \mathbb{Z}_{>0} \\
\text{and } \boldsymbol{\alpha} = \{\alpha_1, \dots, \alpha_9\} \text{ and } \alpha_n \in \{0, 1\} \quad (3.27)
\end{aligned}$$

Here, $\boldsymbol{\alpha}$ is a binary choice vector with which the weight of the global cost function can easily be adjusted. In other words, this vector allows the global cost to target any specific key network improvement which is based on a specific cost. To simplify the notation, and since all key network parameters are outputs of the power flow simulations and not directly adjustable, the global cost function is shortened to $\zeta(\boldsymbol{\alpha})$.

The underlying method that performs the proposed closed-loop optimisation is shown in Figure 3.11. For each time-slot, t , the pre-scheduled ESMU power vector, $\mathbf{s}_{\text{ESMU}}(t)$, is extracted and adjusted by an offset vector, $\delta \mathbf{s}_{\text{ESMU}}(t)$. An optimal offset vector is found through iterative optimisation to minimise the global cost function, $\zeta(\boldsymbol{\alpha})$. This minimisation is achieved by repetitively running power flow simulations of the IEEE distribution feeder and adjusting $\delta \mathbf{s}_{\text{ESMU}}(t)$. Once the adjusted ESMU schedule (i.e. $\mathbf{s}_{\text{ESMU}}(t) + \delta \mathbf{s}_{\text{ESMU}}(t)$) has converged and a solution has been found, then the closed-loop optimisation process terminates and the simulation begins op-

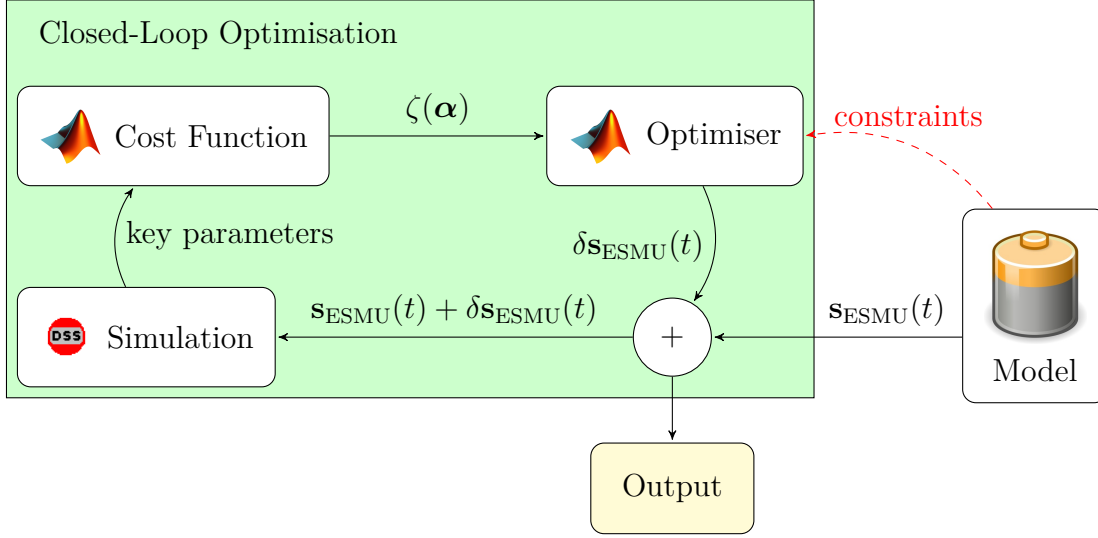


Figure 3.11: ESMU schedule adjustment flow diagram

timising the next time slot (i.e. $t + \Delta t$). One additional constraint is defined since $\delta \mathbf{s}_{\text{ESMU}}(t)$ must not impact the underlying half-hourly ESMU schedule. This constraint assures that the sum of all phase powers in the adjustment vector equates to zero; hence keeping the internal battery's charging-discharge power the same. Including the previously mentioned battery system constraints which ensure that the ESMU operates within its technical limitations, the minimisation problem for the closed-loop optimisation mechanism is formulated as follows:

$$\min_{\delta \mathbf{s}_{\text{ESMU}}(t)} \zeta(\boldsymbol{\alpha}) \text{ s.t. } \begin{cases} \sum_{\phi=1}^{\Phi} \text{Re}(s_{\text{ESMU},\phi}(t)) = 0 \\ p_{\text{bat}}(t) \leq C_f \times C_{\text{bat}} \\ |s_{\text{ESMU},\phi}(t)| \leq S_{\text{rating}} \forall \phi \\ 0 \leq \text{SOC}(t) \leq 1 \end{cases} \quad (3.28)$$

where $\mathbf{s}_{\text{ESMU}}(t) = (s_{\text{ESMU},\phi}(t))$ and $\Phi \in \mathbb{Z}_{>0}$

3.4.2 Execution and result assessment procedure

Being able to focus the global cost function in Equation 3.27 on improving a particular key network parameter by adjusting the binary choice vector α , and after having established how the closed-loop optimising method aims to achieve these improvements, the performance assessment procedure is introduced. The complete evaluation procedure and assessment is summarised in Figure 3.12.

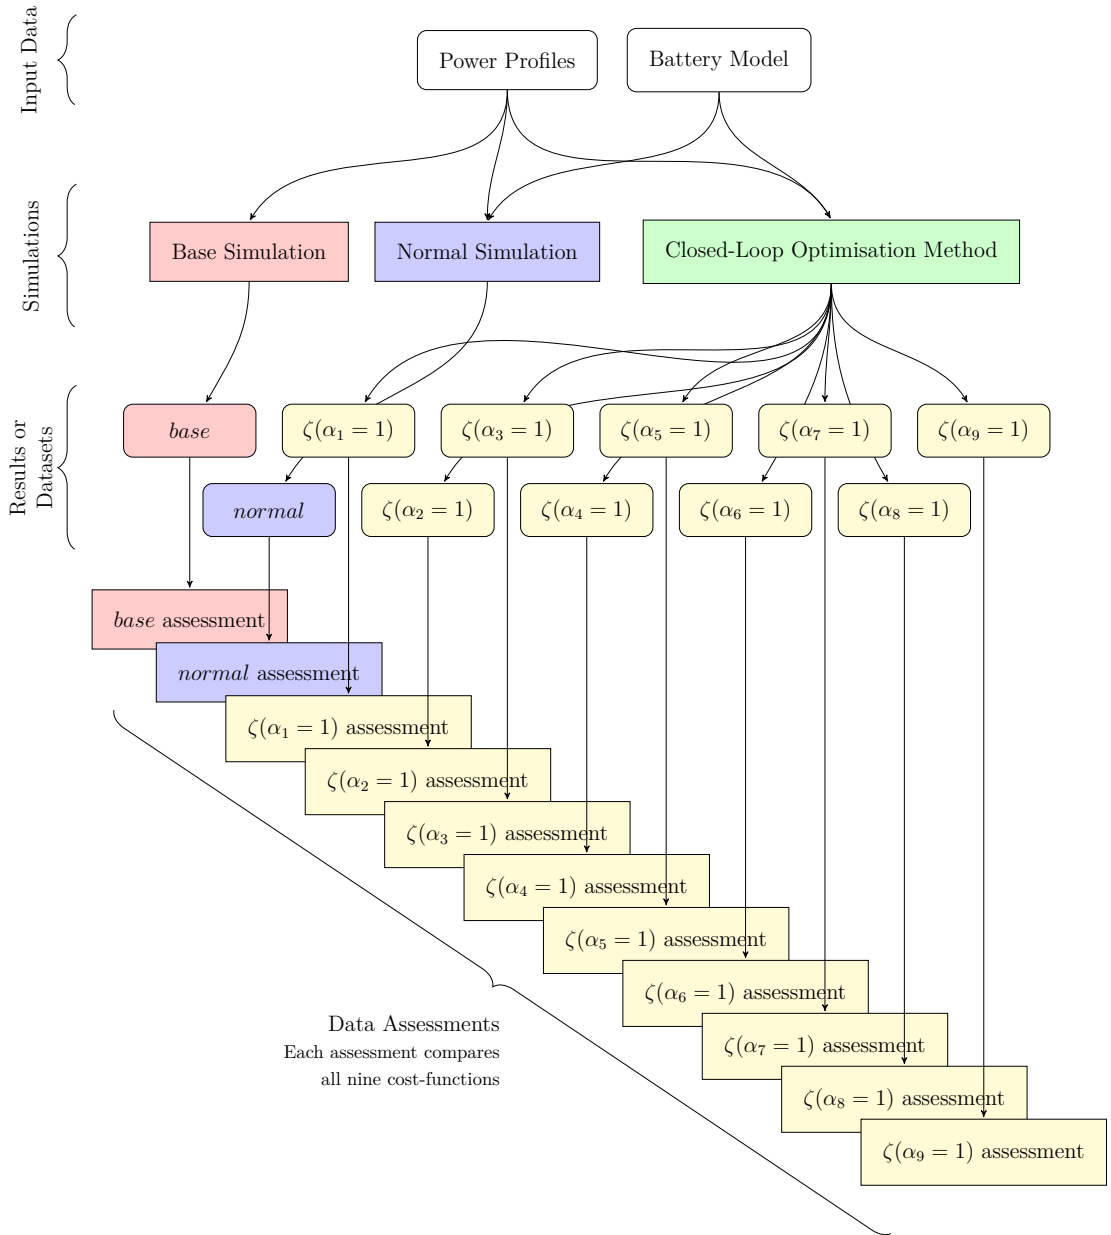


Figure 3.12: Method execution and results assessment flowchart

Since the global cost function can be focused in nine distinct ways using α , eleven datasets of simulation results can be assessed and compared. These additional two results are obtained from a *base* simulation and a *normal* simulation (and nine cost driven i.e. *optimisation* simulations). For the *base* simulation the outcome is generated by applying just the daily power profiles without any ESMU intervention. Therefore this case represents the baseline of network performance which should be improved by any ESMU intervention. The *normal* simulation is the simplest of all ESMU interventions since the ESMU executes its normal (or traditional) half-hourly schedule without any additional modifications. Comparing results from the *base* and *normal* simulations will show the direct impact of the traditional ESMU operation on network performance. The remaining nine datasets are results of the nine different cost driven simulations where the ESMU schedule is adjusted on a sub-half-hourly level for each simulation. This adjustment is designed to minimise one underlying cost-function, whilst conforming to the ESMU's overall half-hourly charging and discharging profile. In order to treat each cost-function separately α is set to focus on each cost independently, for example by setting $\alpha_1 = 1$ and $\alpha_2 = \alpha_3 = \dots = \alpha_9 = 0$. For simplicity the flowchart in Figure 3.12 abbreviates the specific cost choice by only indicating which entry in the α vector is set to 1, for example $\zeta(\alpha_1 = 1)$.

Once all eleven simulations have completed their corresponding datasets are assessed in an identical manner so that their impact on network performance can be compared. This comparison is broken into three parts for all dataset:

1. **Time Series Analysis** - The underlying profiles are plotted and compared against their respective counterpart cases in order to link the immediate network impacts to their physical meaning. Here the used performance metric is the cost that is calculated from the simulation specific cost function. For the same profiles their corresponding cost profiles are calculated and plotted in the results section. This is done to highlight how the profiles are interpreted by the cost-

functions in terms of improvement (i.e. lower cost) or worsening (i.e. increased cost).

2. **Difference Analysis** - The difference in cost profiles compared to the respective *base* or *normal* case is calculated and boxplots of these differences are presented in the results section to show the statistical spread of improvements or worsening. For these plots a generally positive boxplot indicates a general improvement of the underlying network parameters whilst a generally negative boxplot does indicate worse performance in regards to the underlying network parameters.
3. **Probability Density Analysis** - A set of Probability Density Functions (PDF) is derived for each cost profile using the well established and standardised kernel density estimation. These PDFs indicate the probability that a certain cost value occurs. An improvement is noted when the PDF is shifted towards the lower cost values, whereas a shift towards higher cost values worsened the network performance.

The above cost function is however limited to target each individual cost separately since α is a binary choice vector. As discussed in the future work in Chapter 7.4 a multi-objective problem is considered as a next step where costs are weighted against each other. After all, the difference of importance of each cost that DNOs care about can then be reflected accordingly.


3.5 Results and Discussion

In this section all results are presented and discussed. Each of the three assessments in this section focuses on improvements in voltage level, improvements in network efficiency (i.e. power quality and network losses) and improvements in resource utilisation. Hence only a subset of all relevant results is included in each subsection, but


the complete set of results has been appended to this Thesis in Appendix A.1. Data is used and collected in this section as per Section 3.3.1.

3.5.1 Time Series Analysis

The ESMU's largest impact on network voltage levels can be noticed at the ESMU's PCC. Consequently any adjustments to the ESMU powers should become noticeable. This impact can clearly be observed in Figure 3.13.

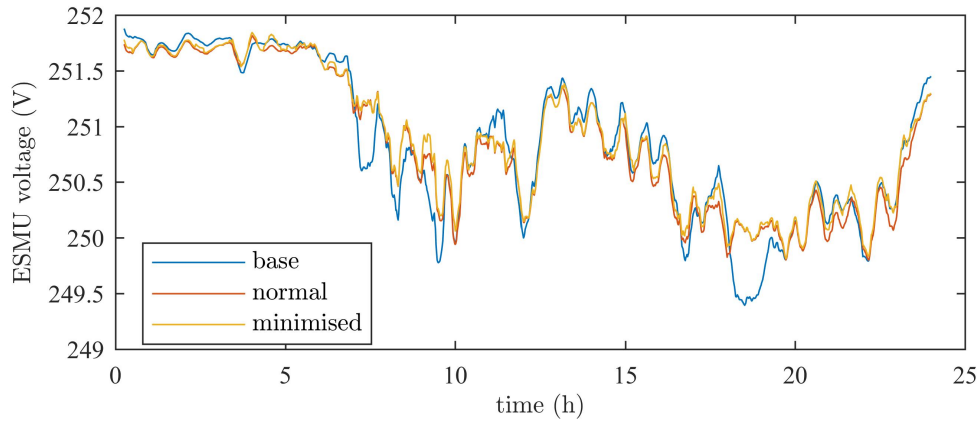

(a) Voltage levels at ESMU's PCC when minimising its voltage deviation (nominal substation voltage is 252V)

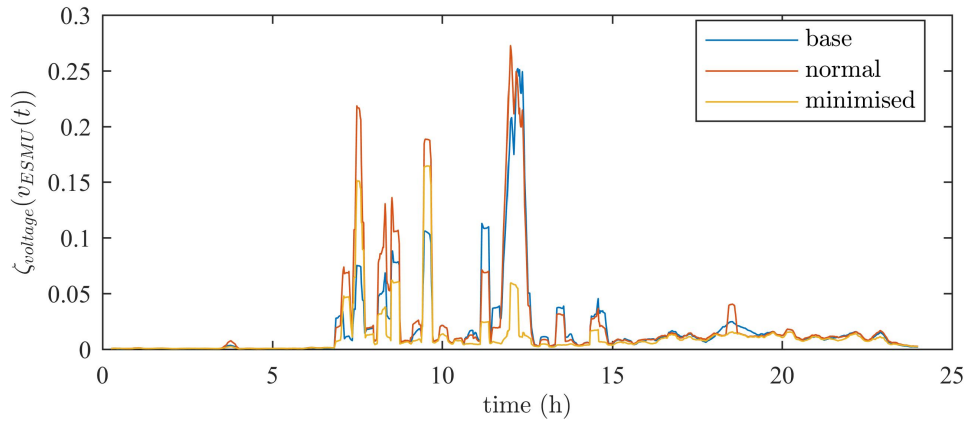

(b) Cost associated with the minimisation of the ESMU's PCC voltage deviation


Figure 3.13: Voltage level modifications as noted at the ESMU's PCC by adjusting its schedule

In this figure the *base* and *normal* case's voltage profiles are plotted alongside


the *minimisation* case for which voltage deviation is minimised. The plot shows that during the night's light load (i.e. from 0:00 to 6:00) ESMU was able to boost its voltage towards the nominal feeder voltage. This is also the case during the lighter load in the afternoon (i.e. between 12:00-14:00). But during the rest of the day when network load increases, the ESMU is unable to reduce voltage deviation to match its PCC voltage with the network's nominal substation voltage. The reason behind this behaviour is that the ESMU has allocated its resources to serve for the underlying half-hourly ESMU schedule. Therefore the remaining resources that could provide voltage support during periods of low demand become limited during periods of high demand. Combined with the fact that the LV distribution networks are more resistive than inductive (i.e. unlike HV transmission networks), adjustments using the ESMU's reactive powers to stabilise voltage levels has an even smaller impact. Nonetheless, due to some continuous yet small availability of power resource ESMU is able to boost voltages to some extent at all times. In Figure 3.13b this can be seen since the associated cost has always been reduced in comparison to the *base* and *normal* cases.

The ability to support voltage levels at the ESMU's PCC is interesting, yet supporting voltage levels at all buses throughout the network is more relevant since some of these buses are linked to customers for which it is essential to maintain a constant voltage level. Therefore, the following results assess both the highest and lowest voltage level that is recorded throughout the network.

In Figure 3.14a, despite no voltage violations taking place due to the already boosted substation voltage, the ESMU's positive impact can be observed. Here the difference between highest and lowest bus voltage of the network is indicated by two lines of the same colour. It is this difference that is noticeably reduced and their average voltage is brought closer to a nominal voltage level. The ESMU's function to support the network in providing more stable voltage levels at customer endpoints is

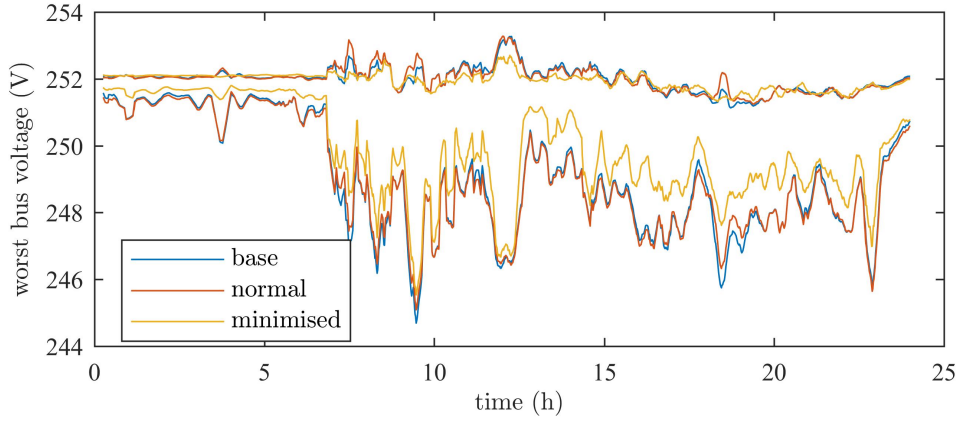


(a) Highest and lowest voltage levels that were recorded throughout the network when minimising the worst voltage deviation (nominal substation voltage is 252V)

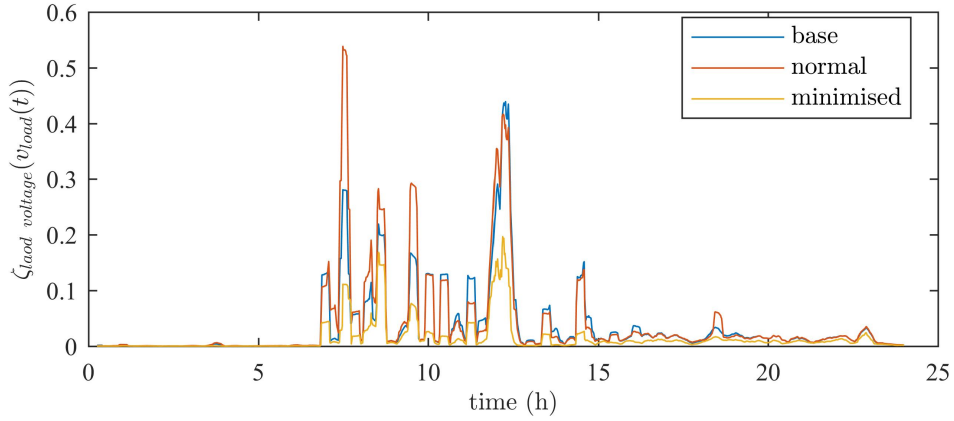


(b) Cost associated with the worst voltage deviation throughout the entire network

Figure 3.14: Voltage level improvements at all buses in the entire distribution network due to the ESMU schedule adjustment.

therefore met. This fact is also supported by the associated cost plot in Figure 3.14b where a reduction in cost can be observed throughout the entire simulated day.

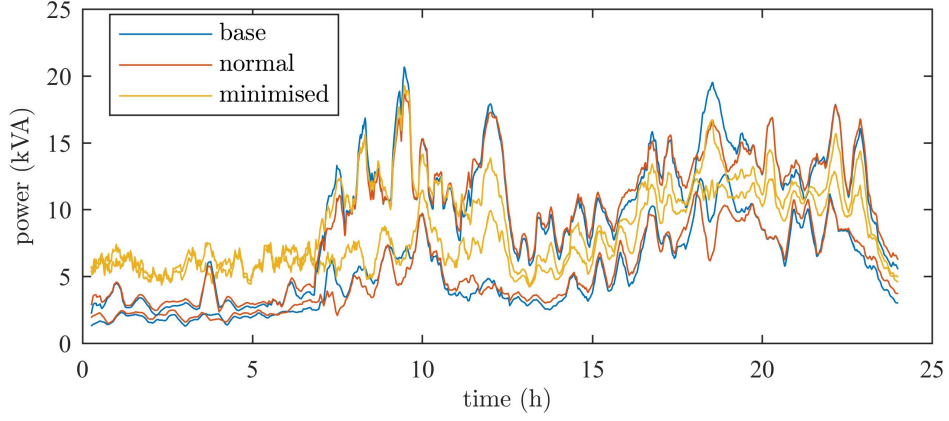

(a) Network's highest and lowest phase power demand when phase unbalance was minimised

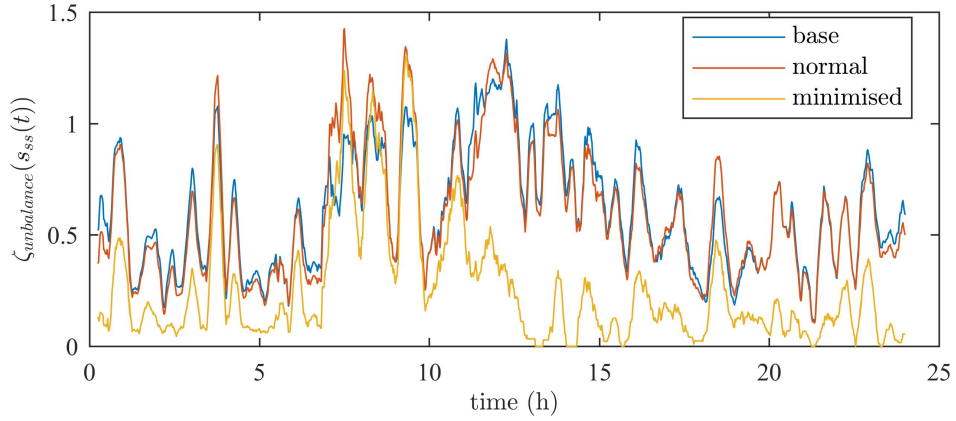

(b) Cost associated with the network's phase unbalance

Figure 3.15: Reduction of the network's phase unbalance due to the adjustment of the ESMU schedule.

Beside providing stable voltage levels, power quality should also be upheld to assure that distribution networks operate as efficient as possible. The first power related parameter that indicates network efficiency is phase unbalance. In Figure 3.15a the power value of the highest and lowest loaded corresponding phases is plotted over time. At all times the sub-half-hourly adjustments of the ESMU's schedule did reduce the underlying phase imbalance. This was achieved by redistributing power from the most loaded phase to the least loaded phases; hence utilising the unused capacity

of the lighter loaded phases. As expected, the associated cost has been noticeably lowered in comparison to the *base* and *normal* cases. It should however be noted that phase balancing during the morning hours is predominantly achieved by using reactive power injection and absorption. This can be seen by the similar yet increased phase loadings between 0:00 and 7:00. Therefore the tradeoff between adding additional strain onto the network versus balancing phases has to be taken into account. One such strain that is being put onto the network is increased neutral power flow due to phasor misalignment.

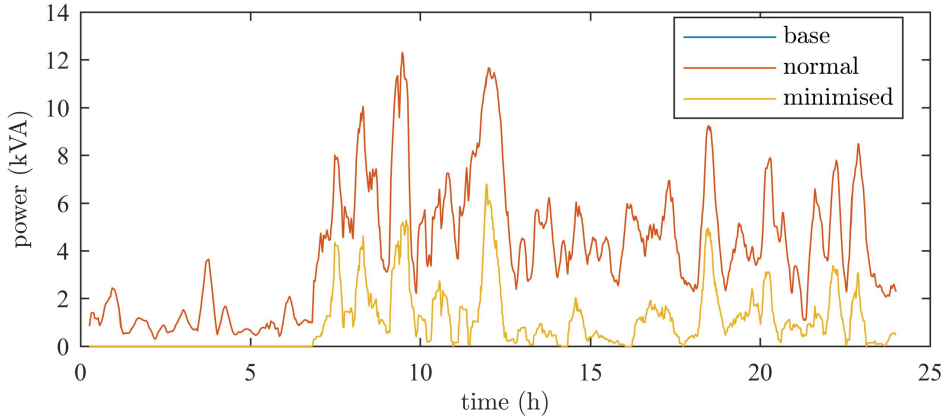


Figure 3.16: Neutral power reduction due to the ESMU schedule adjustments

For the results that are plotted in Figure 3.16, neutral power flow is minimised through the adjustment of ESMU powers. It can be seen that for the *normal* case neutral power is not affected at all. Reason for this result is the choice of evenly assigning the scheduled ESMU power to all three phases. Therefore neither phase unbalance nor loading of the neutral conductor is being taken into account. For the *minimisation* case however, loading of the neutral conductor is successfully reduced in comparison to both the *normal* and *base* case.

Unlike neutral phase unbalance and neutral loading, power factor on the other hand is impacted just by introducing the half-hourly ESMU schedule as shown in Figure 3.17. Whilst the choice of a static power factor for all loads in the *base* case

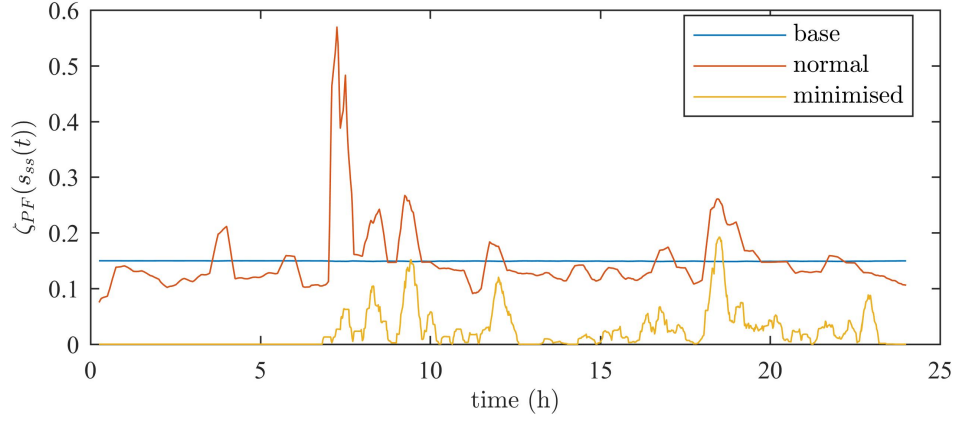


Figure 3.17: Power factor cost improvements due to the adjustment of the ESMU schedule

resulted in a constant power throughout the day, half-hourly ESMU intervention in the *normal* case results in a noticeable power factor variation. This variation is however successfully reduced throughout the entire day for the *minimisation* case in comparison to the *normal* case.

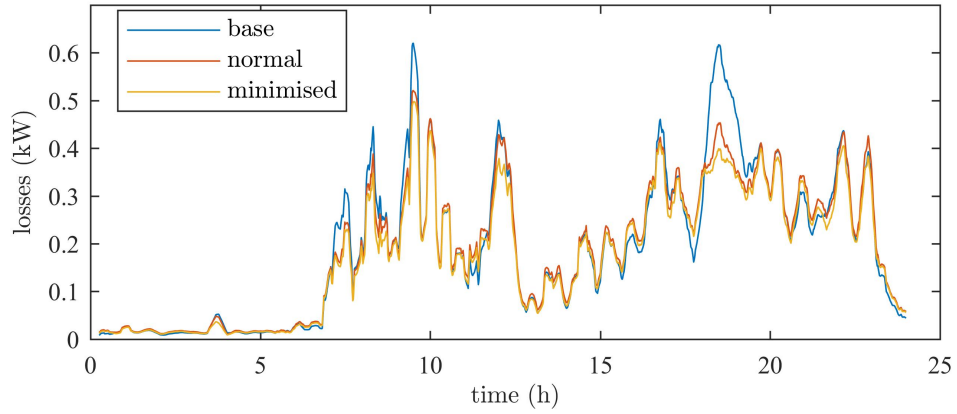


Figure 3.18: Instantaneous losses of the distribution network when adjusting the ESMU schedule in order to reduce the former (energy lost: 4.55kWh for base; 4.47kWh for normal; 4.19kWh for minimised).

The final parameter that indicates system efficiency are the distribution losses. Figure 3.18 shows the reduction in distribution losses that were achieved when adjusting the ESMU powers accordingly. In fact, when compared to the *base* case, the *normal* case lead to a daily energy saving of 0.07kWh. The *minimised* case however

reduced daily losses by 0.36kWh. This equates to more than five times the energy saving achieved, simply by adjusting the ESMU's power injection and absorption behaviour. Although this amount of energy seems negligibly small these saving can amount to a noticeable level of savings on a national scale which can potentially benefit the entire power network. Nonetheless, measuring losses is difficult and costly which is why attempting to do so will likely outweigh the benefits that are shown above.

Instead, a better way of relieving stress from the power network is to minimise its assets utilisation by mitigating demand spikes that were taken into account in Equation 3.26. However, since the ESMU was constraint to not deviate from its underlying half-hourly schedule only phase related demand differences can be addressed and the impact of correcting those phase differences is barely noticeable. This limitation can be seen in Figure 3.19.

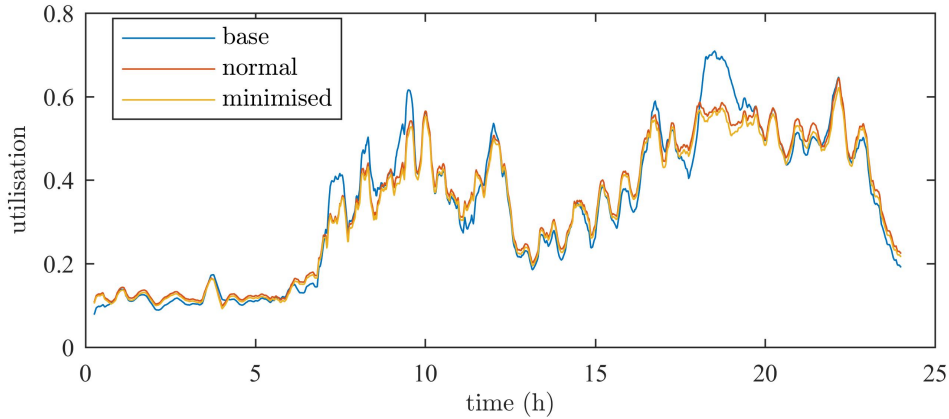


Figure 3.19: Improvement of the worst line utilisation across the entire network when adjusting the ESMU schedule correspondingly.

Whilst the *normal* case noticeably lowered some of the daily demand, power spikes after for example 9pm were not addressed at all. Even the *minimisation* case could barely reduce those spikes due to the constraining half-hourly schedule. Nonetheless, throughout the entire day ESMU was still able to reduce line utilisation at the sub-station level; despite those improvements being relatively small in comparison to the

impact in the *normal* case.

3.5.2 Difference Analysis

In order to gauge whether the sub-half-hourly ESMU power adjustment results in a statistical difference in network performance, a box-plot was generated to compare each *minimisation* with the corresponding *normal* case. Hence, the underlying data for each box-plot represents the difference between the *minimisation* case's costs and the *normal* case's costs, i.e. when operating without adjusting ESMU powers. Therefore any positive difference in cost indicates an improvement to the system's performance whilst a negative difference would imply a worsening. All cases are compared and plotted in Figure 3.20, and the complete set of box-plots (i.e. showing the “cross-cost difference”) is included in Appendix A.1.2. On each of these box-plots, the central red mark indicates the median, and the bottom and top edges of the blue box indicate the 25th and 75th percentiles, respectively. The whiskers extend to the most extreme data points not considered outliers, and the outliers are plotted individually using the red '+' symbol. In Figure 3.20 an individual axis, scaled at 10:1, is used for indicating the cost of neutral power to better visualise its distribution.

This figure shows how the reduction in cost (defined in Equation 3.27) is distributed. In this case the cost reduction (i.e. $-\delta\zeta(\boldsymbol{\alpha})$) is the change in cost from the *normal* ESMU operation case to *minimisation* operation cases, for “phase unbalance” $\delta\zeta(\boldsymbol{\alpha}) = \zeta(\alpha_1 = 1) - \zeta(\alpha_6 = 1)$. Due to the different scales however, the improvements are difficult to observe. Therefore, this cost reduction has been normalised in regards to the *normal* ESMU operation case and is replotted in Figure 3.21.

In this figure it can be seen that the most significant cost related impact on the network is yielded when improving voltage deviation, phase unbalance and power factor costs. Reason for this noticeably larger impact is due to ESMU being able to assign its scheduled active power to all three phases in an optimal manner as long

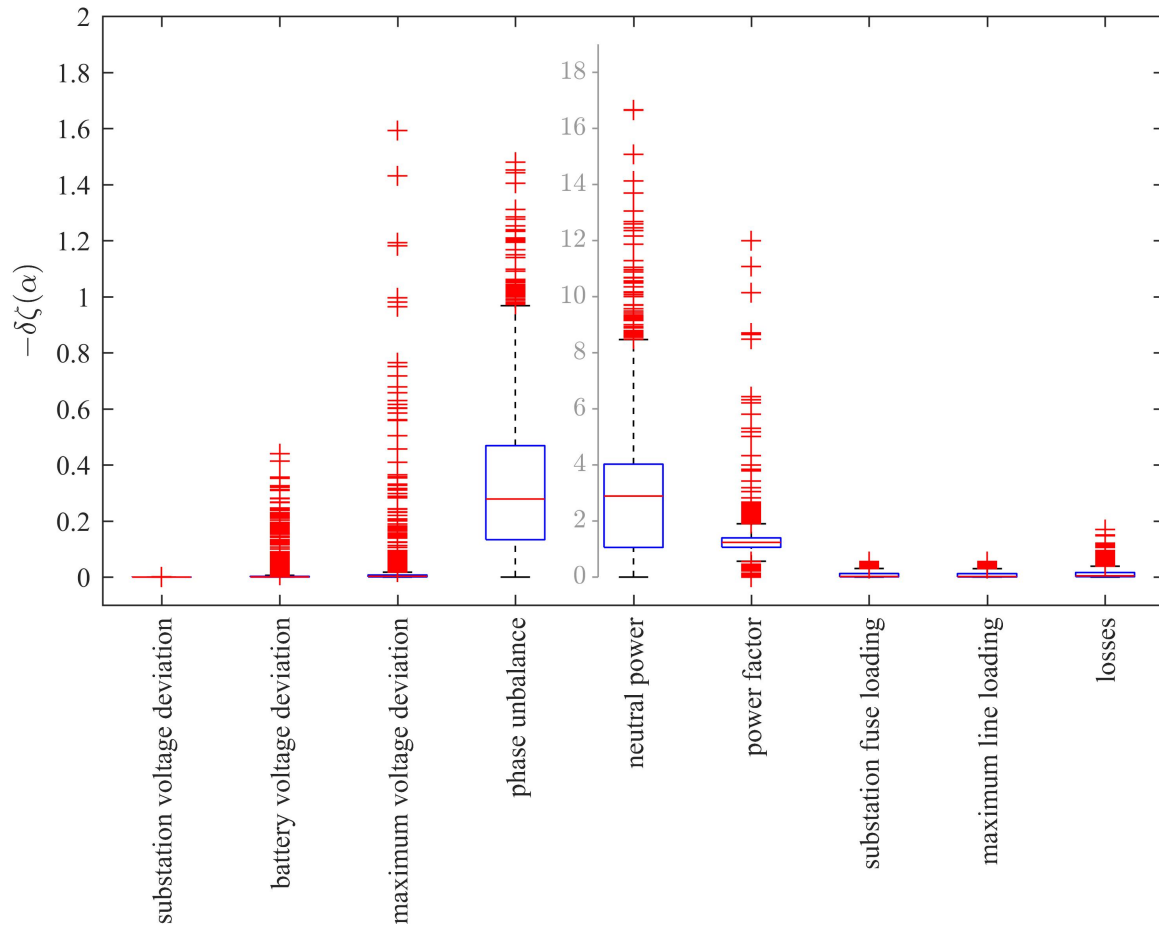


Figure 3.20: Cost improvement spread, when comparing against the *normal* ESMU operation case and when optimising for the underlying cost (a separate y-axis is introduced for the optimisation of “neutral power”).

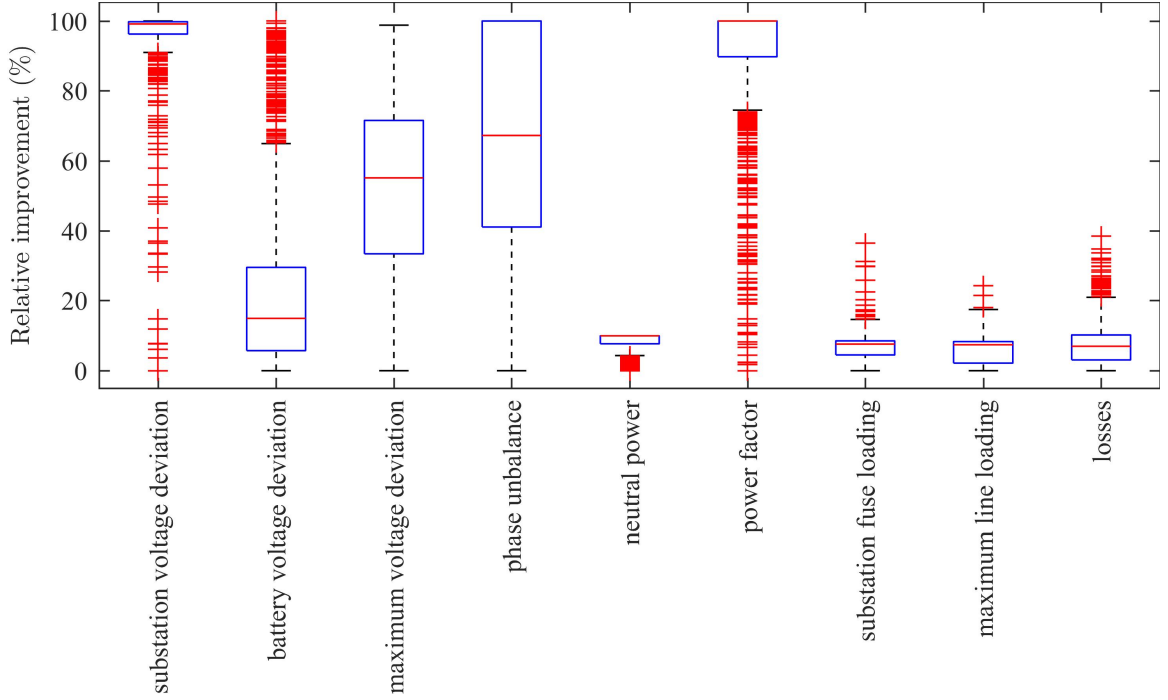


Figure 3.21: Relative cost improvement spread, when comparing against the *normal* ESMU operation case and when optimising for the underlying cost.

as the predetermined half-hourly schedule is obeyed. It is this obedience constraint that limits the extend by which all other key network parameters can be impacted. Reactive power on the other hand is only indirectly constrained by the ESMU schedule. The only limit that applies to the ESMU's reactive power injection capabilities is the remaining PMU capacity after committing to the scheduled active power. Also, unlike active power, reactive power has a smaller impact on the LV network due to its physical property (i.e. being more resistive than inductive). Nonetheless, when each key network parameters became subject to their corresponding cost minimisation all of them were impacted positively.

In addition to the box-plots, the cost improvements (whose box-plots are presented in the Appendix A.1.2), are calculated and tabulated in Table 3.1. This table shows the cumulative difference in $-\delta\zeta(\boldsymbol{\alpha})$ between the *normal* case and the *minimisation* case, i.e. where $\delta\zeta(\boldsymbol{\alpha}) = \zeta(\alpha_1 = 1) - \zeta(\alpha_2 = 1)$. However, instead of only presenting the cost reduction that is yielded when minimising it this table also includes all other

resulting costs, i.e. the daily aggregated cost to be precise. This value is defined as the “cumulative cost difference”, i.e. $\sum_t \delta\zeta(\boldsymbol{\alpha})$. In addition to the comparison between *minimisation* and *normal* cases, the *normal* case is compared to the *base* case for reference. For convenience all positive cost reductions (i.e. network improvements) have been highlighted.

As expected all entries along the diagonal are positive in cross-cost difference, i.e. where the evaluated cost is also the cost that was minimised. But beside this fact one can also observe which cost minimisation has an impact on different costs. For example, adjusting the ESMU schedule to achieve the largest reduction in distribution losses (i.e. far right column) improves nearly all key network parameters apart from substation voltage deviation. Furthermore, Table 3.1 indicates that reducing battery voltage deviation, maximum voltage deviation, phase unbalance and neutral power (respectively, columns 3, 4, 5 and 6) have a noticeable impact on each other. Minimising any of these four costs does however not impact power factor, loading and losses (apart from reducing battery voltage deviation).

Although the impact on network improvements for some costs is easily determined and explained with the underlying physical properties of distribution systems, other impacts of minimising cost do not share this transparency. For example, minimising power factor (column 7) has a greater impact on reducing line loadings than directly minimising substation or maximum line loading (column 8 and 9, respectively). The reason behind this effect is due to instantaneous apparent power contributing to the line current. This means that maximising the network’s power factor minimises reactive load which in turn lowers the total line current. Since the solving algorithm does not know which cost to minimise first, the task of finding a global minimum becomes more difficult. To improve the performance of adjusting ESMU powers one could propose to concatenate several cost minimisation procedures in a sequential series. Doing so would focus the search for global minima for each iteration of the

	normal	minimisation cases										losses
		substation voltage deviation	battery voltage deviation	maximum voltage deviation	phase unbalance	neutral power	power factor	substation fuse loading	maximum line loading			
substation voltage deviation	0.00	0.08	-2.49	-1.39	-4.89	-8.72	0.04	0.00	0.01			-1.09
battery voltage deviation	-5.01	-0.40	15.52	17.04	9.14	14.93	-2.85	-0.43	-1.62			13.69
maximum voltage deviation	-6.83	-1.15	28.22	36.42	24.66	33.05	-3.07	-0.56	-2.57			25.44
phase unbalance	12.15	40.93	284.87	380.57	490.22	351.35	40.66	10.02	5.03			441.24
neutral power	-0.83	-96.72	2303.70	1642.37	2698.78	4415.85	319.23	133.46	53.53			2401.12
power factor	-0.27	159.42	-7.63	-37.25	-633.30	-314.11	183.01	145.35	136.87			88.84
substation fuse loading	5.14	13.34	-0.43	-8.69	-51.76	-72.68	14.37	10.98	10.91			5.64
maximum line loading	4.53	12.88	-6.17	-10.04	-80.41	-97.30	13.89	10.69	10.94			4.72
losses	4.34	7.22	13.38	-4.46	-46.37	-66.32	12.89	9.65	9.02			17.13

Table 3.1: Cross-cost improvements due to adjustments to the original ESMU schedule.

sequence, yet this lies outside the scope of this Thesis and can be continued in future research.

3.5.3 Probability Density Analysis

The final part of analysing the results is to determine whether the cumulative cross-cost differences are statistically significant. To do so, the probability density functions (PDF) of the cross-cost differences is analysed using a null hypothesis test. The underlying data is conditioned in order to meet all prerequisites that are necessary to perform the null hypothesis test, like the standard t -test. These prerequisites include stationarity, low auto-correlation and high gaussianity of the underlying time-series. The procedure to meet these prerequisites is carried out without falsifying the data which means that all applied conditioning operations were restricted to time-series division and linear transformation. Details on the exact data conditioning steps are outside the scope of this chapter, but for completeness they are included in Appendix A.1.3.

Table 3.2 presents the results from this analysis, where p -values have been tabulated and those cells with a value below 0.05 have been highlighted. A similar pattern to that in the previous table can be seen (i.e. Table 3.1). In this table however, instead of just comparing cross-cost reductions, statistical indications to support the significance of the findings is presented. In combination with the preceding table one can therefore determine that the impact of optimising operation based on maximum voltage deviation has little to no significant impact on improvements in power factor whilst adjusting ESMU powers to improve the network's power factor has the most significant statistical impact on the chosen key network parameters.

		minimisation cases									
normal		substation voltage deviation	battery voltage deviation	maximum voltage deviation	phase unbalance	neutral power	power factor	substation fuse loading	maximum line loading	losses	
	substation voltage deviation	0.851	< 0.001	0.999	1.000	0.999	< 0.001	< 0.001	< 0.001	0.999	
	battery voltage deviation	0.899	< 0.001	< 0.001	< 0.001	< 0.001	0.022	0.018	0.325	< 0.001	
	maximum voltage deviation	0.718	< 0.001	< 0.001	< 0.001	< 0.001	0.086	0.167	0.772	< 0.001	
	phase unbalance	0.331	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001	0.038	< 0.001	
	neutral power	0.940	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.016	< 0.001	
	power factor	0.488	< 0.001	0.999	0.999	1.000	< 0.001	< 0.001	< 0.001	< 0.001	
	substation fuse loading	0.777	< 0.001	0.999	0.999	1.000	< 0.001	< 0.001	< 0.001	0.001	
	maximum line loading	0.846	< 0.001	0.999	0.999	0.999	< 0.001	< 0.001	< 0.001	0.102	
	losses	0.881	< 0.001	< 0.001	0.637	0.910	< 0.001	< 0.001	< 0.001	< 0.001	

Table 3.2: p -values for statistical evidence of cross-cost improvements based on statistical two-sample single-tailed t -test.

3.6 Summary

In this chapter, a method to adjust three-phase ESMU powers on a sub-half-hourly basis to support network operation whilst following a pre-determined half-hourly schedule is proposed and tested. The ESMU schedule is tailored to result in a “peak-shaving” and “valley-filling” behaviour and uses a realistic ESMU model to meet any operational constraints. A set of key network parameters to indicate the performance of the network was used for the development of a corresponding set of cost functions. By adjusting the ESMU’s active and reactive powers, each cost could be minimised and therefore network operation was improved.

Results therefore indicate that when explicitly focusing on the improvement of certain key network parameters then the derived cost reduces for every single case. The scale by which the cost was reduced and network performance was improved became apparent for the time-series assessments in Section 3.5.1 since 5kWh of energy was saved (instead of only 1.2kWh) when explicitly focusing on reducing the cost that is tied to distribution losses. It was found that during periods of low demand and low ESMU powers (i.e. before 7am), reactive power injection provided the largest benefits. Active power that is dictated by the underlying ESMU schedule did however provide peak reduction and thermal constraint functions for the remaining time of the day (i.e. after 7am). Nonetheless, any cost minimisation always had an effect on different costs since loss minimisation positively impacted nearly all other costs.

Using cumulative cross-cost differences in Section 3.5.2 it was shown that a net cost reduction was achieved simply by implementing the proposed ESMU power adjustment method on top of the normal execution of a half-hourly schedule. Although the amount by which different costs reduce is not as large as the amount for the cost that was presently focused on, all costs did experience some kind of cross-cost impact. For example, when optimising for distribution losses then substation voltages, power factor, line loadings and the ESMU’s voltages were also improved. Since the units

of this assessment were however cost specific, a true assessment of the correlation between costs could be performed.

Therefore, Section 3.5.3 focused on the statistical sensitivity of the cost reduction to attempt such an assessment. Using the two-paired t -test the aforementioned fact that costs do indeed impact each other is supported. Hence there is strong evidence (i.e. $p \leq 0.05$) that those power adjustments do have a positive impact on the distribution network's operation. The strength of this impact can be used when trying to impact theoretical key network parameters in reality (i.e. when only realistic key network parameters can be observed). From these lessons learnt one can conclude that the first objective of this thesis which is outlined in Section 1.2 has been met.

The main limitation of the proposed method is however the battery's half-hourly schedule. It dictates the active power that has to be injected into or absorbed from the distribution network. Also, this schedule inadvertently dictates the remaining overhead in reactive power that can be compensated on each phase. Therefore, the next chapter in this thesis presents a method of dynamically adjusting this scheduled power profile in real-time without violating any physical constraints.

Chapter 4

Real-Time Adjustment of Battery Operation using MPC Guided Schedule Deviation

4.1 Overview

In the preceding chapter, Chapter 3, an Energy Storage Management Unit (ESMU) is used to improve network operation. This improvement is achieved by optimally adjusting the device's scheduled three-phase powers at sub-half-hourly resolution. Any improvement is indicated by a cost reduction where the underlying cost functions are tied to changes in key network parameters. The extent to which ESMU is able to improve network operation was then shown by focusing on the minimisation of different cost functions and repetitively optimising and simulating the distribution network. However, this network improvement was limited by the constraint of having to obey the underlying half-hourly ESMU schedule despite applying adjustments at a sub-half-hourly level.

In this chapter, research **Objective 2** is addressed (i.e. to develop a control

method that dynamically adjusts half-hourly BESS schedules on a sub-half-hourly basis in order to reduce daily load peaks by combining control elements from both off-line and on-line control; this was outlined in Section 1.2) by removing these limiting constraint and proposing a corresponding sub-half-hourly ESMU schedule adjustment method. This method unifies the benefits from sub-half-hourly demand measurements and half-hourly demand forecasts. Unlike previous work in the field, the proposed approach reverses the traditional control paradigm to compensate for schedule inaccuracies. Put differently: traditional approaches implemented on-line control mechanisms like Set-Point Control (SPC) in combination with prediction models in order to adjust and prepare ESMU for future load trends. In this chapter however, forecast driven schedules are adjusted using on-line measurements instead of supporting on-line control with real-time load predictions. This adjustment is achieved by first scheduling ESMU operation at half-hourly resolution (i.e. by following a “peak-shaving” and “valley-filling” behaviour which has been explained in Chapter 3) and then modifying this schedule using MPC. In this case, Model Predictive Control (MPC) is comprised of a lightweight Autoregressive (AR) model to assure real-time deployability. These two control signals are unified using two Proportional Integral Derivative (PID) compensators that are tuned to assure system robustness regardless of the forecast’s erroneousousness. All ESMU schedules are generated under the constraints of a realistic ESMU model, and all demand measurements and corresponding forecasts that are used in this work are based on real data that is provided by the project partner and DNO: *Scottish and Southern Energy Networks* (SSEN). Results are generated from this realistic (i.e. provided) network load with their corresponding load forecasts and cases are compared against the original and a baseline load case (i.e. traditional off-line control). It is shown that the proposed schedule adjustment method can successfully reduce sub-half-hourly peaks even under these imperfect forecast conditions. In fact, whilst the probability distribution of the baseline case sat

around an average of 1.78kW peak reduction, the proposed method could increase the reduction to 5.24kW. Since this proposed control method is the natural extension of our previous work in [105], hereon it is also referred to as “dynamic control”.

The chapter is organised as follows: In Section 4.2 all constituent system components including ESMU model, forecast acquisition and ESMU schedule generation are explained. Section 4.3 presents the dynamic control, including the dual PID setup and MPC. Section 4.4 outlines the different case studies that were used to compare the performance of the dynamic control. In Section 4.5 all results from these case studies are presented and discussed. Finally, conclusion and the future work are described in Section 4.6.

4.2 System Explanation

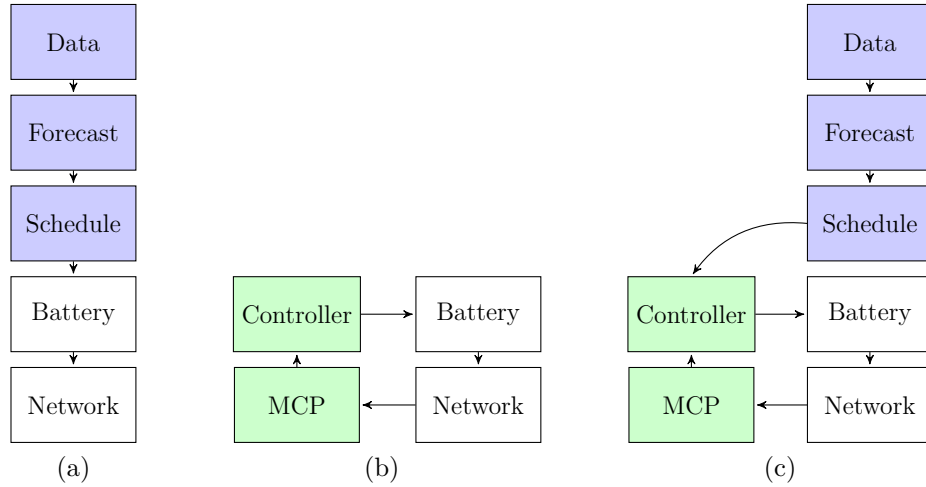


Figure 4.1: (4.1a) Traditional forecast driven BESS control; (4.1b) Traditional on-line system; (4.1c) Proposed dynamic control system

The presented work is part of the *New Thames Valley Vision* (NTVV) research project and was conducted in collaboration with the British DNO *Scottish and Southern Energy Networks* (SSEN) [98]. From the findings of this research project the diagram in Figure 4.1 was generated, showing two well established ESMU control

approaches and the proposed dynamic control approach. This figure includes all constituent systems that were used during the ESMU street-level deployment. The two traditional systems are off-line and on-line ESMU control which are shown in Figure 4.1a and 4.1b, respectively. Alongside these two control approaches is the proposed dynamic control system that is shown in Figure 4.1c. This control approach entails the benefits from both the traditional half-hourly forecast driven and the sub-half-hourly ESMU control system and can therefore be seen as the hybrid of the two traditional systems. Unlike previous work this hybrid system does not rely on Set-Point Control (SPC) which is adjusted by a MPC to compensate for trends in the load profile. Instead, it operates by executing a predetermined half-hourly ESMU schedule which is adjusted at sub-half-hourly intervals. Therefore the necessity of relying on a stable SPC is removed and replaced by a robust schedule execution. Nonetheless, flexibility is provided by allowing the aforementioned schedule adjustments. The preceding work by Rowe et al. in [124] inspired this hybrid system and used a similar approach that emphasises these benefits of using a hybrid system. Unlike the work by Rowe et al. in [124] however, the proposed hybrid system operates at a higher temporal resolution (it uses a light weight deterministic adjustment method in the form of MPC), and it does not rely on a long forecasting horizon since it recomputes the power adjustments for every single time-step. As already mentioned, those adjustments are based on MPC-guided instructions and details about this dynamic control are outlined in Section 4.3.

In this section however the battery model which is used in this work is reminded first. Also the load data acquisition, forecasting and ESMU schedule generation are outlined where scheduling is performed in accordance to the ESMU model’s constraints.

4.2.1 ESMU model

The ESMU model is based on the physical system that was deployed by SSEN during the NTVV project. Since this model is the same model as the one used in the preceding chapter which has been explained in detail in Section 3.3.3, only the model's final equation (as well as all used parameters) are detailed, hence foregoing the re-deriving of the same battery storage model. This ESMU model equation is as follows:

$$SOC(t + \Delta t) = \begin{cases} \mu \left(SOC(t) + \frac{\eta \Delta t p(t)}{C_{bat}(3.6 \times 10^6)} \right) & \text{if } p(t) \geq 0 \\ \mu \left(SOC(t) + \frac{\Delta t p(t)}{\eta C_{bat}(3.6 \times 10^6)} \right) & \text{otherwise} \end{cases} \quad (4.1)$$

Here the next State of Charge, $SOC(t + \Delta t)$, is computed from the current State of Charge, $SOC(t)$, and the current battery power, $p(t)$. This is done by calculating the current change in SOC as the added energy $\Delta t p(t)$, divided by the total battery capacity C_{bat} . Dynamic properties of the model also take into account the energy conversion efficiency, η , and the self-discharge factor, μ .

For the purpose of the simulation, it is assumed that the battery is initially charged up to 50%. Hence, the initial conditions of this model are defined as $SOC(0) = 0.5$, which makes the model valid for a time span of $t \geq 0$, where $t \in \mathbb{Z}_{\geq 0}$.

4.2.2 Load data and ESMU scheduling

Having established the ESMU model, the procedure to generate a corresponding schedule is explained in this subsection. This procedure follows the same practice as outlined in the previous chapter (i.e. in Section 3.3.4) where an ESMU schedule is generated at half-hourly temporal resolution. Therefore the same synchronisation function, $k(t)$, that was used in Section 3.3.4 can be used to link the native minutely sampling period of Δt to the schedule's half-hourly time slots. Since the sub-half-hourly operation was at a minutely period and the generated schedule is at half-hourly

period, this fixed conversion function is defined as:

$$k(t) := \left\lfloor \frac{t-1}{30\Delta t} \right\rfloor + 1 \quad (4.2)$$

Having established a means of synchronising the two sampling periods, the shape of the ESMU schedule that would “smoothen” the underlying power profile is defined next. For simplicity linear forwarding was chosen which means that the power assigned at for instance $t = 1$ remains constant over the scheduling period of $30\Delta t$ until $t = 31$. With this assumption the ESMU’s SOC can be calculated for each t despite the scheduled power profile only having been defined for every 30^{th} t . Furthermore, with this second assumption not only every sub-half-hourly ESMU power can be derived from its half-hourly schedule, but it also enables the calculation of every SOC, i.e. $SOC(t)$ is well defined.

For the generation of the ESMU schedule a load forecast, \mathbf{p}_{for} , was required; here $\mathbf{p}_{\text{for}} = (p_{\text{for}}(k(t)))$. Just like the ESMU forecast this forecast is also produced at half-hourly temporal resolution and it was provided by SSEN as part of the NTVV research project. The task at hand is to find a half-hourly ESMU schedule, \mathbf{p}_{sch} , where $\mathbf{p}_{\text{sch}} = (p_{\text{sch}}(k(t)))$, that improves the shape of the underlying forecast, for example by reducing load peaks. In order to generate this optimised ESMU schedule a performance metric quantifying improvements had to be defined first. The remaining task is to now compute a half-hourly schedule, \mathbf{p}_{sch} , that yields the best performance. This computation is done by minimising several cost-functions.

In Chapter 3 several cost functions were defined. Here however, three shape dependent cost-functions are used that quantify the profile improvements that are yielded by \mathbf{p}_{sch} . These costs entailed the Peak-to-Average Ratio (PAR), the difference between the resulting power profile’s maximum and minimum (MMD) load, and the magnitude of all power transients (TRA) [184, 199]. Although these costs and their benefits have already been presented in Section 3.3.4 of this thesis, they are reminded

for convenience. Before however detailing each of these three cost functions, a notation that simplifies power as, \mathbf{p} , is introduced:

$$p(t) = p_{for}(k(t)) + p_{sch}(k(t)) \quad (4.3)$$

where $\mathbf{p} = (p(t))$

Within this section, the vector \mathbf{p} represents the power profile as it would be measured at the substation when both forecast, $p_{for}(t)$, and scheduled, $p_{sch}(t)$, power were applied. The first cost function that is used in this chapter addresses the minimisation of PAR and is defined as follows:

$$\zeta_{PAR}(\mathbf{p}) := \left(\frac{\max_t |\mathbf{p}|}{\bar{\mathbf{p}}} \right)^2 - 1 \quad (4.4)$$

Here, $\bar{\mathbf{p}}$ represents the mean power, i.e. $\bar{\mathbf{p}} = \frac{\Delta t}{T_{sch}} \sum_{t=1}^{T_{sch}} p(t)$ and $\bar{\mathbf{p}} \in \mathbb{R}$, where T_{sch} is the length of the scheduling horizon in regards to the sampling period Δt . If the profile \mathbf{p} had a lot of spikes then the ratio between its maximum and its mean value is greater than one (or with the -1 term greater than zero). A perfectly flat power profile on the other hand would thus result in cost of zero. However, due to limited battery capacity achieving such a cost of zero is highly unlikely. This is why a solution to minimise this cost needs to be found that minimises this cost in accordance to the previously explained ESMU model. To not only increase the mean power or reduce peak power, the second cost function is defined as the difference between minimum and maximum power of \mathbf{p} :

$$\zeta_{MMD}(\mathbf{p}) := (\max_t(\mathbf{p}) - \min_t(\mathbf{p}))^2 \quad (4.5)$$

Similar to the PAR this cost also reduces to zero when the resulting power profile is perfectly flat. Unlike the PAR however, this cost does not incentivise an increase

of mean power. Minimising PAR by itself results in unnecessary and potentially damaging battery cycling when trying to raise the mean power of the profile, yet this behaviour is avoided when ζ_{MMD} is included alongside ζ_{PAR} . Nonetheless, ζ_{PAR} and ζ_{MMD} only impact the fringes of the resulting half-hourly power profile and could lead to an erratic load profile. Therefore the third and final cost addresses the interim power volatility by aiming to minimise the largest possible power transient:

$$\zeta_{\text{TRA}}(\mathbf{p}) := \max_t (p(t + \Delta t) - p(t))^2 \quad (4.6)$$

Minimising this final cost has a smoothening effect on the improved half-hourly power profile since a profile with no transients is by definition a flat and smooth profile. Since all three cost functions are normalised, they are summaries into a single global cost function. In this cost function only the half-hourly ESMU schedule, \mathbf{p}_{sch} , is used as an input and the forecast, \mathbf{p}_{for} , is kept constant:

$$\begin{aligned} \zeta(\mathbf{p}_{\text{sch}}) := & \zeta_{\text{PAR}}(\mathbf{p}_{\text{sch}} + \mathbf{p}_{\text{for}}) \\ & + \zeta_{\text{MMD}}(\mathbf{p}_{\text{sch}} + \mathbf{p}_{\text{for}}) \\ & + \zeta_{\text{TRA}}(\mathbf{p}_{\text{sch}} + \mathbf{p}_{\text{for}}) \end{aligned} \quad (4.7)$$

Subject to ESMU constraints, this global cost function is minimised using a standard solver (i.e. Sequential Quadratic Programming - SQP) to yield a ESMU schedule that is optimised for the given forecast:

$$\min_{\mathbf{p}_{\text{sch}}} \zeta(\mathbf{p}_{\text{sch}}) \text{ s.t. } \begin{cases} SOC_{\text{tol}} \leq SOC(t) \\ SOC(t) \leq 1 - SOC_{\text{tol}} \\ |p_{\text{bat}}(t)| \leq C_{\text{bat}} \cdot C_f \end{cases} \quad (4.8)$$

In order to limit the control's flexibility a State Of Charge tolerance, SOC_{tol} , is

included in this minimisation problem. SOC_{tol} defines the maximum allowed deviation from the computed SOC profile without hitting operational limits (i.e. SOC of one or zero) and can take values in the form of $SOC_{tol} \in [0, 0.5)$ where 0 implies no tolerance and 0.5 implies complete flexibility as if no schedule were computed. For the work at hand a value of 0.1 was chosen to allow a $\pm 10\%$ energy tolerance band.

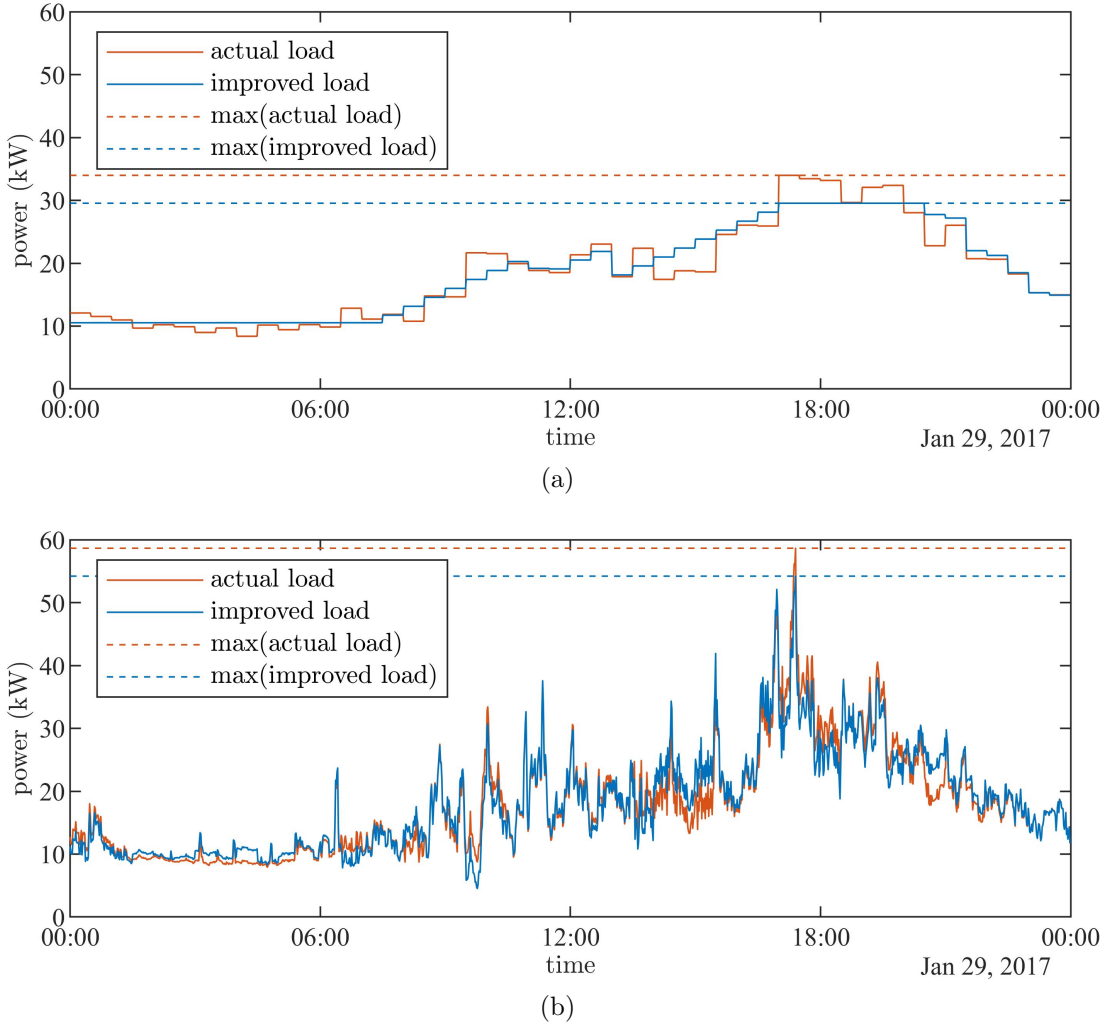


Figure 4.2: An example of applying a half-hourly ESMU schedule to the half-hourly substation load (Subfig. 4.2a) and the actual, sub-half-hourly daily load, measured at the substation (Subfig. 4.2b).

As repetitively mentioned, the ESMU operation that results from this scheduling mechanism is at half-hourly resolution and has therefore limited impact on sub-half-hourly load variation. To visualise this limitation a single day's ESMU schedule was

generated from its corresponding forecast as defined in Equation 4.8 and plotted in Figure 4.2. In this simple comparison the noticeable discrepancy between the half-hourly ESMU schedule and the actual, sub-half-hourly demand can be observed. Furthermore, noticeable disparity in peak duration, magnitude and volatility can be noted. This discrepancy and disparity emphasise the incompatibility issues between half-hourly ESMU schedules and the actual sub-half-hourly load. As previously discussed benefits of ESMU were intended to mitigate sub-half-hourly load volatility, yet this cannot be achieved when solely applying half-hourly ESMU schedules in an off-line manner. Therefore, the control strategy to add an on-line component is explained in the next section.

4.3 Control of ESMU

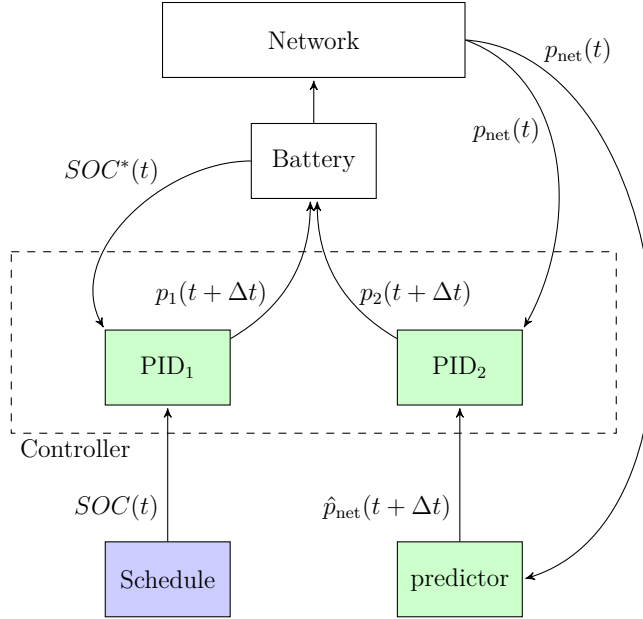


Figure 4.3: Dynamic controller breakdown as previously shown in Figure 4.1c.

This section explains the dynamic control (i.e. the controller block as shown in Figure 4.1c) in the shape of an MPC, containing the two PID compensators to adjust operation around the predetermined ESMU schedule. The first PID compensator is

fed by the ESMU schedule and the other is fed by the predictor load estimations. After the control system is detailed in this section the auto-regressive models which were used during the course of this research are also explained.

4.3.1 Dynamic control

The content of the dynamic control procedure is shown in Figure 4.3. Here two reference signals are used as inputs to the dynamic control. The first reference signal is the SOC profile derived from the ESMU scheduled, $SOC(t)$, and the second is an estimated future network power, $\hat{p}_{\text{net}}(t + \Delta t)$. These two inputs are fed into compensator PID_1 and compensator PID_2 , respectively. The output of each compensator is a corrective battery power component that, when summed, yields the next ESMU power (i.e. $p_1(t + \Delta t)$ and $p_2(t + \Delta t)$) which is applied to the ESMU model. Each PID compensator also receives a feedback signal to compute the internal error states. More specifically, PID_1 receives the most recent SOC value that is obtained from the ESMU model, $SOC^*(t)$, and PID_2 receives the network's most recent power demand, $p_{\text{net}}(t)$ (for example through measurements by substation monitoring).

Inside the PID_1 component a SOC error term, $E_{\text{SOC}}(t)$, is computed. This term is the difference between the scheduled SOC profile, $SOC(t)$, and the actual (or simulated) SOC values, $SOC^*(t)$. The following equation captures this error term.

$$E_{\text{SOC}}(t) := SOC^*(t) - SOC(t) \quad (4.9)$$

Applying a standard and linearly weighted dynamic gain vector, $\boldsymbol{\alpha}$, to the SOC error allows the calculation of a corrective ESMU power component dynamically. Here $\boldsymbol{\alpha} = \{\alpha_P, \alpha_I, \alpha_D\}$ and the components are the P, I and D weights, respectively. How to determine the values of $\boldsymbol{\alpha}$ is explained later in this section. This corrective power is denoted as $p_1(t + \Delta t)$, and is defined as follows:

$$\begin{aligned}
p_1(t + \Delta t) &:= \alpha_P E_{\text{SOC}}(t) \\
&+ \alpha_I \sum_{i=0}^{\infty} E_{\text{SOC}}(t - i\Delta t) \\
&+ \alpha_D \frac{E_{\text{SOC}}(t) - E_{\text{SOC}}(t - \Delta t)}{\Delta t}
\end{aligned} \tag{4.10}$$

Here the integral component removes steady-state error and the instantaneous error differential prevents overshooting. All in all, this compensator uses present and past values to issue a corrective future ESMU instruction. Compensator PID_2 on the other hand uses values from the present, past and future in order to minimise the power transient and load peaks.

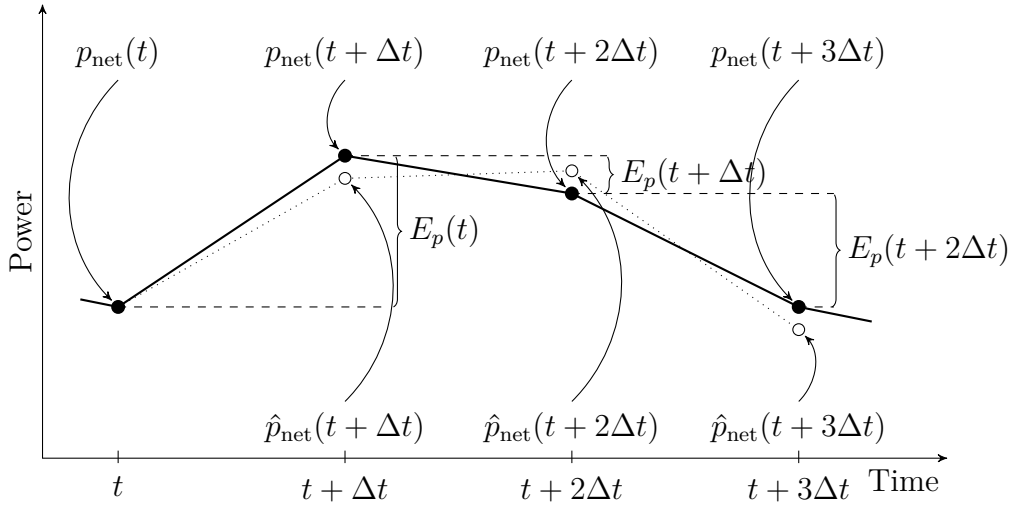


Figure 4.4: Underlying time-series based compensation strategy for compensator PID_2 .

Figure 4.4 summarises the time series computations for each power sample at times t , $t + \Delta t$, etc. Ideally, PID_2 uses present power readings, $p_{\text{net}}(t)$, and a power value of the immediate future, i.e. $p_{\text{net}}(t + \Delta t)$, to compute a power error signal, which is to be reduced to a smallest possible value. This error signal is defined as:

$$E_p(t) := p_{\text{net}}(t + \Delta t) - p_{\text{net}}(t) \tag{4.11}$$

However, since the future network power is unknown an “estimated next power”, $\hat{p}_{\text{net}}(t + \Delta t)$, is used instead. This value is the PID₂’s input from the predictor and results in an “estimated power error signal”:

$$\hat{E}_p(t) = \hat{p}_{\text{net}}(t + \Delta t) - p_{\text{net}}(t) \quad (4.12)$$

Similarly to PID₁, PID₂ produces a corrective ESMU power component, $p_2(t)$, that smoothens the resulting power profile. This corrective ESMU power is also computed using a standard linear weighted dynamic vector β , with $\beta = \{\beta_P, \beta_I, \beta_D\}$, being the P, I and D weight, respectively:

$$\begin{aligned} p_2(t + \Delta t) &:= \beta_P E_p(t) \\ &+ \beta_I \sum_{i=0}^{\infty} E_p(t - i\Delta t) \\ &+ \beta_D \frac{E_p(t) - E_p(t - \Delta t)}{\Delta t} \end{aligned} \quad (4.13)$$

Similar to α how to determine the values of β is explained later in this section. Finally, the “next ESMU power” can be deduced by adding the two corrective ESMU power components, as shown in the equation below.

$$p(t + \Delta t) = p_1(t + \Delta t) + p_2(t + \Delta t) \quad (4.14)$$

Both PID compensators do however depend on correctly chosen weights for α and β . Therefore they need to be tuned prior to executing the dynamic control. For this work a minimisation problem was formulated that is based on a cost function, $\zeta^*(\alpha, \beta)$, to deduce the two weight vectors as follows:

$$\begin{aligned}
& \min_{\alpha, \beta} \zeta^*(\alpha, \beta) \\
& \text{s.t.} \quad \begin{cases} SOC(t) - SOC_{tol} \leq 0 \\ -SOC(t) \leq 0 \\ SOC(t) - 1 \leq 0 \end{cases}
\end{aligned} \tag{4.15}$$

Here, $\zeta^*(\alpha, \beta)$ is defined as:

$$\begin{aligned}
& \zeta^*(\alpha, \beta) := \max_t (\mathbf{p}_{net} + \mathbf{p}) \\
& \text{where } \mathbf{p}_{net} = (p_{net}(t)) \text{ and } \mathbf{p} = (p(t))
\end{aligned} \tag{4.16}$$

In Equation 4.15 and Equation 4.16, $\zeta^*(\alpha, \beta)$ represents the sub-half-hourly peak load during a day when ESMU schedules are adjusted with the corresponding α and β weights. Also, the same SOC tolerance that was used to generate the SOC schedule (i.e. SOC_{tol}) is included to prevent the solution from deviating off the prescheduled SOC profile. To generalise this solution for all load cases this minimisation problem was formulated to solve multiple daily load profiles in order to find ideal values for α and β . The system of two PID compensators for discrete time is unconventional and it is worth considering different types of control or compensator. However, with the above-explained approach and for the data used as part of this research, the computed set of α and β weights resulted a convergent and stable solutions. In this context, convergent means that the $SOC^*(t)$ values tend towards the $SOC(t)$ values, and stable means that the $SOC^*(t)$ values never clipped at zero or one. The details concerning these case studies themselves are however outlined in Section 4.4.

4.3.2 Model predictive control

As explained in the literature review in Chapter 2, Model Predictive Control (MPC) is favoured over Set-Point Control (SPC), since it takes into account time-series to produce a behaviour. With this knowledge, MPC can be used to not only react to recent changes but also to counteract foreseen trends. Different approaches exist to obtain these foreseen trends and these approaches highly vary in accuracy, computational burden and robustness. Equally, the characteristics of underlying data which is used to train these models impacts their performances. For the presented work in this chapter, an efficient and robust approach is required since potential ESMU deployment with SSEN demands these functional requirements. Prediction accuracy on the other hand is an optional requirement which becomes important only when the predicting model can issue predictions in real-time and does (for the predicting horizon) remain stationary and bounded.

The simplest form of producing a prediction is to assume that the currently observed trending load will also occur in the future. This kind of prediction does however not take into account demand dynamics. An AR model on the other hand uses a series of past observations and their individual contribution to predict the next power. But the further into the future these predictions are made the less accurate they become. This accuracy loss is however circumvented since the hybrid system was designed to only apply corrections based on load predictions of the immediate future (i.e. next sample time at $t + \Delta t$ and not $t + 2\Delta t$ or similar). This simplification also reduces computational burden and guarantees real-time operation especially when choosing the simplest dynamic model (i.e. an Auto-Regressive (AR) model instead of deep artificial neural networks). Since external forces can and often do impact the behaviour of the model, the AR model is treated as an exogenous model with a time-series of input powers, $\mathbf{p} = (p(t))$, a time-series of predicted “next powers”, $\hat{\mathbf{p}} = (\hat{p}(t))$, and an internal delay function $t - \Delta t$.

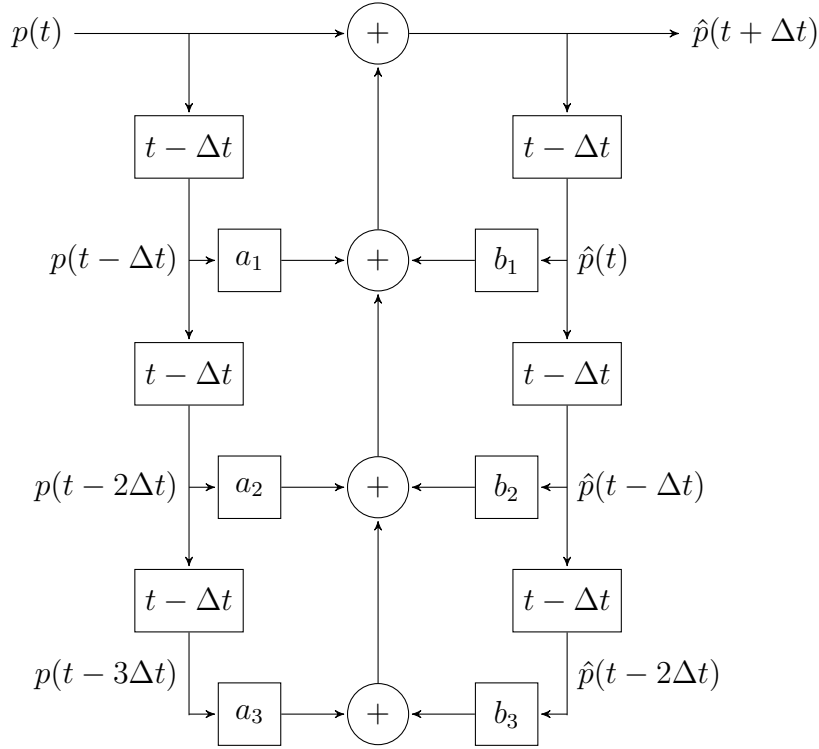


Figure 4.5: Example of exogenous auto-regressive model that is used for model predictive control. Here, $t - \Delta t$ indicates the time delay by one sample period.

Figure 4.5 graphically captures the standard AR model's function tree which is equivalently represented mathematically in the following equation:

$$\hat{p}(t + \Delta t) = p(t) + \sum_{i=1}^N a_i p(t - i\Delta t) + \sum_{i=1}^N b_i \hat{p}(t - (i - 1)\Delta t) \quad (4.17)$$

Values of the two weight vectors \mathbf{a} and \mathbf{b} , where $\mathbf{a} = (a_i)$ and $\mathbf{b} = (b_i)$, are determined during runtime using the standard adaptive least squares algorithm, i.e.:

$$\min_{\mathbf{a}, \mathbf{b}} (p(t) - \hat{p}(t))^2 \quad (4.18)$$

Or:

$$\min_{\mathbf{a}, \mathbf{b}} \left(p(t) - p(t - \Delta t) + \sum_{i=2}^N a_i p(t - i\Delta t) + \sum_{i=2}^N b_i \hat{p}(t - (i - 1)\Delta t) \right)^2 \quad (4.19)$$

Therefore, the proposed algorithm adjusts \mathbf{a} and \mathbf{b} to minimise the prediction error at each time-step. Beside finding optimised values for \mathbf{a} and \mathbf{b} , the model's number of regressors, N , is also expected to impact the model's performance (N is also referred to as the “model length”). The example in Figure 4.5 represents a symmetric model where $N = 3$. This short length however is most likely insufficient in predicting $p(t + \Delta t)$ which is why several models of increasing lengths are assessed and compared in the results section of this chapter. From this comparison the impact of N on the models' resulting values of $\hat{p}(t + \Delta t)$ and correspondingly on the performance of the dynamic controller can be determined and discussed. Details about the cases for different model length are presented in the case studies in Section 4.4.

4.4 Case studies

All cases that are used to demonstrate the operation of the proposed hybrid control use 27 days of uninterrupted historical demand data. In total five cases are assessed. Two special cases, respectively case **O** and case **B**, assess the performance of the original case, i.e. where no ESMU operation takes place, against a baseline case, i.e. where traditional off-line ESMU operation that only uses predetermined half-hourly ESMU schedules is referred to as the benchmark case. The remaining cases which are explained below, capture different implementations of the dynamic control. These three case studies are defined as: cases **I**, **II** and **III**. This group of three case studies evaluates the impact of the proposed dynamic control when subjected to realistic (i.e. imperfect) half-hourly load forecasts. In each of the three cases a different mechanism is used to predict the power volatility. More specifically:

- case **I** represents an ideal scenario where perfect foresight is assumed and the exact next load can be estimated,
- case **II** uses the aforementioned MPC and performance of different AR model

lengths is compared, and

- case **III** is the third and final case and implements the simplest prediction mechanism (i.e. it is assumed that the current power measurements repeats).

For clarity, all three cases, numbered **I** to **III**, are summarised and tabulated in Table 4.1.

estimation method	real forecast
perfect foresight	I
MPC (AR/ARX)	II
power repetition	III

Table 4.1: Three cases and their dynamic control input assumptions

Results from all ESMU cases (**B**, **I**, **II** and **III**) are first compared against the original (i.e. uncompensated) network load case **O**. In this first set of results the assessment of load profile improvements are made clear by using only one sample day. Once it is clear how the day's peak is reduced by the algorithm the daily peak reduction capability from all cases' results are compared across the entire set of days. Rather than assessing the underlying load profile from a time-series perspective, focus is only put on any additional reductions of peak load. However, the number of days makes it difficult to spot trends and improvements in the data. Therefore a Probability Density Function (PDF), based on kernel density estimation, is derived from the daily peak reduction results. The PDF shows the stochastic improvement of each case in comparison to the original case **O**. Finally, to assess the AR model's impact on the peak reduction performance, the simulations are re-run using different AR model lengths (N) are and the results are compared using the same PDF comparison method.


4.5 Results and discussion

All proposed cases are used to control power flow of the ESMU using 27 days of uninterrupted sub-half-hourly load records. In this section the time-series improvements are presented at first where a day's peak reduction due to the sub-half-hourly schedule adjustment are highlighted. After all, reducing peaks both frees additional resources for future load and reduces ohmic losses in the cables. Then the daily peak reduction across the entire dataset is presented and followed by a probability density plot to better compare these findings. In the end the model's impact on the peak reduction performance is assessed.


4.5.1 Time-series analysis

A single day was plotted in Figure 4.6 which shows the time-series improvements that were yielded by the ESMU operation. For visual clarity Figure 4.6a and 4.6b show, respectively, the entire day and a zoomed in version that focuses on the period of interest where the ESMU impact is most apparent. It can be observed that the unmodified demand profile (i.e. the original case **O**) and the case where scheduled half-hourly ESMU operation is applied (i.e. the baseline case **B**) result in noticeably higher load peaks than any of the three adjustment cases. More specifically, the original peak reduction (which is equal to the scheduled ESMU power) was 1.8kW (or 3.9% peak reduction). The average peak reduction when applying adjustments to the ESMU operation was 9.6kW (or 20.6% peak reduction). Although it is too early to conclude on any overall performance improvements this time-series modification does show the physical impact of the ESMU schedule adjustments on the network's load profile. Furthermore Figure 4.6a highlights the volatility of the underlying data which would be neglected for half-hourly ESMU schedules.

Interestingly, both the standard AR and the exogenous AR estimation models

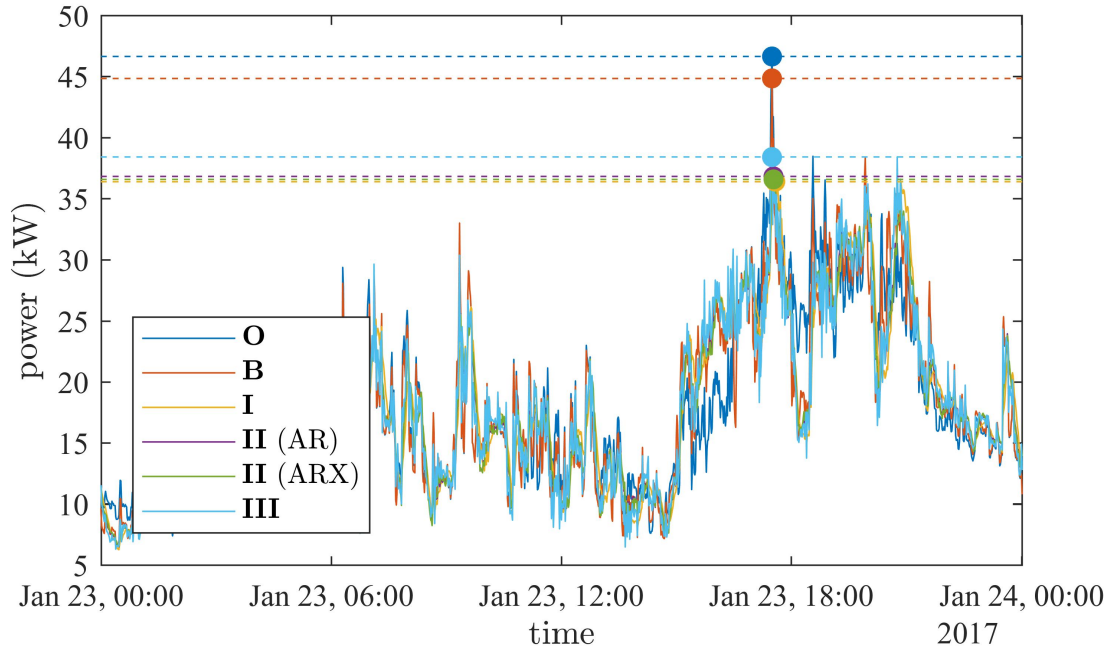

(a)

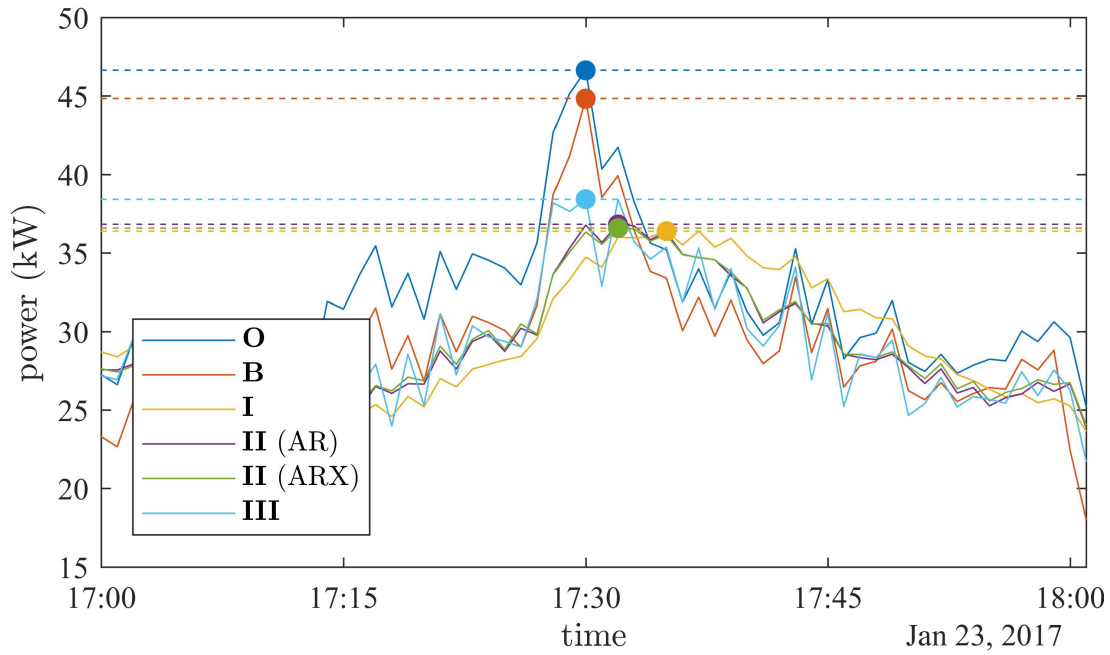

(b)

Figure 4.6: Time series performance over a single day when using realistic load forecasts: (4.6a) total day; (4.6b) zoomed in on critical period

that were used in case **II** performed very similar and show little to no significant difference in peak reduction performance. Equally noteworthy is the fact that the simplest prediction methods of them all in case **III** (i.e. the method of assuming a power repetition occurs) yields positive peak power reductions, too. However, case **I** slightly outperformed all other cases since perfect knowledge would also imply best results. Nonetheless, only a small improvement was possible due to the imperfect underlying half-hourly ESMU schedule. The amount by which the three cases were able to reduce the daily peak load is also indicated by horizontal dashed lines and dots located at the point of peak load for each profile. These initial findings show that every single version of dynamic control reduces peak load when compared to the baseline case **B**. This finding is also tabulated in Table 4.2, and it suggests that the prediction mechanism by itself did play some role when compensating for demand volatility.

case	O	B	I	II (AR)	II (ARX)	III
peak (kW)	46.6	44.8	36.4	36.8	36.6	38.4

Table 4.2: Peak reduction in time-series sample

However, the general impact of each prediction method on the resulting peak reduction performance can only be assessed if the complete dataset is evaluated. Hence, the next section compares the daily peak load reduction from the application of each case.

4.5.2 Daily peak reduction

In Figure 4.7, every day’s power peak was extracted in a similar way to the procedure that was used for Figure 4.6. Here the actual power peaks were plotted in Figure 4.7a, and the relative power improvements (i.e. ratio to the baseline power peaks from case **B**) were plotted in Figure 4.7b. From both plots it can be seen that controlling ESMU

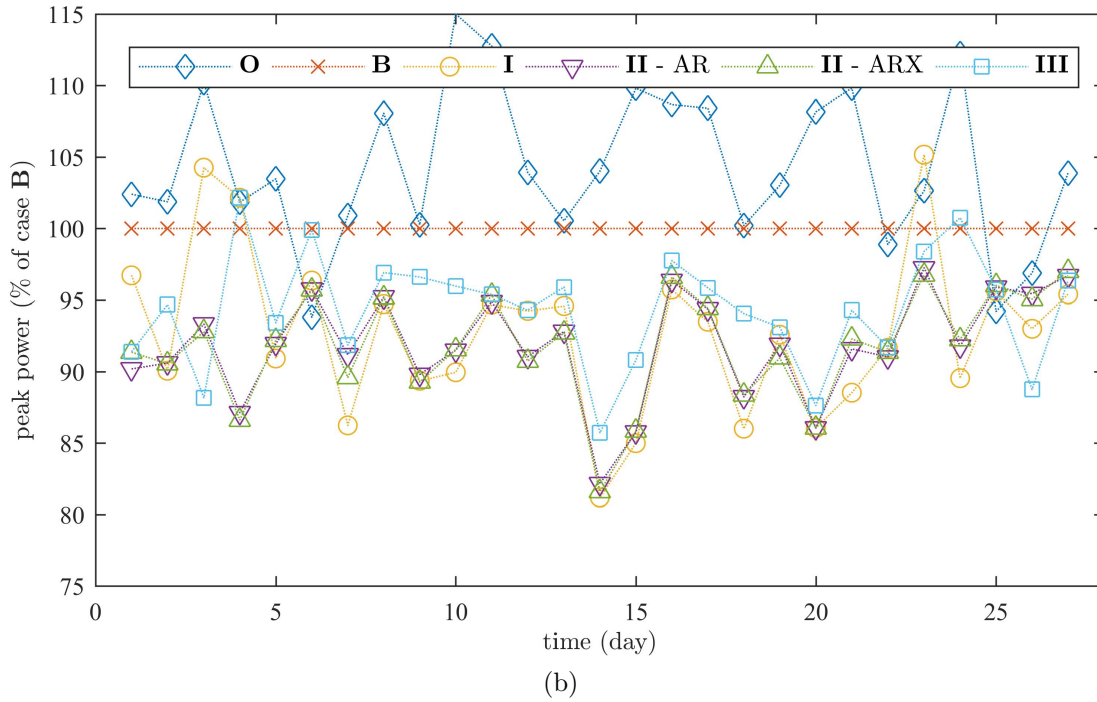
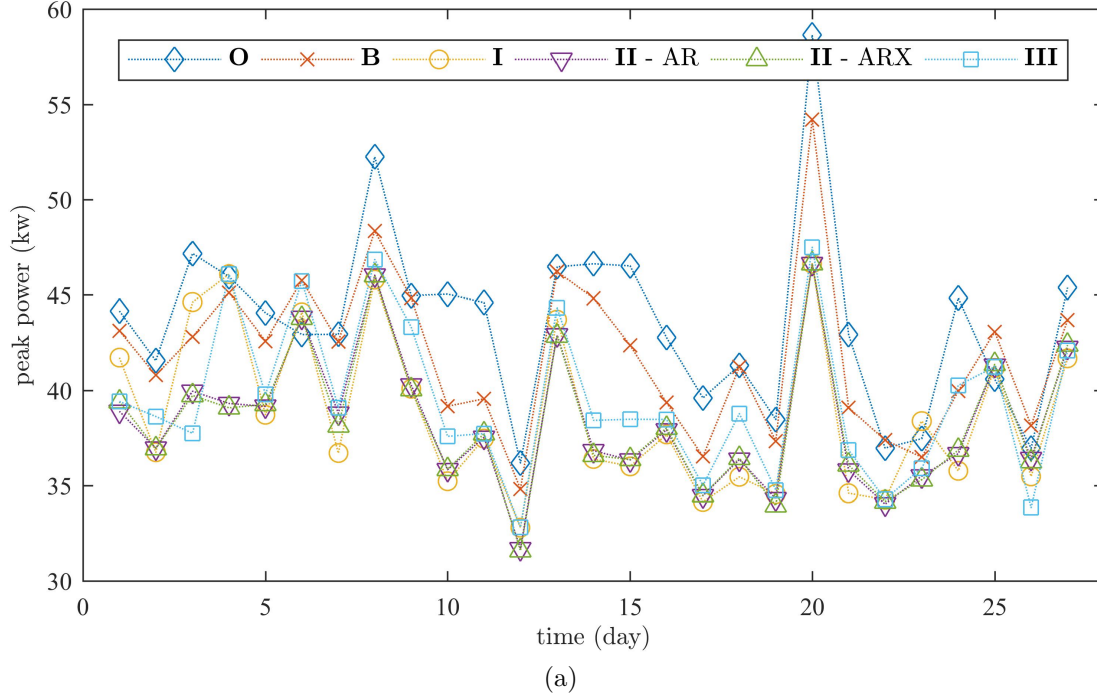


Figure 4.7: Daily peak reduction when using realistic forecasts as: (4.7a) peak power values; (4.7b) percentage of original case **B**.

using the proposed dynamic control (**I**, **II**, **III**) lowers peak load. This is true even when the underlying ESMU schedule originally worsened and increased peak load (see **B** vs **O**). Such a behaviour can be observed clearly during days 6 and 25, where the half-hourly ESMU schedule based on **B** increased the actual load peak from case **O** by 2.8kW and 2.5kW, respectively. The ESMU schedule adjustment mechanisms (**I**, **II**, **III**) however compensated for this error, but in those two cases the compensation was not enough to reduce peak power below the original value. Day 26 on the other hand experienced a similar increase in peak power during the baseline case **B** by 1.2kW, but the proposed power adjustment mechanism according to **II** corrected this forecast error and reduced the final peak power below the original value.

Nonetheless, the sensitivity to the underlying power prediction approaches becomes apparent when having this larger set of peak reduction results to compare the dynamic control's performance against its baseline cases. As seen in Figure 4.7b the scenario with perfect foresight (i.e. case **I**) frequently outperformed all other cases since it appears to achieve largest peak power reduction from the baseline case. During some days however (i.e. day 3, 4 and 24) the compensators could not correctly compensate despite the perfect foresight. This behaviour was unexpected, but it turns out that the discrepancy between the underlying half-hourly BESS schedule and the actual load curve (i.e. due to erroneous half-hourly load forecasts) caused the dynamic control to reach its SOC tolerance limit. Reaching its limit during those three days consequently worsened the daily peak. The simplest of all cases on the other hand (i.e. case **III**) yielded a constant but small reduction when compared to the baseline case. Case **II** seems to perform similar, but slightly better than case **III**. One could therefore assume that by maintaining a constant error in the power prediction does positively skew the results when already subjected to low-resolution forecasting errors. Whether this assumption holds can however not be said with the presented analysis and instead, in order to obtain an more general picture of the

overall peak reduction performance, the Probability Density Function (PDF) had to be estimated and analysed for all cases. This is done in the following section.

4.5.3 Probability of peak reduction

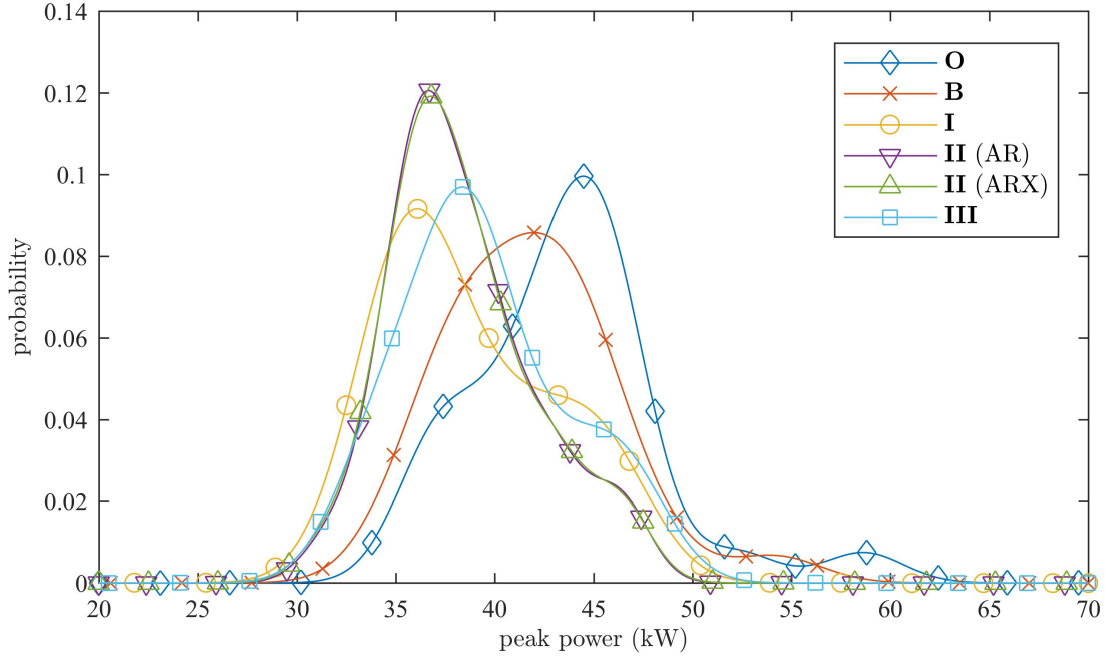


Figure 4.8: Peak load probability for different prediction mechanisms.

With the use of the standard kernel density estimation, the PDF is plotted in Figure 4.8. The data used to generate these plots is the same data as shown in Figure 4.7. Now however, the probability of a peak power occurring is linked to the magnitude of this peak. It can be seen that case **O** has the highest probability around a peak load of 45kW, whilst case **B** has its highest probability around a peak load of 42kW. This indicates that there is even a high probability that the half-hourly ESMU schedule has a positive impact on the load peaks. When adjusting this schedule by using the proposed dynamic control, this peak was however lowered further. Case **I** performed best by having a most probable peak power of 36.1kW. Case **II** achieve the second best values at 36.7kW and 36.8kW (for AR and ARX case, respectively) whilst the simplest prediction mechanism has its peak power probability maximised

at 38.4kW.

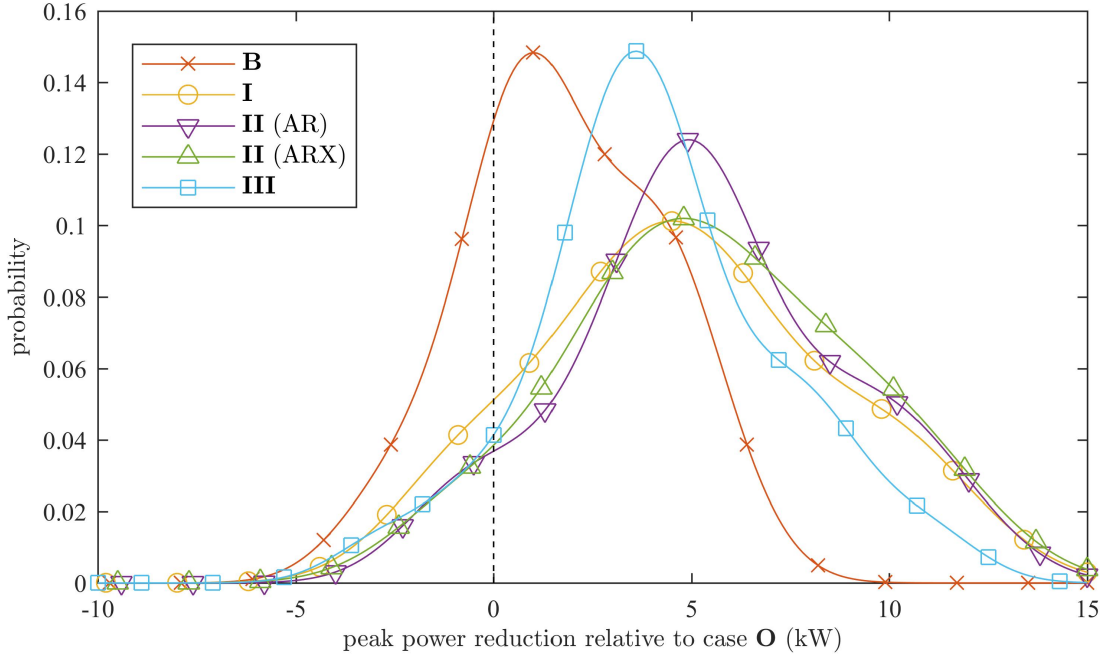


Figure 4.9: Probability of peak load reduction for different prediction mechanisms.

Figure 4.9 takes this analysis even further where only the difference in peak load to the original case (i.e. case **O**) is plotted. Now the ESMU impact can easily be seen since a high probability of positive peak load reduction indicates a beneficial impact of the ESMU operation. A negative peak load reduction (i.e. increased peak load) would therefore indicate a worse performance. As expected, case **B** has a slight positive impact on the system whilst a cumulative probability of more than 25% (i.e. area under curve of case **O**) to the left of 0kW suggests that the peak might be worsened one in four times. The dynamic control with its simplest prediction method however (i.e. case **III**) lowered this probability to already 7.4%. The perfect foresight model (i.e. case **I**) performed only at 11.8% and the MPC based cases (i.e. case **II**) achieved an average of 8.0% probability of worsening the peak power. The fact, that the perfect foresight model **III** could not reduce the probability of peaks as well as the simple model **I** is likely due to the used power profiles and forecast errors. However, the mean probabilities (that are discussed below) differ as expected.

In the following, the mean peak reduction of the base case **B** (i.e. where the cumulative probability reaches 50%) is treated as the benchmark for peak reduction. This probability is reached at 1.7kW or in other words: the probability of reducing load peaks by 1.7kW or more was at 50% for case **B**. The simplest case **III** however increased this probability to 77.7%, case **II** to 84.5 5% (AR) / 83.1% (ARX), and the perfect foresight case **I** to 79.8%. The reason why this simplest case achieved a slightly lower value than the AR/ARX cases was due to aforementioned discrepancy between actual and forecasted load profiles. Due to the discrepancy in erroneousess the chosen SOC tolerance was exhausted and lead to some worsening cases that negatively skewed results of the perfect foresight case (i.e. case **I**). Nonetheless, when comparing the three dynamic control cases with each other as done in Figure 4.9, then it can be seen that case **II** using an AR model for MPC performed best at reducing peak loads for the used dataset.

4.5.4 Impact of varying the model's length

The subsequent results are intended to show whether the length of the AR/ARX model impacted the peak reduction performance. To do so, the same procedure was use as shown in Section 4.5.3, but the length of the AR and ARX models was varied from five minutes to two hours. Therefore the MPC of the dynamic control took into account a longer power history to potentially improve the prediction of the next power.

Similar to Figure 4.9, Figure 4.10 shows the probability for the difference in peak power between the original case (**O**) and all other cases. In this plot however all PDFs for the different model lengths have been included (whilst the previous study only showed the inter-model means). It can be seen that both the AR and ARX case (i.e. case **II**) performed noticeably better than the baseline case **B**. Despite the varying model length all PDFs appear to peak around a reduction performance of 5kW.

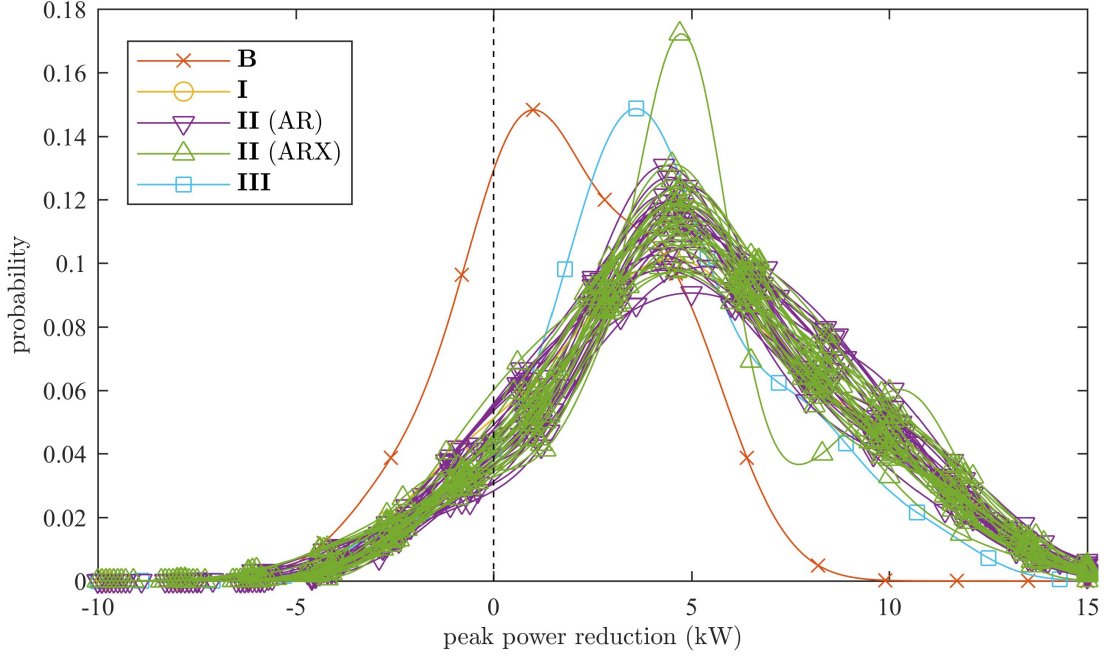


Figure 4.10: Probability of peak load reduction for different prediction mechanisms and different AR/ARX model lengths.

Therefore it is assumed that the length of the chosen models does not significantly impact the results.

This assumption is also supported by the boxplots in Figure 4.11 where the peak power distributions are visualised for all different model lengths and the six different case studies. It can be seen that the different AR/ARX model lengths (i.e. case **II**) outperforms both the original and baseline cases (i.e. case **O** and case **B**, respectively). All in all, a certain variation in peak reduction performance can be observed, but no apparent trend. Therefore the assumption that the model length impacts the performance of the dynamic control is true, but for the used data the assumption that a longer model generally yields better results is not.

4.6 Summary

In this chapter a dynamic control method is proposed to address **Objective 2** in the objective list which is presented in Section 1.2. The proposed method adjusts half-

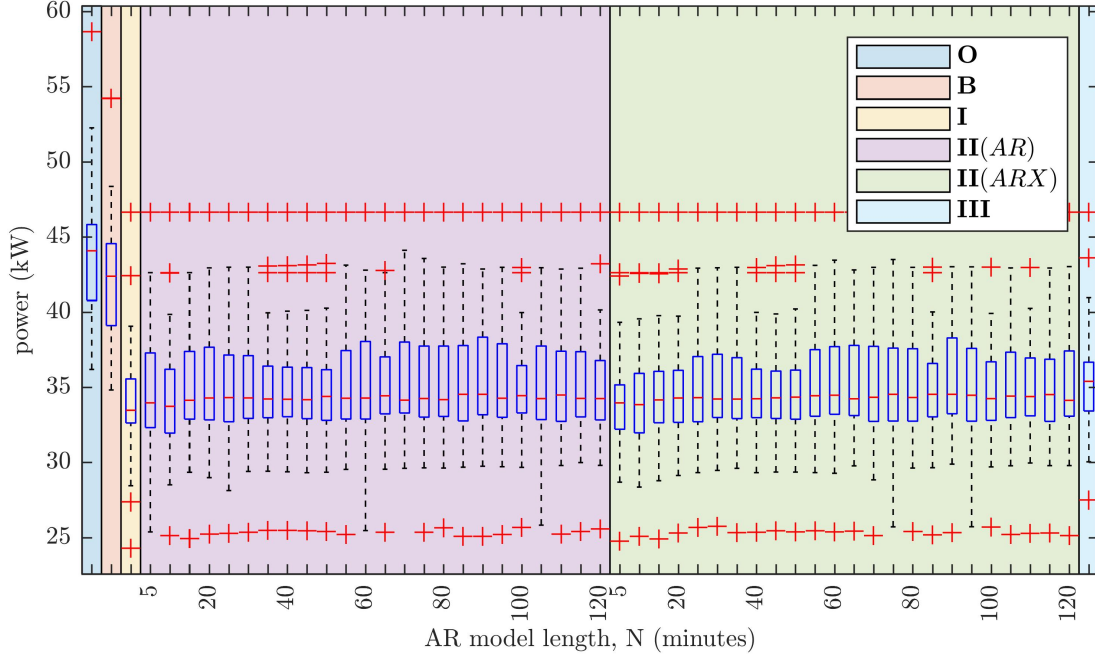


Figure 4.11: Visualisation of the peak power distribution for different AR/ARX model lengths.

hourly Energy Storage Management Unit (ESMU) schedules on a sub-half-hourly basis in order to minimise otherwise neglected sub-half-hourly power spikes without risking a shortage or surplus of ESMU stored energy. Traditional load forecasts usually lack accuracy and temporal resolution which makes it hard to schedule ESMU in an optimal manner. Recent research implements derivations of Set-Point Control (SPC) which is typically guided by a short-term Model Predictive Control (MPC) mechanism to address both load volatility and to prepare ESMU for upcoming load spikes. Those approaches do however not utilise the information, quality and operational certainty that would be provided by load forecasts and ESMU schedules. The proposed dynamic control addresses this shortcoming by approaching the problem from the opposite direction: i.e. it adjusts a predetermined ESMU schedule based on two linked PID compensators.

The first compensator was designed to minimise the deviation from the prescheduled ESMU's State Of Charge (SOC) profile and the second compensator was designed

to minimise the load volatility. For the second compensator to operate however a short-term predictive model was used to estimate the load power in the immediate future (i.e. the next time step). Two different light weight and well established mechanisms were used to implement this predictive model in order to assure real-time operation and robustness of the system.

Simulating these different models to guide schedule adjustments yielded positive results for each test case that used dynamic control. A sample day showcased how additional adjustments can reduce a sub-half-hourly power spike by 10kW whilst the execution of a traditional half-hourly schedule would have only resulted in reduction of 1.8kW. In fact, dynamic control outperformed the baseline case in nearly every case (where the baseline case is the scenario of applying a traditional half-hourly ESMU schedule in an off-line manner). Whilst this baseline operation did also increase peak load under severe forecast errors, the best performing dynamic control case was able to reduce the probability of increasing peak loads by a factor of 3.12. Also, the length of the underlying prediction models was varied from 5 minutes to 2 hours in order to assess the impact of this variation on the performance of the dynamic control. It was determined that there is no linear correlation between the models' lengths and the performance of the dynamic control. Instead, the dynamic control operated with slight performance variations, yet always outperformed the original and baseline cases. Those performance gains were achieved despite the fact that all cases used the same underlying ESMU schedule that were generated from realistic (hence imperfect and erroneous) load forecasts. In conclusion, **Objective 2** which is defined in Section 1.2 has been successfully met with the provided data.

The work presented here demonstrates how imperfect ESMU schedules can still be used to yield more beneficial impacts on the overall load profile. With future deployment of ESMU throughout Low-Voltage power distribution networks, advanced ESMU control is necessary to assure their impact is in accordance to volatile de-

mand. Control, like the one proposed here can take into account the complete range of demand volatility and when implemented correctly, can defer or avoid network reinforcement altogether. This is particularly true since ongoing electrification of UK heat and transport sectors change consumers' electricity consumption and increase stress on power distribution networks.

Chapter 5

Effects of Desynchronising Information Propagation when Distributing Smart-Charging

5.1 Overview

In previous chapters, the question has been addressed how one can optimally control a single battery energy storage unit. It was shown that half-hourly forecasts can be used to predict demand that is based on customers' behaviours. With this knowledge Battery Energy Storage Systems (BESS) were scheduled to shave half-hourly peak loads on a daily basis in order to avoid overloading the power distribution system. Yet sub-half-hourly issues could not be addressed by this traditional BESS schedules which is why two successive sub-half-hourly power adjustment methods were proposed and developed as extended BESS control methods. The first method in Chapter 3 focused on improving network operation by considering the underlying three-phase network properties whilst strictly following its underlying half-hourly operating schedule. The second method on the other hand which was presented in

Chapter 4 alleviated this constraint by adjusting the total power flow instead. Benefits like preparing the storage for a day-ahead peak can be exploited by using BESS schedules and complementing them with dynamic feedback enabled the device to take into account sub-half-hourly volatility, too. As shown in those previous two chapters (Chapter 3 and Chapter 4) together, these two methods yield improved system operation as well as a reduction in both daily and intermittent peak load.

The next step would be to take such control methods and apply them to multiple and distributed batteries. To prevent the negative impact from simultaneous battery charging, particularly when dealing with the home-charging of Electric Vehicles (EVs), battery energy consumption needs to be coordinated. As already discussed in the literature review in Chapter 2, multiple control methods that can also be used to coordinate Distributed Energy Resources (DER) that include EV charge scheduling methods (i.e. [39, 110, 147, 151–162]). Those approaches propose demand prioritisation, multi-tariff environments and even game theory based methods to maximise utility or to reduce operating cost. In the context of EV charging, reacting to other EV’s changes in charging plans becomes a vital requirement when scheduling and coordinating their own charging profiles. For this very reason has research predominantly focused on improving so called smart-charging algorithms, but in a distributed system this scheduling assumption of perfect knowledge exchange does not always hold: In fact, during the scheduling of distributed EVs, control instructions broadcasted by one EV to inform all other EVs (for example of an updated charging schedule) need not or cannot receive and respond to this instruction at the exact same time, unless some synchronisation amongst all EVs is emplaced. A method to develop smart-charging algorithms that explicitly function in both synchronised and desynchronised environments does not yet exist, to the best of the author’s knowledge. Therefore, this chapter, Chapter 5 first develops a smart-charging method for a synchronised fleet of EVs and then introduces message desynchronisation to assess the

performance difference between the two operating environments. By doing so, Chapter 5 addresses **Objective 3** of this thesis that aims to develop an EV scheduling method that is immune to message desynchronisation (details of this objective was outlined in Section 1.2).

It should be noted that the charging of EVs is explicitly assessed instead of managing a collection of BESSs since storage is able to release energy and thus provide grid support, too. Traditional EVs on the other hand do not have such capabilities¹ and need to be coordinated in order to avoid home-charging related load spikes. To achieve this coordination Chapter 5 implements a Multi-Agent System (MAS) to enable the distributed scheduling using the Foundation for Intelligent Physical Agents (FIPA) compliant agents as communication entities [200]. A smart-charging algorithm is developed and implemented in each agent where communication is initially assumed to be synchronised. Results show how EV scheduling in a synchronised environment leads to the expected outcomes - some of which have also been established in literature (for example oscillating load assignment like in [46]). However, adding jitter to message broadcasting significantly changes the algorithm’s behaviour. Differences regarding rate of convergence and criteria for stability are most noticeable whilst scheduling performance on the other hand does not deteriorate. The structure of this chapter is as follows: First, the EV demand and scheduling mechanism to coordinate the synchronised and desynchronised smart-charging is explained in Section 5.2. Next, in Section 5.3 the distributed control system for the chosen MAS is presented alongside the two cases for synchronised and desynchronised information propagation or message exchange. Section 5.4 presents and discusses the results from these two cases, upon which a conclusion is drawn in Section 5.5.

¹Research delving into Vehicle-to-Grid (V2G) support do consider reverse energy flow, yet this is not included in the work presented in this thesis as it lies outside the scope for message desynchronisation when considering the generation of traditional EV charging plans.

5.2 Coordination of EV charging

In this section an algorithm for EV charging is presented which is implemented in both a synchronised and desynchronised case. The Irish load dataset [201] is used in combination with EV energy demand to test the proposed smart-charging algorithm. Performance of the algorithm at preventing new power spikes from occurring is then assessed with the use of standard performance metrics that have already been used throughout this thesis (i.e. the PAR and TRA metric). Finally, to study the convergence of the algorithm a convergence criteria as well as rate of convergence are presented, too.

5.2.1 EV Demand

In order to simulate the fleet of charging EVs, U where $U \in \mathbb{Z}^{>0}$, each EV, u where $u \in \{1, \dots, U\}$, is modelled as a load that needs to consume a certain amount of energy, E_u where $E_u \in \mathbb{R}^{\geq 0}$, over the course of a scheduling horizon, T^{sch} where $T^{\text{sch}} \in \mathbb{Z}^{>0}$. Unlike typical load profiles (for example household load profiles) EVs are modelled to not have a predetermined load profile. Instead they are flexible so they schedule their own demand, $p_{u,n}^{\text{EV}}(t)$ where $\mathbf{p}_{u,n}^{\text{EV}} = (p_{u,n}^{\text{EV}}(t))$, at any moment time, t where $t \in \mathbb{Z}^{\geq 0}$. In other words, EVs can autonomously assign their own charging plan over the predetermined number of future time-slots, T^{sch} . Due to limitations in on-board power electronics each EV's maximum charge rate, P_u^{max} where $P_u^{\text{max}} \in \mathbb{R}^{>0}$, is restricted and must not be exceeded. In order to meet the EV's charging demand over the scheduling horizon, T^{sch} , a soft minimum charging power, P_u^{min} where $P_u^{\text{min}} \in \mathbb{R}^{>0}$, is also introduced:

$$P_{\text{min},u} := \frac{E_u}{T^{\text{sch}}} \quad (5.1)$$

Although the upper limit represents the technical restriction of the on board

charging equipment, this lower limit is a necessity to assure the demanded energy is charged over the entire charging period and thus this limit is also used to initiate the scheduling procedure itself. This charging procedure is explained in Section 5.2.3. EVs utilise their agent system to purchase energy quantities for each time-slot, t , and also sell or “undo” some of the already acquired energy quantities if it contributes towards the lowering of a potential load spike.

5.2.2 Baseline Load

Historic customer load profiles were used in this work to represent real power consumption in simulations [201]. For every of the containing 543 loads, this dataset consisted of 7392 demand readings which were sampled at half-hourly period (i.e. $\Delta t = 0.5$ hours). A single scheduling horizon was defined as one day (i.e. $T^{\text{sch}} = 48$ samples).

In this MAS related context, each household dispatches its agents once to acquire the household’s half-hourly energy demand for the entire day; thus making the assumption that demand foresight is available. It is worth mentioning that perfect demand foresight, especially for domestic loads, is difficult to realise. Imperfect foresight would result in sub-optimal power profile allocation, for example. Therefore, due to the focus of this chapter (which is to determine the difference between synchronised and desynchronised algorithm execution) the assumption of perfect foresight is made. After each household has acquired or reserved its daily demand by issuing an energy request, the entire network demand is known to the energy supplier and can be relayed to all EV agents when they query for the overall demand profile. This ability is exploited when scheduling and negotiating the unknown EV charging profiles. More specifically, all EV’s agents communicate with the supplier’s agent to optimally embed their charging profiles (i.e. $p_{u,n}^{\text{EV}}(t)$) within this aggregated baseline load.

5.2.3 Scheduling Algorithm

For the EV charging coordination strategy, an algorithm was designed that generates charging profiles for each EV so that the network power, $p^{\text{net}}(t)$ where $p^{\text{net}}(t) \in \mathbb{R}$, is optimised. Here an optimal network power implies that when adding all aggregated charging profiles to the network's baseline load, $p^{\text{base}}(t)$ where $p^{\text{base}}(t) \in \mathbb{R}^{>0}$, no additional power spikes occur in the resulting power profile (i.e. $p^{\text{net}}(t) = p^{\text{base}}(t) + \sum_{u=1}^U p_{u,n}^{\text{EV}}(t)$ where $p_{u,n}^{\text{EV}}(t)$ is the EV charging power). The charging profiles are generated by repetitively querying energy supplies for the network's baseline load, adjusting individual EV charging profiles and resubmitting the adjusted charging profile. As already stated, the common assumption when designing such a scheduling algorithm is that all scheduling entities are synchronised (i.e. they wait for each other) before querying for the network's baseline load. For visualisation the message exchange between two loads and a supplier is shown in Figure 5.1. This visualisation also includes the agent synchronisation event.

In Figure 5.1 the horizontal arrows indicate messages being sent from loads (i.e. EV agents) to a supplier and vertical lines indicate processing or idle time. Here a single scheduling iteration is shown, which can be broken into the sub-processes of: querying, scheduling, updating and synchronising. From top to bottom, the sequential execution of these sub-processes is as follows First, both load_1 and load_2 query the supplier for the currently known network load (i.e. $\text{query}(l_1)$ and $\text{query}(l_2)$). This network load is used to schedule their power profiles to “fill valleys” (i.e. only charge EVs during periods of low demand). Upon receipt of a reply from the energy supplier (i.e. $\text{reply}(l_1)$ and $\text{reply}(l_2)$) both loads immediately start scheduling their profiles. In the example above load_1 found a solution before load_2 and can therefore inform the supplier about its intended load profile sooner. It does so by sending an update (i.e. $\text{update}(l_1)$) to the supplier. Subsequently querying the supplier for an updated network load would be premature since the other load (i.e. load_2)

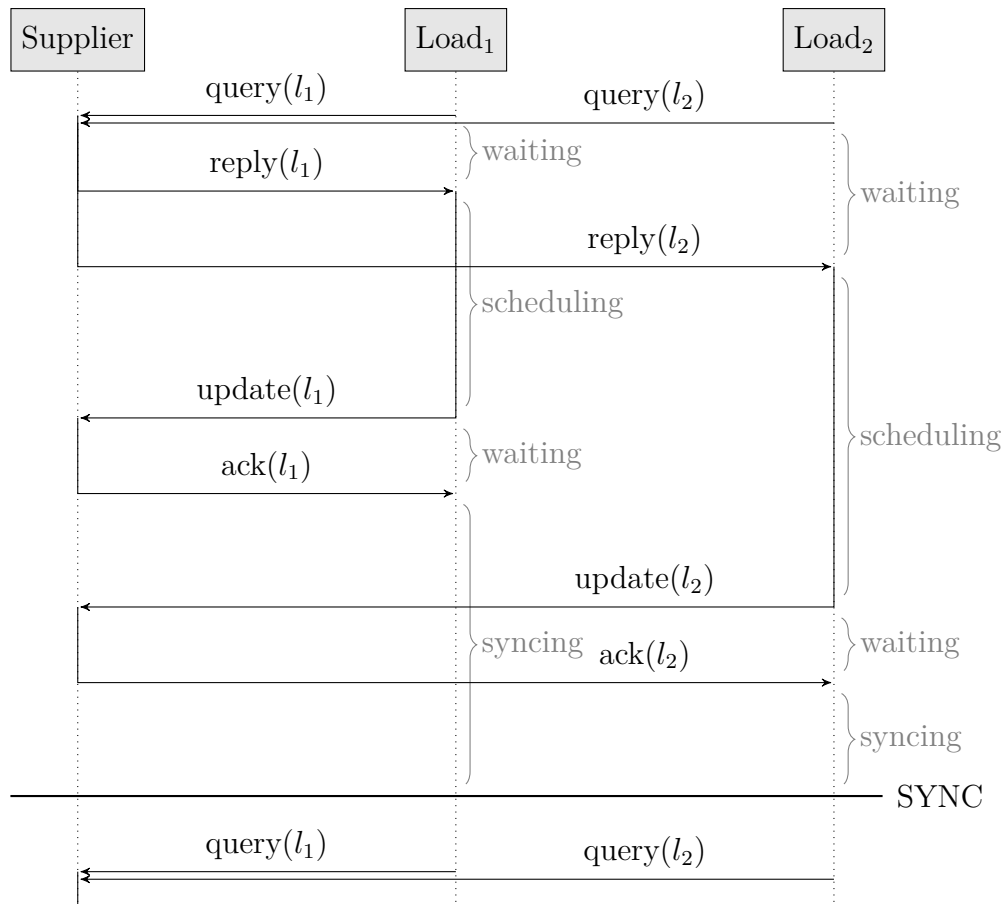


Figure 5.1: Example of agent synchronisation process before re-scheduling their EVs charging profile.

has not yet generated and updated its load profile. Therefore a synchronisation mechanism had to be used which forces load_1 to wait until all loads have sent updates to the supplier. In this example load_1 waits until load_2 has sent an update and the corresponding profile was acknowledged by the supplier (i.e. $\text{ack}(l_2)$). Only after this had happened, a synchronisation event would be triggered (i.e. *SYNC* event). After this synchronisation event the next algorithm iteration is initiated and the procedure repeats. Since all subsequent iterations are similar to the one shown in Figure 5.1 only the two querying messages of the second iteration are shown.

Although timing and message exchange has been outlined, the mechanism to allocate and reallocate charging powers in order to achieve the aforementioned valley filling behaviour has not yet been defined. This behaviour is shown in Figure 5.2 where several iterations numbered n (where $n \in [1, \dots, N]$ where $N \in \mathbb{Z}^{>0}$) are shown and for each subsequent iteration some amount of prescheduled power is reallocated to different time-slots. It is this reallocation to different time-slots that reduces and eventually completely mitigates EV charging spikes.

For every iteration, n , in Figure 5.2, charging profiles are added onto a baseline network load, $\mathbf{p}_n^{\text{base}}$, where $\mathbf{p}_n^{\text{base}} = (p_n^{\text{base}}(t))$. This base load is shown as the bold black line and does not change throughout the EV scheduling procedure. For every iteration numbered n , the charging profile of EV number u is defined as $p_{u,n}^{\text{EV}}$, where $\mathbf{p}_n^{\text{EV}} = (p_{u,n}^{\text{EV}}(t))$ (i.e. \mathbf{p}_n^{EV} consists of all EV charging profiles at iteration n). During the first iteration however (for example Figure 5.2a where $n = 1$) this charging profile is determined by assigning the maximum EV charging power to the time-slots of lowest load, until the total EV energy demand is met (i.e. consecutive time-slots t are chosen where $t = \text{argmin}(\mathbf{p}^{\text{base}})$). Resulting is an aggregated charging power that is likely to contain at least one new charging spike since all EVs scheduled their profiles based upon the same knowledge of $\mathbf{p}_n^{\text{base}}$. This spike is seen on an updated (i.e. temporary) demand profile, $\hat{\mathbf{p}}_n^{\text{base}}$, where $\hat{\mathbf{p}}_n^{\text{base}} = (\hat{p}_n^{\text{base}}(t))$, is defined as:

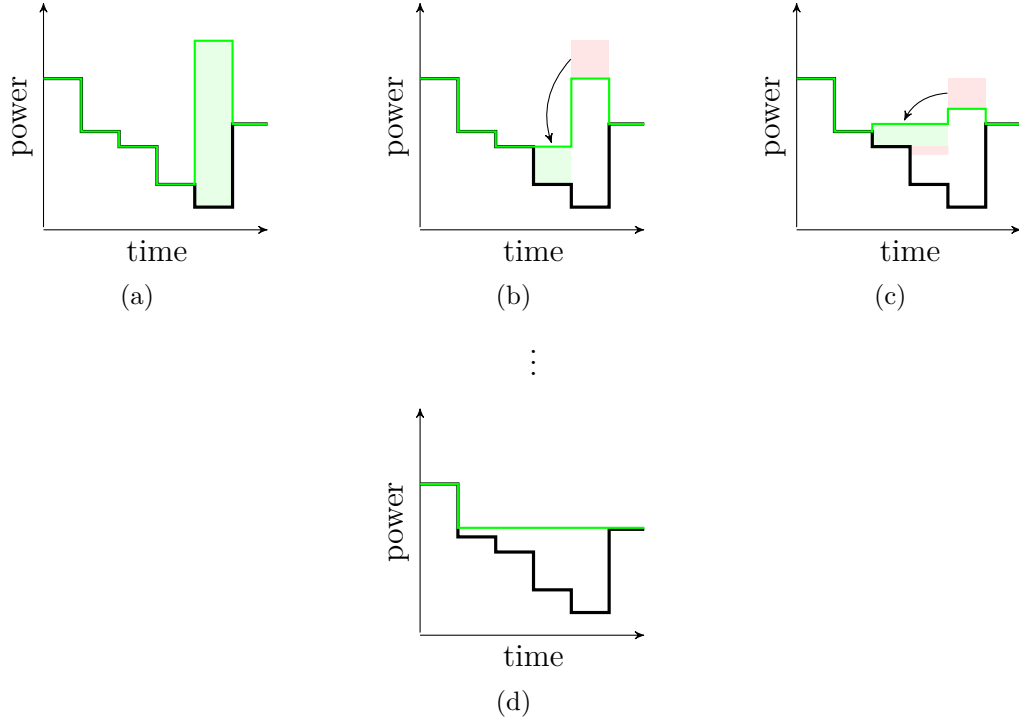


Figure 5.2: Charging power (green line) allocation on top of base network load (black line) for valley-filling behaviour. Here $n = 1$ for Fig. 5.2a, $n = 2$ for Fig. 5.2b, $n = 3$ for Fig. 5.2c, and $n = N$ for Fig. 5.2d.

$$\hat{p}_n^{\text{base}}(t) := p_n^{\text{base}}(t) + \sum_{u=1}^U p_{u,n}^{\text{EV}}(t) \forall t, n \quad (5.2)$$

For the next iteration $n + 1$ (for example Figure 5.2b where $n = 2$) a proportion of the previously scheduled power vector $\mathbf{p}_{n-1}^{\text{EV}}$ is “undone”. Subsequently, the spike in the resulting $\hat{\mathbf{p}}_n^{\text{base}}$ is reduced, yet the energy that has been undone needs to be reallocated to meet the EVs’ demands. The amount by which $\mathbf{p}_{n-1}^{\text{EV}}$ is reduced is determined by the “undoing” parameter α , where $\alpha \in [0, 1)$. A new reduced (i.e. temporary) charging vector $\hat{p}_{u,n}^{\text{EV}}(t)$ is therefore defined as:

$$\hat{p}_{u,n}^{\text{EV}}(t) := p_{u,n-1}^{\text{EV}}(t)(1 - \alpha) \quad (5.3)$$

Using this temporary charging power the temporary energy demand, $\hat{E}_{u,n}$, that needs to be reallocated can also be defined by including the sampling period Δt :

$$\hat{E}_{u,n} := E_u - \sum_{t=1}^{T^{\text{sch}}} \hat{p}_{u,n}^{\text{EV}}(t) \Delta t \forall u \text{ and } n \in 2, \dots, N \quad (5.4)$$

To include the first iteration of the algorithm, Equation 5.4 needs to be expanded to redefine $\hat{E}_{u,n}$ for all successive algorithm iterations n :

$$\hat{E}_{u,n} := \begin{cases} E_u & \text{if } n = 1 \\ E_u - \sum_{t=1}^{T^{\text{sch}}} \hat{p}_{u,n}^{\text{EV}}(t) \Delta t & \text{otherwise} \end{cases} \quad \forall u, n \quad (5.5)$$

Following the similar procedure as for the first iteration, $\hat{E}_{u,n}$ is then allocated to different time-slots where the rule of performing the power allocation (i.e. allocating $p_{u,n}^{\text{EV}}(t)$ based on $p_{u,n-1}^{\text{EV}}(t)$) is defined as follows:

$$p_{u,n}^{\text{EV}}(t) = \begin{cases} \hat{p}_{u,n-1}^{\text{EV}}(t) + \frac{\hat{E}_{u,n}}{\Delta t} \beta & \text{if } \hat{p}_{u,n-1}^{\text{EV}}(t) + \frac{\hat{E}_{u,n}}{\Delta t} \beta \leq P_u^{\text{max}} \\ P_n^{\text{max}} & \text{otherwise} \end{cases} \quad \forall u \quad (5.6)$$

where $\hat{p}_{u,n-1}^{\text{EV}} + \frac{\hat{E}_{u,n}}{\Delta t} \beta \geq P_{\min,u}$

Here β is the maximum “allocation” parameter, where $\beta \in (0, 1]$, and this parameter limits the power that can be allocated to any successive time-slot (i.e. $t - \Delta t$). To not exceed the EV’s maximum charging power any value in the charging vector, $\mathbf{p}_{u,n}^{\text{EV}}$, is capped to P_u^{max} . If β is chosen as one then the undone energy is allocated as quickly as possible, but this can lead to new power spikes and this slow the converging behaviour. For smaller values of β on the other hand, the undone charge is reallocated in smaller portions and the old power spike is distributed gradually. If this value is too small however then the total EV demand, E_u , cannot be allocated across the entire scheduling horizon, T^{sch} . The constraint in Equation 5.6 thus guarantees that EV demand is allocated over this finite scheduling horizon. By doing so, the temporary

energy demand equates to the original energy demand after the new charging powers are assigned to their corresponding time-slot (i.e. after $\mathbf{p}_{u,n}^{\text{EV}}$ is updated).

In any following algorithm iteration (i.e. $n > 2$ as shown in Figure 5.2c) each EV's charging profile is adjusted and spread further over the base load, \mathbf{p}^{base} . In the end (i.e. when $n = N$) the ideal EV charging profiles add to the base load in such a way that the resulting network load has an optimally filled valley. This valley filling behaviour was thus achieved by the “undoing” and “allocation” of EV charging power from one algorithm iteration to the next. For the purpose of this simulation, the algorithm terminates when the final iteration is reached (i.e. $n = N$) regardless of the final network load's shape. Here the rate of convergence of the algorithm differs based upon the choice of α and β values. This rate can be estimated and compared for each choice of α and β since the simulations terminate after the same number of iterations. However, convergence is in fact guaranteed when selecting values of $\alpha < 1$ and $\beta < 1$ since, in those cases, the algorithm satisfies the D'Alembert Criterion; the criterion requires a continuous but not necessarily regular reduction in successive outputs.

To summarise this section, the complete EV scheduling algorithm was developed by: 1. defining the message exchange and synchronisation mechanism, which is shown in Figure 5.1; 2. formulating the initial and successive “undoing” of charging power, as shown in Equation 5.3; and 3. defining the iterative update and “allocation” of the temporary energy demand, as defined in Equation 5.5. For clarity, this smart charging algorithm's pseudocode that performs the complete valley filling procedure has been included below; in Algorithm 1.

```

1 // Input data, i.e. initial conditions
  Data:  $\mathbf{p}_{\text{base},n}$ ,  $E_u$ ,  $P_{\text{max},u}$ ,  $P_{\text{min},u}$ ,  $\Delta t$ ,  $T_{\text{sch}}$ 
  Result:  $\mathbf{p}_{\text{EV},u,n}$ 
2 for  $n \leftarrow 1$  to  $N$  do
3   // Query for base load
4    $\mathbf{p}_{\text{base},n} \leftarrow \text{query}()$ ;
5   // Forward and undo previous schedule
6   if  $n > 1$  then
7      $\mathbf{p}_{\text{EV},u,n} \leftarrow \mathbf{p}_{\text{EV},u,n-1}(1 - \alpha)$ ;
8   else
9      $\mathbf{p}_{\text{EV},u,n} \leftarrow [0, 0, \dots, 0]$ ;
10  end
11  // Determine unallocated energy
12   $\hat{E}_{u,n} = E_u - \sum_{\tau=1}^{T_{\text{sch}}} p_{\text{EV},u,n}(\tau) \Delta t$ ;
13  // Fill valley
14  for  $\tau \leftarrow \text{argmin}(\mathbf{p}_{\text{base},n})$  to  $\text{argmax}(\mathbf{p}_{\text{base},n})$  do
15    if  $p_{\text{EV},u,n}(\tau) + \frac{\hat{E}_{u,n}}{\Delta t} \beta \leq P_{\text{max},u}$  then
16       $p_{\text{EV},u,n}(\tau) \leftarrow p_{\text{EV},u,n}(\tau) + \frac{\hat{E}_{u,n}}{\Delta t} \beta$ ;
17    else
18       $p_{\text{EV},u,n}(\tau) \leftarrow P_{\text{max},u}$ ;
19    end
20     $\hat{E}_{u,n} = E_u - \sum_{\tau=1}^{T_{\text{sch}}} p_{\text{EV},u,n}(\tau) \Delta t$ ;
21    // Once EV profile is found, send update
22    if  $\hat{E}_{u,n} = 0$  then
23       $\text{update}(\mathbf{p}_{\text{EV},u,n})$ ;
24       $\text{break}()$ ;
25    end
26  end
27   $\text{synchronising}()$ ;
28 end

```

Algorithm 1: Robust valley filling algorithm for a single EV in the synchronised case

5.3 Distributed Systems

As discussed in the literature review in Chapter 2 several mechanisms exist to decentralise control of DERs. For their reactivity, pro-activeness, social ability and flexibility however, the Multi Agent System (MAS) distinguished itself from traditional software and hardware systems which is why it was also chosen for the coordination of this smart EV charging. Several agent package implementations exist where each follows a different interaction paradigm. Some of these paradigms include “Belief, Desire and Intention” (BDI), neutral behaviour or other specialised functionality [202]. From the catalogue of MAS paradigms the Java Agent Development Framework (JADE) was chosen since it natively implements the Foundation for Intelligent Physical Agent (FIPA) specification [203,204]. Furthermore, JADE is an application independent package that has become quite popular as seen by the increasing number of publications (for example [46,205–208]).

In this work multiple virtual trading agents are used to negotiate their corresponding EV charging profile with other trading agents. Tying virtual agents to a physical entity is not new [166,209–211] and allows a clear decoupling of the data storing entities from the interacting entities. In previous work however, physical agents directly controlled the virtual entities whilst the agents in the presented work negotiate schedules that will be applied after schedule ratification. Therefore, the physical agent is never notified of any intermediate charging profile and only receives the final schedule (i.e. scheduling is delegated to a broker). Scheduling and inter-agent communication is achieved by so called “broker” agents that follow the Brokering Interaction Protocol (BIP) to serve the final charging profile when it is requested. It is those broker agents that communicate and negotiate with each other by following the Contact-Net Protocol (CNP). All these FIPA protocols are based on the FIPA Agent Communication Language (ACL) that is required to communicate over a shared telecommunication infrastructure since it standardises the communication ontology and schemas. Follow-

ing this standard also opens the possibility of including different agent packages into the scheduling mechanism, but this lies outside the scope of this thesis. Explanations of all protocols that were used in this implementation of FIPA agents also lie outside the scope of this thesis, but for completeness they are included in Appendix B. In this work, each broker is linked to a single EV and negotiates its charging profile over the aforementioned scheduling horizon (i.e. T_{sch}). This link is shown in Figure 5.3.

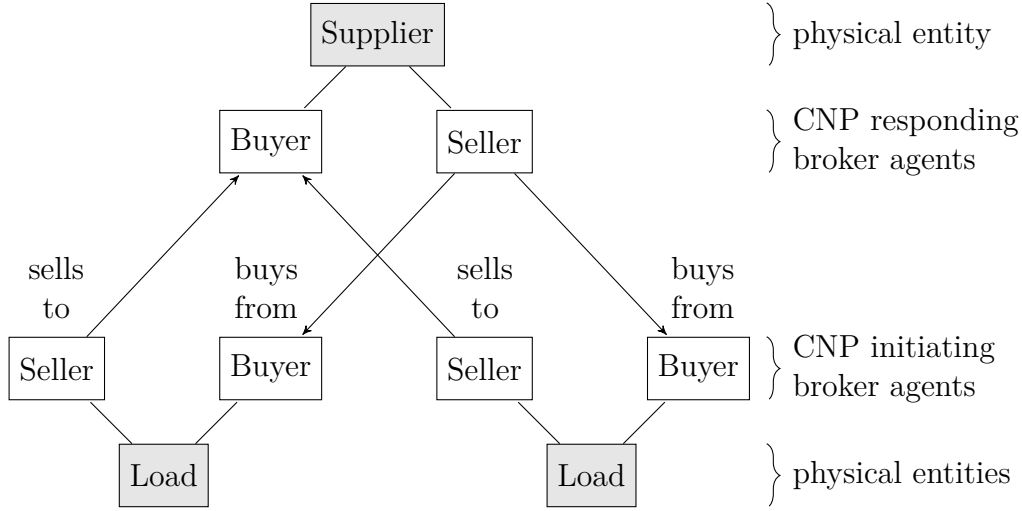


Figure 5.3: A simplified MAS structure containing virtual seller and buyer agents (white), that negotiate power/charging profiles for physical entities (grey).

The example in Figure 5.3 shows the structure of a MAS with three physical agents and six virtual agents. A supplier and two loads are the physical agents that each dispatch two brokers. One of the brokers buys energy (i.e. “allocating” energy to the profile) and the other one sells energy (i.e. “undoing” energy from the profile). With this kind of system architecture the scheduling algorithm can be executed to mitigate the potential EV charging spikes.

How this MAS is implemented, synchronised and desynchronised is explained in the following sections, Section 5.3.1 and Section 5.3.2, respectively. Subsequently, in Section 5.3.3, all case studies and performance metrics that are used to assess the MAS performance are outlined.

5.3.1 MAS Implementation

The MAS is implemented in Java and runs on a parallel compute cluster (i.e. the *HTCondor* cluster at the former *School of Systems Engineering* at the *University of Reading*). How the compute cluster was used to realise multiple agents is shown in Figure 5.4.

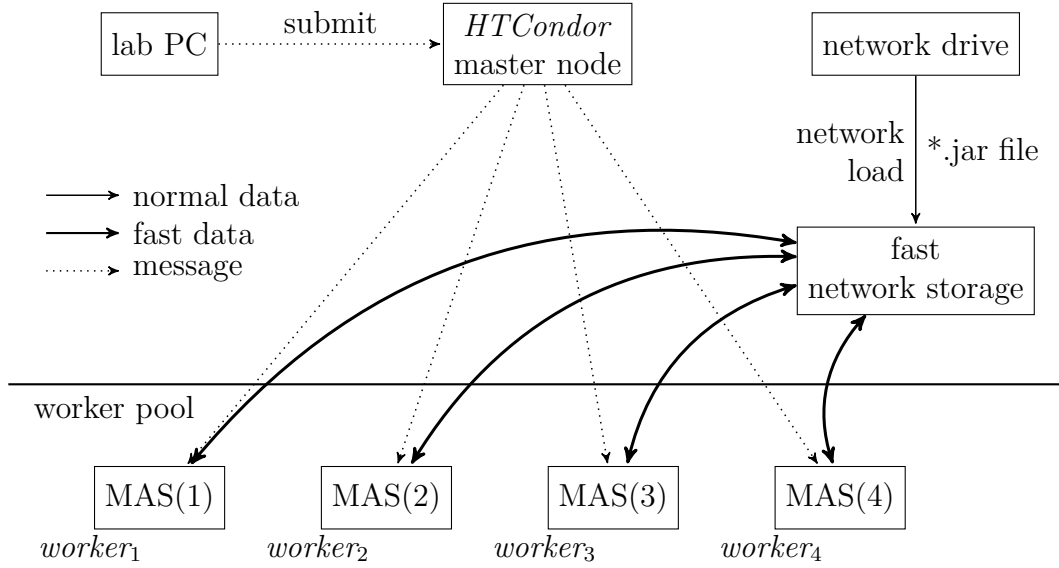


Figure 5.4: The implementation of FIPA on *HTCondor*.

In this figure, Figure 5.4 a collection of MAS simulations is compiled in order to extensively cover the algorithm’s operating spectrum. This compilation is done at the laboratory workstation. More specifically, 10000 repetitions of the scheduling algorithm are queued for a single baseline load, but with different α and β parameters. Therefore, the algorithm’s parameter sensitivity is probed at a resolution of 0.01 for both α and β (i.e. $\alpha \in \{0.01, 0.02, \dots, 1.00\}$ and $\beta \in \{0.01, 0.02, \dots, 1.00\}$). This queue of 10000 simulations is then submitted to the *HTCondor* master node which schedules the execution of each simulation to its pool of workers. Each worker internally simulates an instance of the MAS and stores its outputs to a fast networked storage which also serves as the worker’s data source. The Irish dataset [201] comprising several weeks of uninterrupted power data is used since it also provides 1540

different half-hourly load profiles. Given this large number of load profiles, provided from the Irish dataset, and assuming a typical distribution network of 55 customers, a theoretical limit of 6.11×10^{101} simulations would exist. Due to the limited time and size of the available worker pool (ca. 200 workers), a total number of 1.5×10^7 MAS simulations is chosen to yield a sufficiently accurate estimate of the algorithm's performance. For all submitted simulations a relatively high EV uptake of 20% was chosen in order to maximise the effect of badly scheduled EV charging and in order to give the algorithm a larger energy volume when adjusting the EV charging schedules. Also, in the diagram in Figure 5.4, all bold arrows indicate data transmissions that are faster than the lab PC connection (this connection is used to acquire and store the datasets that are used for each MAS simulation), solid arrow indicates the loading of simulation data and the dotted arrows indicate the software messages to submit and launch the MAS simulations.

5.3.2 MAS Desynchronisation

Originally the smart-charging algorithm was intended to run in a synchronised MAS environment as shown in Figure 5.1. However, when aiming to desynchronise this operation two distinct ways exist: Either any idle state that is interrupted by the synchronising signal (which is shown in Figure 5.1) is removed and agent execution continues immediately or agents are launched with a random jitter and operate in an execution loop with a fixed time delay. Although the first approach would result in the quickest simulation execution, it still would require a synchronised start since one agent would already finish all algorithm iterations by the time a second agent joins the MAS. Therefore, only the second way yields a truly desynchronised and simultaneous execution of all agents (i.e. guaranteeing that all agents partake in the scheduling process). Furthermore, using this jitter and therefore extending the execution time of each simulation makes the algorithm compliant with the compute cluster's terms of

usage since it would otherwise threaten to overload *HTCondor* by having to manage the submission and data transfer between all workers at once.

In order to implement the second way of desynchronising agents, each agent is equipped with its individual loop timer that regulates its execution behaviour. All agents are launched in quick succession and immediately begin their enumeration and scheduling tasks. Desynchronisation amongst all agents is then achieved by introducing a jitter to both the agents' loop timers and the period between successive agent launches. The resulting MAS then consisted of a completely desynchronised collection of agents (i.e. none of the agent's loop execution is aligned or dependent on any other agent's loop execution). An example of this desynchronisation mechanism is presented in Figure 5.5.

From Figure 5.5 the successful desynchronisation can be observed since the supplier never receives more than one message at a time. Whilst the synchronised and desynchronised algorithm implementation do not differ in the scheduling method, their updating procedure does distinguish them. More specifically, for the synchronised implementation the algorithm obtains the complete demand (i.e. Equ. 5.2) after all EVs have sent their updated charging profiles. The desynchronised implementation on the other hand receives intermittent updates of the network demand. To investigate the difference in performance a set of cases and performance metrics are defined in the following section, Section 5.3.3.

5.3.3 Cases and Performance Metrics

A set of load profiles is assessed with three different configurations:

1. Synchronised algorithm execution
2. Desynchronised algorithm execution with regular loop delays
3. Desynchronised algorithm execution with irregular loop delays

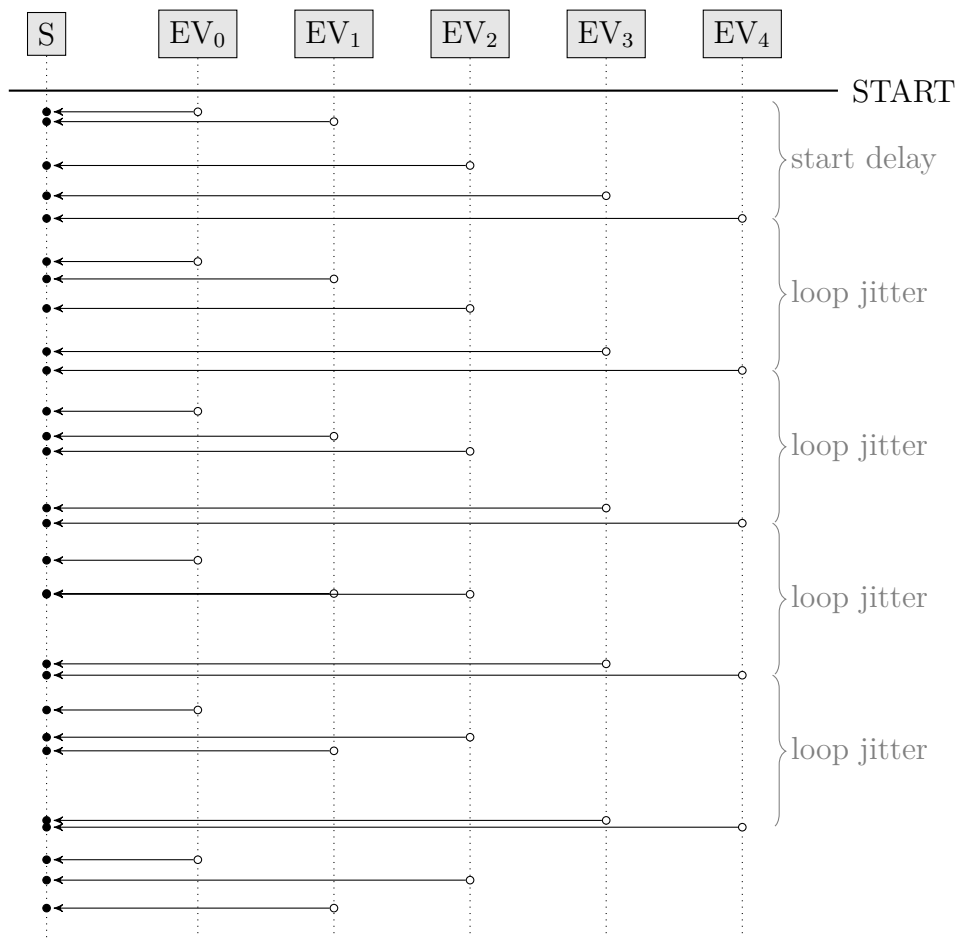


Figure 5.5: Example of agent desynchronisation when running through algorithm iterations in their respective execution loop. Here, communication events are in quick succession, but never at the exact same time.

For each load profile 10000 MASs are simulated to cover a high range of α and β parameter pairs. In this context each simulation is seen as an individual case study. Therefore each case study executes up to 100 iterations after which the smart-charging algorithm terminates. Throughout the progress of executing the algorithm every EV's charging profile is recorded for each iteration. Also, when the simulation terminates the final aggregated charging profile is also recorded. Therefore, an information on the development of the total demand profile can be obtained for every single algorithm iteration. The performance of the algorithm is then determined by assessing the shape of the resulting demand profile by using the Peak-to-Average Ratio (PAR) and the Transient power metric (TRA).

Similar to the previous chapters (i.e. Chapter 3 and Chapter 4) the PAR and TRA values are used as performance metrics for the demand profile. There two metrics, respectively $\zeta^{\text{PAR}}(\mathbf{p}_n^{\text{net}})$ and $\zeta^{\text{TRA}}(\mathbf{p}_n^{\text{net}})$, have already been defined in those preceding chapters. Here, $\mathbf{p}_n^{\text{net}}$ denotes the total network demand (i.e. $\mathbf{p}_n^{\text{net}} = \mathbf{p}^{\text{base}} + \sum_{u=1}^U \mathbf{p}_{u,n}^{\text{EV}}$) for algorithm iteration n and as a reminder the two parameter definitions are included in Equation 5.7 and Equation 5.8, respectively.

$$\zeta^{\text{PAR}}(\mathbf{p}_n^{\text{net}}) := \left(\frac{\max_t(\mathbf{p}_n^{\text{net}})}{\frac{1}{T} \sum_{t=0}^T p_n^{\text{net}}(t)} \right)^2 \text{ where } \mathbf{p}_n^{\text{net}} = (p_n^{\text{net}}(t)) \quad (5.7)$$

$$\zeta^{\text{TRA}}(\mathbf{p}_n^{\text{net}}) := \sqrt{\frac{1}{N-1} \sum_{n=1}^{N-1} (p_{n+1}^{\text{net}} - p_n^{\text{net}})^2} \text{ where } \mathbf{p}_n^{\text{net}} = (p_n^{\text{net}}(t)) \quad (5.8)$$

If the proposed scheduling algorithm successfully fills valleys and avoid adding new charging peaks then the gap between mean and maximum demand reduces and ζ^{PAR} in Equation 5.7 tends towards one. At this point one might assume a perfectly flat demand profile. However, if the total charging power of all EVs constructively superimposes at the same time and if this additional power does not increase the daily demand peak then ζ^{PAR} would still decrease despite the unwanted demand shape. Therefore, the change in power (i.e. the mean transient) is also taken into account

in Equation 5.8 with ζ^{TRA} . This value is only lowered when the change in power between consecutive time-steps is reduced and thus the profile becomes smooth.

When the scheduling algorithm was detailed in Section 5.2.3, convergence for the synchronised case was guaranteed since the algorithm follows the D'Alembert Criterion. This criterion holds if the ratio between the metrics for the current and previous algorithm outputs (i.e. from Algorithm 1) is less than one or; as long as these values are decreasing for every successive algorithm iteration. Formally, this criterion is satisfied when

$$\lim_{n \rightarrow \infty} \frac{|\zeta^{\text{PAR}}(\mathbf{p}_n^{\text{net}})|}{|\zeta^{\text{PAR}}(\mathbf{p}_{n-1}^{\text{net}})|} < 1 \text{ where } n \geq 2 \text{ and } \zeta^{\text{PAR}}(\mathbf{p}_n^{\text{net}}) \neq 0 \quad (5.9)$$

and

$$\lim_{n \rightarrow \infty} \frac{|\zeta^{\text{TRA}}(\mathbf{p}_n^{\text{net}})|}{|\zeta^{\text{TRA}}(\mathbf{p}_{n-1}^{\text{net}})|} < 1 \text{ where } n \geq 2 \text{ and } \zeta^{\text{TRA}}(\mathbf{p}_n^{\text{net}}) \neq 0 \quad (5.10)$$

These two convergence criteria in Equation 5.9 and Equation 5.10 are limited to values of ζ^{PAR} and ζ^{TRA} greater than zero. ζ^{PAR} satisfies this criterium since the ratio between maximum and mean can only reduce to a value of one. ζ^{TRA} on the other hand may reduce to a value of zero. To prevent this from happening, the number of EVs and their total demand are limited to a value that could not fully “fill” the network demand’s valleys and lead to a perfectly flat demand profile.

Although the chosen D'Alembert Criterion can be used to validate whether the smart-charging algorithm converges, it cannot produce the rate of convergence. Instead the rate of convergence is determined by an exponential decay function (for example similar to Laplace). Since the underlying mathematical function is unknown, an estimated exponential is used instead. The estimate is obtained by fitting an exponential function to the series of ζ^{PAR} and ζ^{TRA} values over all iterations, and by using the following definition of a simple exponential function:

$$f_n(a, b) = ae^{-bn} \text{ where } a \in \mathbb{R}^{>0} \text{ and } b \in \mathbb{R}^{>0} \quad (5.11)$$

In Equation 5.7 a is the zero-crossing point of this function and b the rate of convergence. The size of b indicates how fast the values converged which is why b is used as a convergence indicator. Values for a and b are found by reducing the error between the exponential function and the series of ζ^{PAR} or ζ^{TRA} values, i.e.:

$$\min_{a,b} \sum_{n=1}^N \left| \left(\zeta_{\text{PAR}}(\mathbf{p}_n) - \min(\zeta^{\text{PAR}}(\mathbf{p})) \right) - f_n(a, b) \right| \quad (5.12)$$

and

$$\min_{a,b} \sum_{n=1}^N \left| \left(\zeta_{\text{TRA}}(\mathbf{p}_n) - \min(\zeta^{\text{TRA}}(\mathbf{p})) \right) - f_n(a, b) \right| \quad (5.13)$$

It is however worth mentioning that the condition is not satisfied when $\alpha = 1$ and $\beta = 1$ since in this case an algorithm behaviour is expected where each EV's demand is oscillating between a set of profile troughs. A similar behaviour has already been observed by Karfopoulos et al. in [46] which is why the main part of the results in this chapter study values where α and β are not one at the same time.

Results are split into three subsections. In the first subsection, results are presented for the time-series evolution when using the algorithm in a synchronised MAS. Different α and β values are used to explore and show the sensitivity of the algorithm. With this in mind the corresponding ζ^{PAR} and ζ^{TRA} values are presented to show their link to the underlying load profile's shape and their convergence values (i.e. b is also presented). In the end, a complete set of final ζ^{PAR} and ζ^{TRA} values, as well as their convergence values, b , are plotted for the entire spectrum of α and β pairs. This is to show the sensitivity of the algorithm for the complete range of α and β .

The second subsection then introduces algorithm desynchronisation, but with reg-

ular loop delays. Then the complete analysis (i.e. as performed for the first subsection) is repeated for the results in this second subsection, in order to compare them with the results in the previous subsection.

In the third and last subsection, the algorithm desynchronisation is changed so that the algorithm's loop delays are irregular. All results are once again compared to the preceding two subsection of the results by following the same analysis.

5.4 Results and Discussion

5.4.1 Algorithm performance for synchronised operation

The objective of the smart-charging algorithm is to distribute the charging demand of a fleet of EVs over the underlying baseline load in such a way that no additional demand spikes are produced. After assigning each EV's energy demand to its initially known demand trough, the algorithm produces a new demand spike since all EVs are charging simultaneously. Through repetitive iterations and reallocating a portion of the assigned energy to different demand troughs, the algorithm is then able to spread all EVs' demands to form a flat demand profile in the end. This process is shown in Figure 5.6.

Here, the first algorithm iteration is shown in Figure 5.6a, where allocated power profile produces two new morning spikes of around 200kW and subsequently 110kW. The second iteration however reduces these spikes by the factor α (i.e 0.2) and redistributes the undone charging powers over the new power profile. Figure 5.6b shows this reduction and reallocation. Figure 5.6c is the third iteration that reduces and redistributes the peaks even further. In the end (i.e. when $n = 100$) the resulting power profile becomes as flat as possible which is shown in Figure 5.6d. Throughout these iterations, it can be observed how the peak load in the total power (i.e. \mathbf{p}_n) reduces and it can be observed how the changes in charging power (i.e. $\mathbf{p}_{n+1} - \mathbf{p}_n$)

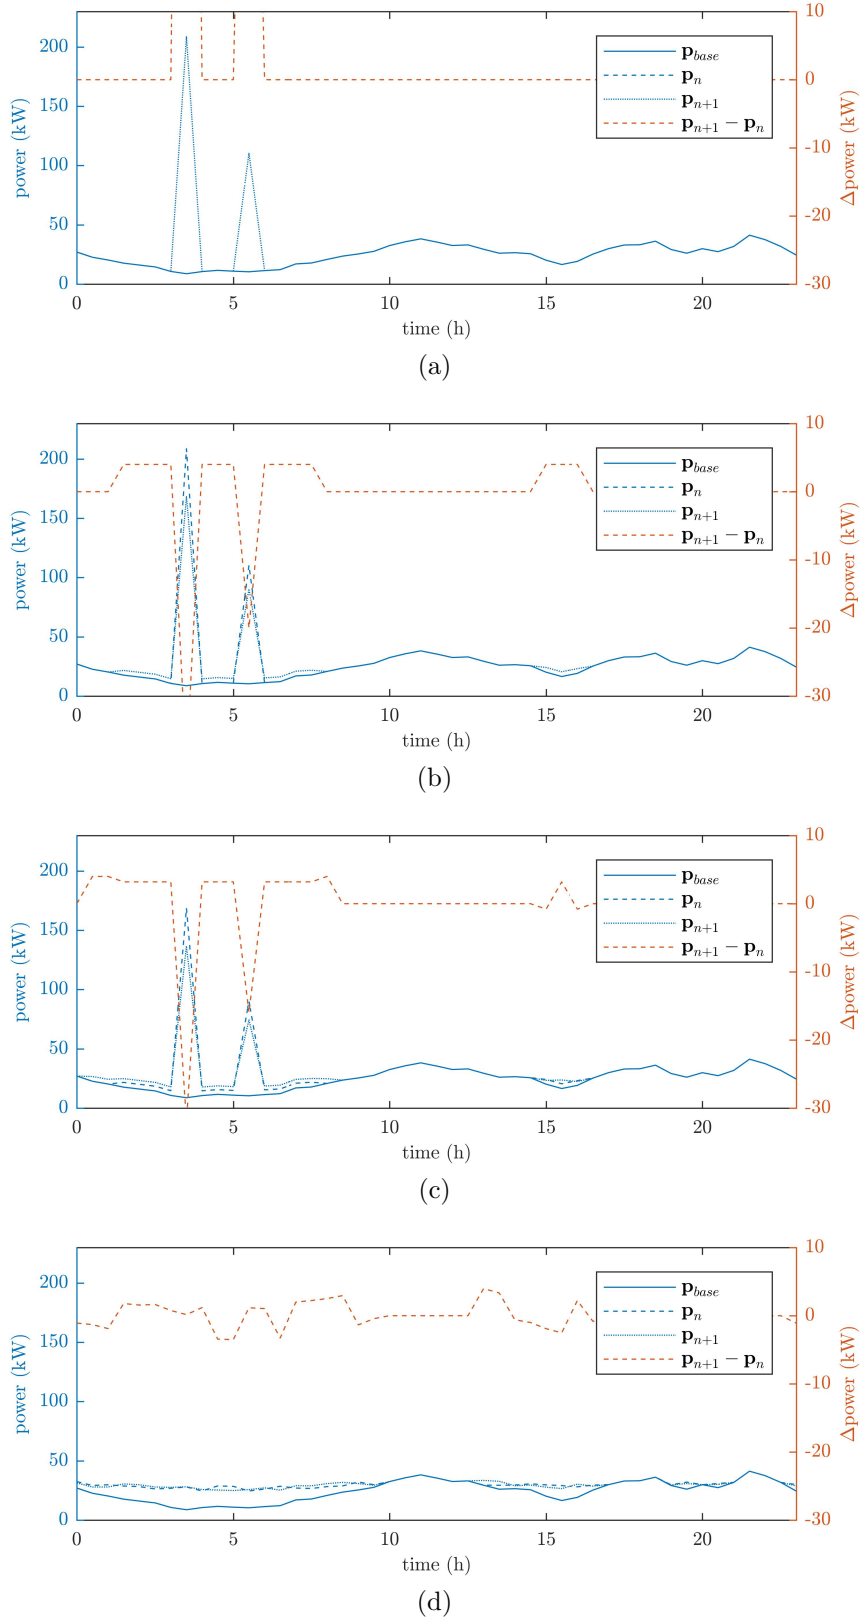


Figure 5.6: Synchronised time series evolution for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.

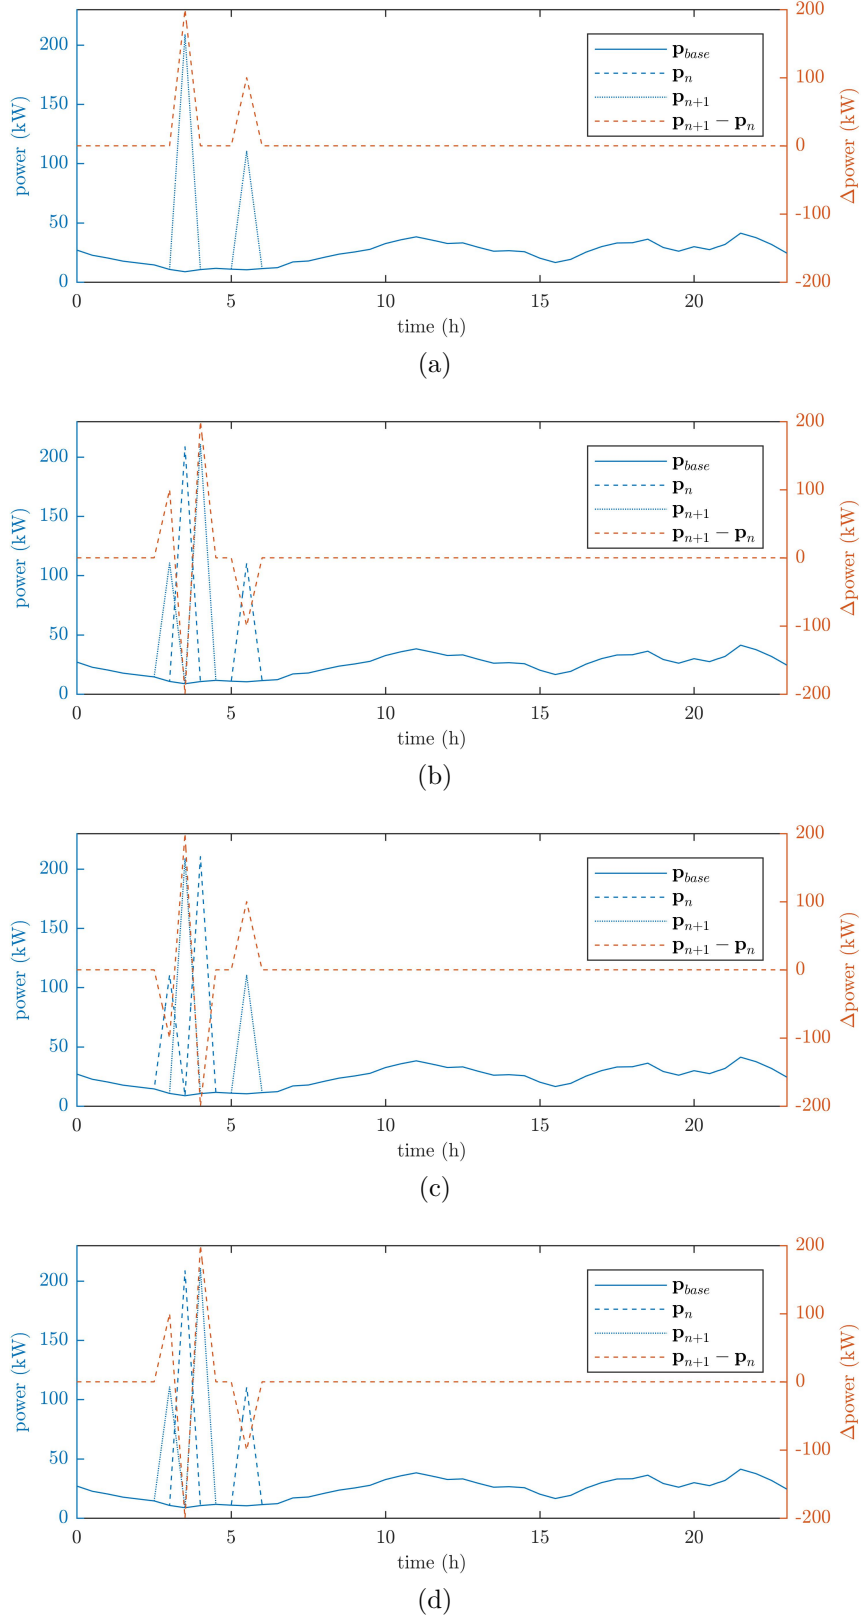


Figure 5.7: Synchronised time series evolution for $\alpha = 1.00$ and $\beta = 1.00$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.

reduce in variance, which indicates that the algorithm works for the chosen parameters of α and β . However, different parameters of α and β do impact the performance of this synchronised algorithm execution as shown in Figure 5.7.

iteration (n)	$\alpha = 0.02$ and $\beta = 0.20$		$\alpha = 1.00$ and $\beta = 1.00$	
	ζ^{PAR}	ζ^{TRA}	ζ^{PAR}	ζ^{TRA}
1	46.84	45.86	46.84	45.86
2	30.61	35.54	47.66	46.26
3	20.10	27.31	46.84	45.86
4	13.28	20.75	47.66	46.26
5	8.83	15.56	46.84	45.86
6	5.93	11.41	47.66	46.26
7	4.02	8.20	46.84	45.86
8	2.76	5.83	47.66	46.26
9	1.92	4.24	46.84	45.86
10	1.83	3.22	47.66	46.26
\vdots	\vdots	\vdots	\vdots	\vdots
100	1.83	2.72	47.66	46.26
convergence (b)	0.47	0.32	0.00	0.00

Table 5.1: Comparison of ζ^{PAR} and ζ^{TRA} for two α and β parameter pairs as shown in Figure 5.7 and Figure 5.6. Each value per iteration n and the convergence b is shown.

Whereas the α and β parameters use to produce the results in Figure 5.6 reduced the power spike, those parameters in 5.7 where $\alpha = \beta = 1.0$ did not. In fact, an oscillating behaviour can be observed since the initially applied power profile is completely undone and completely reassigned onto a different demand trough. Since this produces similar peaks, the same procedure repeats and reassigns the complete power profile back to the original demand troughs. In the end, these charging spikes can never be fully mitigated and the algorithm did not smoothen the total demand. The resulting charging spike of more than 200kW could therefore cause significant issues if the underlying physical network has not been scaled appropriately, for example. This longevity of issue becomes more evident when comparing the ζ^{PAR} and ζ^{TRA} values for both parameter pairs. The evolution of ζ^{PAR} and ζ^{TRA} , as tabulated in Table 5.1,

shows this difference in performance and convergence of the algorithm when subjected to different values of α and β . Those figures indicate that a well chosen pair of α and β results in a convergence value (i.e. b) that is greater than zero. No convergence occurred however for those values of α and β that resulted in the oscillating behaviour (i.e. convergence rate b is zero).

Next, the entire range of α and β needed to be studied since different parameter pairs are likely to result in different convergence rates (and therefore different algorithm performance). These results (i.e. for the synchronised algorithm performance) are plotted in Figure 5.8.

Figure 5.8a and Figure 5.8c show how the final values for both ζ^{PAR} and ζ^{TRA} were lowest when either α or β was chosen closer to zero. This result coincides with the finding that hard reduction and reallocation lead to an oscillating behaviour of the algorithm. Similarly, the convergence of those two performance metrics, as shown in Figure 5.8b and Figure 5.8d, was highest when α approached one and β approached zero. This behaviour is by design since a larger value of α increases the rate at which the currently applied peak is reduced whilst a smaller value of β limits the amount that can be reallocated for each time slot. Such a clear difference in behaviour for different pairs of α and β indicates an optimal operation region of the algorithm within the top right quadrant of the plot. This quadrant indicates optimal operation since low ζ_{PAR} and ζ_{TRA} values are achieved (see Fig. 5.8a and Fig. 5.8c) at a relatively high rate of convergence (see Fig. 5.8b and Fig. 5.8d). Whether the algorithm still performs in this way when introducing desynchronisation is answered in the subsequent section, Section 5.4.2.

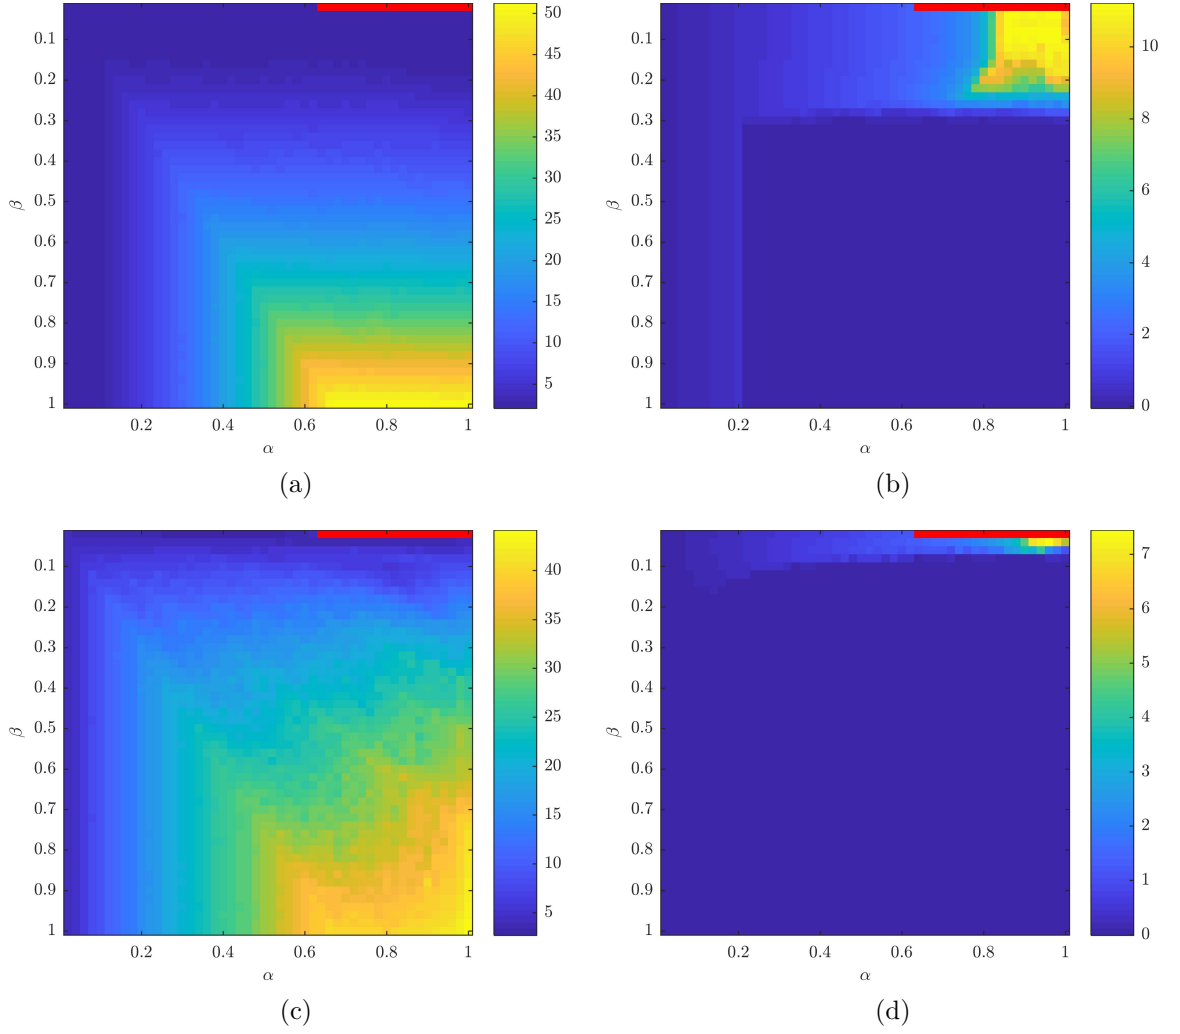


Figure 5.8: Full range analysis of α and β for the synchronised MAS where, (a) shows the final ζ_{PAR} , (b) shows the convergence, b , for ζ_{PAR} , (c) shows the final ζ_{TRA} , and (d) shows the convergence, b , for ζ_{TRA} (red indicates missing data).

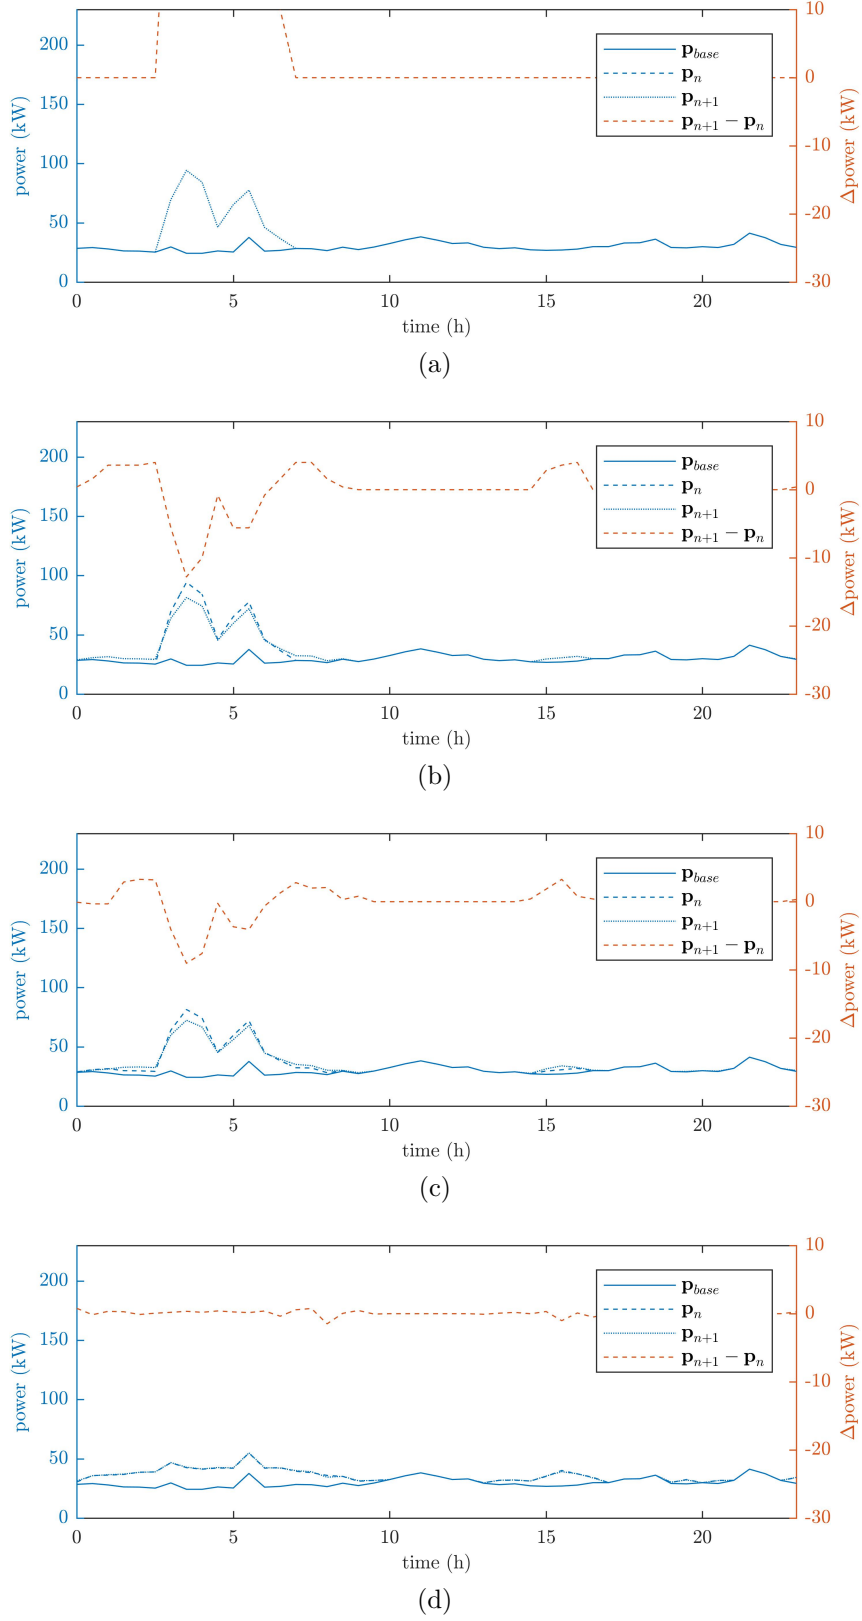


Figure 5.9: Desynchronised time series evolution for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.

5.4.2 Algorithm performance for desynchronised operation with regular timing

Looking at the evolution of the time-series when desynchronising the algorithm's execution shows significant differences already. Figure 5.9 shows this evolution for the same parameters as those chosen for Figure 5.6. The difference is however that the assignment of charging powers lead to a significantly lower demand spike at the very beginning of executing the algorithm. Subsequent iterations then reduce this spike much broader than it has been the case when executing the algorithm in a synchronised manner. Therefore, more demand troughs are filled and a smoother profile is obtained in comparison to sub-optimal pairs of α and β . It should however be noted that the valley filling is not as effective, but much quicker, when compared to the same synchronised case. After all, the initial power spike already reduced to below 100kW, whilst the synchronised cases always started at peaks above 200kW.

This behaviour becomes particularly apparent when looking at the full range of α and β values. Figure 5.10 shows the same full range analysis as the figure in the previous section did, i.e. Figure 5.8. When comparing them at the same scale, ζ^{PAR} and ζ^{TRA} values (plotted in Figure 5.10a and Figure 5.10c, respectively) have significantly lowered in magnitude. This indicates a much better performance of the algorithm across the entire range of α and β parameters. Convergence rates (i.e. plotted in Figure 5.10b and Figure 5.10d) were however not impacted to the same extend. This indicates that the underlying execution of the algorithm still performs as intended, but the interplay between the agents that implement this algorithm changes the outcome of the aggregated result.

The next step is to assess whether desynchronising the algorithm's execution by randomising the loop delays yields any further changes in algorithm performance and behaviour. Results from that step are presented in the following section, Section 5.4.3.

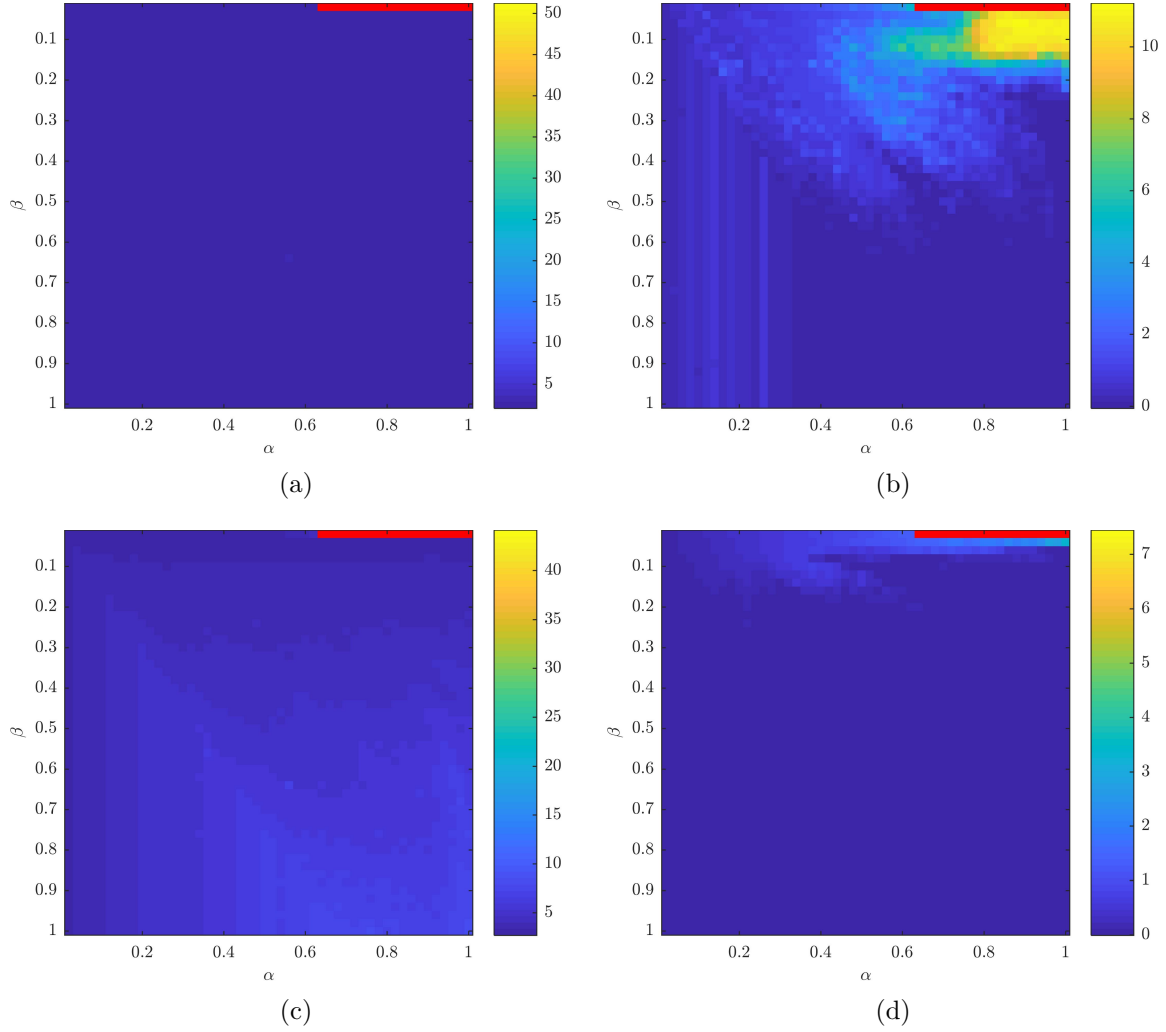


Figure 5.10: Full range analysis of α and β for the desynchronised MAS where, (a) shows the final ζ^{PAR} , (b) shows the convergence, b , for ζ^{PAR} , (c) shows the final ζ^{TRA} , and (d) shows the convergence, b , for ζ^{TRA} (red indicates missing data).

5.4.3 Algorithm performance for desynchronised operation with irregular timing

As shown in Figure 5.11, the difference between regular and irregular loop delays when executing the smart-charging algorithm is barely noticeable. The interlaced querying still causes each agent to react to a slightly different network demand profile which results in a varied power profile allocation. A functioning peak reduction behaviour is therefore a positive sign since this irregular algorithm desynchronisation (as introduced in Section 5.3.2) represents the worst algorithm deployment scenario. Performance and convergence do however need to be inspected for the complete range of α and β values so that the results can be compared to the previous findings.

Figure 5.12 shows the results for this range of α and β values when executing the algorithm on a desynchronised MAS with irregular loop delays. The values for ζ^{PAR} and ζ^{TRA} are still significantly lower than they were for the synchronised case, but they do not differ much from the regular desynchronisation case. The same is true when comparing convergence which indicates that the algorithm's underlying execution still performs as intended.

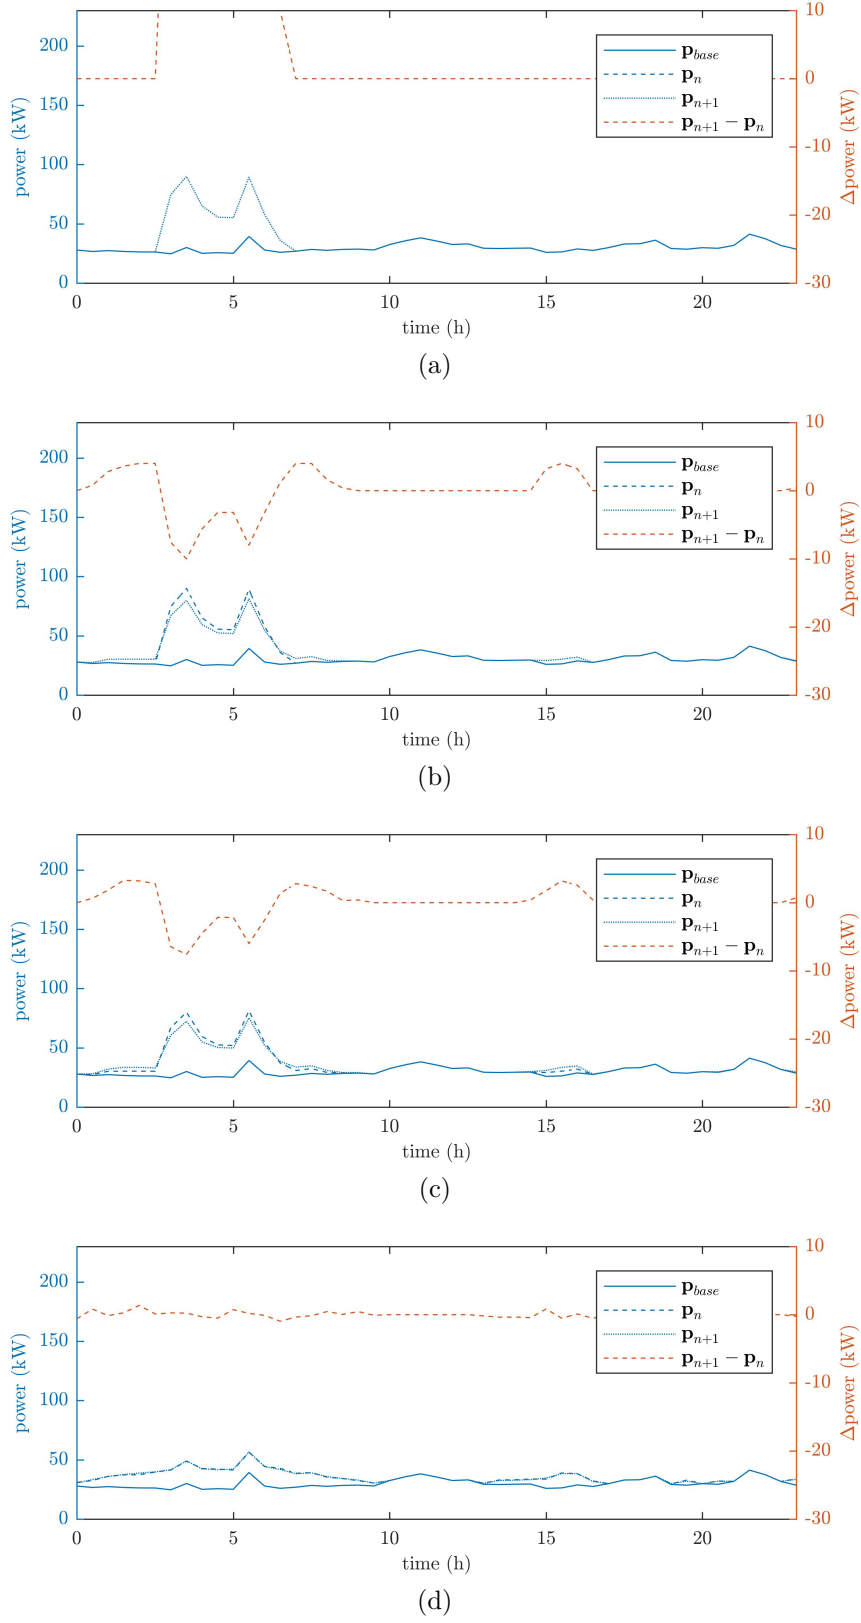


Figure 5.11: Desynchronised time series evolution when using irregular loop delays for $\alpha = 0.02$ and $\beta = 0.20$, where (a) is at $n = 1$, (b) is at $n = 2$, (c) is at $n = 3$, and (d) is at $n = N - 1$.

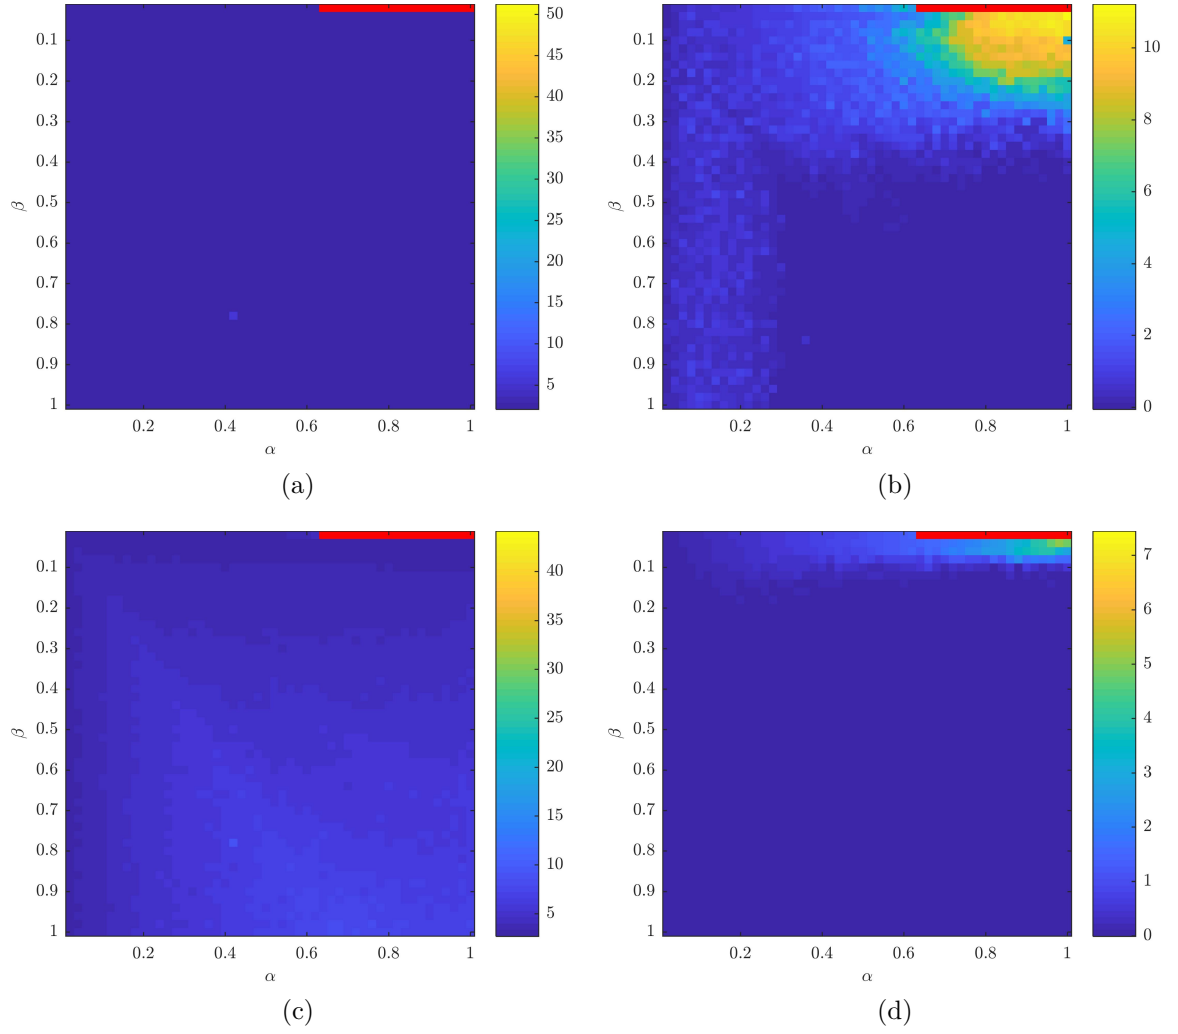


Figure 5.12: Full range analysis of α and β for the desynchronised MAS with irregular loop delays where, (a) shows the final ζ^{PAR} , (b) shows the convergence, b , for ζ^{PAR} , (c) shows the final ζ^{TRA} , and (d) shows the convergence, b , for ζ^{TRA} (red indicates missing data).

5.5 Summary

When designing a smart-charging algorithm to distribute the EV load over the entire day and thus avoid new demand spikes, coordination between EVs is usually achieved by the means of ICT. In this chapter, Chapter 5, such an algorithm was developed to assure that the coordinated charging of an EV fleet does not add a new demand spike onto the base power profile. This algorithm was then deployed on a MAS and controlled using two parameters, i.e. α and β , that allowed each agent to, respectively, undo and reassign a certain amount of its charging profile. By repeating this behaviour of undoing and reassigning fractions of the charging profile, agents were able to respond to each other and avoid simultaneous charging actions. Two performance metrics (i.e. ζ^{PAR} and ζ^{TRA}) indicated the spikiness and volatility of the final power profile. Reducing these metrics is therefore the key function of the smart-charging algorithm, despite the fact that the algorithm is not metric dependent or metric driven.

Originally, the presented smart-charging algorithm was designed for synchronised MAS execution which means that all agents obtain a network update to calculate their charging profile at exactly the same time. For properly chosen values of α and β , this resulted in an algorithm convergence in accordance to the D'Alembert Criterion which was explained in Section 5.3.3. Extreme control parameters (i.e. where $\alpha = 1.0$ and $\beta = 1.0$) resulted in an oscillating behaviour where an aggregated charging spike of more than 200kW would continue to persist. This persistence led to the conclusions that the underlying scheduling algorithm is highly dependent on a correct choice of values for α and β . The dependence on these control parameters is however significantly reduced when desynchronising the agent communication (i.e. compared to the synchronised execution of the algorithm). In fact regular and irregular desynchronisation yielded much lower values for ζ^{PAR} and ζ^{TRA} as seen in Section 5.4.2 and Section 5.4.3. For example, in the synchronised case ζ^{PAR} converged to a value

below 5 after 100 algorithm iterations if the control parameters were chosen for $\alpha < 0.2$ or $\beta < 0.1$. The desynchronised execution however showed that after 100 algorithm iterations ζ^{PAR} values always reach a value below 5.

The rate of convergence towards these final performance values on the other hand did maintain a similar distribution to the synchronised algorithm execution despite the difference in MAS execution behaviour. Therefore, the algorithm's valley-filling behaviour was still upheld, yet the interplay between agents that implement this algorithm significantly changed the outcome of the aggregated result. This work thus completes **Objective 3** of this thesis (which was outlined in Section 1.2) since it shows the capabilities of a smart-charging algorithm and highlights the importance of considering agent de/synchronisation when developing a multi-controller DSM network. Such findings are especially relevant due to the inherent difficulty and cost associated with the synchronisation of a distributed control system. More specifically, synchronisation becomes particularly difficult when the network size and number of controllers increases. With lightweight algorithms like the one proposed in this chapter synchronisation can be neglected without sacrificing algorithm performance. Nonetheless, this finding is true for any smart algorithm as long as the algorithm is studied in both a synchronised and desynchronised test environment; which is however done very seldom. This inherent difficulty of designing and implementing any smart algorithm with ICT would thus raise the question if it is possible to design a cooperative algorithm that does not rely on ICT. The subsequent chapter, Chapter 6, intends to answer this question.

Chapter 6

Cooperative Battery Operation without Need for Communication Infrastructures

M. J. Zangs, P. Adams, et al., “Distributed Energy Storage Control for Dynamic Load Impact Mitigation,” Energies, vol. 9, no. 8, p. 647, August 2016

— Available: <https://dx.doi.org/10.3390/en9080647>

T. Yunusov, M. J. Zangs, et al., “Control of Energy Storage,” Energies, vol. 7, no. 10, p. 1010, July 2017

— Available: <https://doi.org/10.3390/en10071010>

6.1 Overview

In the past three chapters of this thesis on-line control methods have been developed to optimally control power injection into the LV network and to shave or prevent load peaks. Chapter 3 and Chapter 4 showed how such an on-line control can be tuned to maximise BESS impact on a three-phase LV network and how it can also minimise both daily (i.e. half-hourly) and intermittent (i.e. sub-half-hourly) demand peaks.

Then, in Chapter 5 a smart-charging algorithm was developed to mitigate charging peaks from an EV fleet. This algorithm’s communication requirements were analysed by executing it in different MAS environments where its distributed control was run in both a synchronised and desynchronise system. It was found that control methods that rely on such information exchange also rely on a stable ICT infrastructure since the impact of control parameters on the algorithm’s global performance significantly deviated from the expected smart-charging behaviour. To continue contributing towards the aim of this thesis, in this chapter, Chapter 6 the impact of charging an EV fleet is mitigated in a different communication-less approach. More specifically, this chapter addresses **Objective 4** of this thesis (which is outlined in Section 1.2) and proposes an individually tuned control algorithm for multiple household connected BESSs in order to mitigate the impact from charging EVs. As already discussed in the literature review in Chapter 2, although the adoption of EVs is often seen as the potential solution to decarbonise future transport networks, conventional charging (i.e. “dumb-charging”) is expected to dominate the domestic charging demand [183]. In the near future such a charging behaviour is expected to put the most significant burden on the power distribution network. This burden is aimed to be mitigated by the extended control of distributed BESS that is proposed in Chapter 6. More specifically, the proposed algorithm uses an individualised Set-Point Control (SPC) to regulate bi-directional battery power flow and is built upon the traditional Additive-Increase Multiplicative-Decrease (AIMD) algorithm for stability [191]. Results show how the developed battery control method reduces voltage deviation, how it reduces over-currents and how it reduces the otherwise uneven usage of deployed batteries without relying on any ICT. Equalising this uneven battery usage leads to a more homogeneous operation of all of the distributed BESSs and prevents unequal degradation rates and potentially unfair device utilisation.

The remainder of Chapter 6 is organised as follows: Section 6.2 gives some back-

ground to related work on AIMD algorithms on which this research is based. Section 6.3 outlines the EV, network and storage models used in this research. Additionally, it explains the assumptions that accommodate and justify these models. Section 6.4 elaborates on the proposed AIMD control algorithm (AIMD+). Next, Section 6.5 details the implementation and scenarios used for a set of test cases. For later comparison, this section also outlines a set of comparison metrics. Section 6.6 presents and discusses the results, followed by a chapter summary in Section 6.7.

6.2 Related Work

The main body of existing literature on communication-less control has already been covered in Section 2.4.3. Within this literature the main usage of BESS in LV distribution networks is to assure voltage security (this was addressed in Section 2.4.3 i.e. [39,110,154,155,158]). However, as also identified by Hatziargyriou et al. in [134], the underlying but strong requirement for a communication infrastructure to relay network information and control instructions still remains. Therefore this chapter presents a control algorithm that removes the need for any such BESS communication. It does so by implementing local voltage measurements with individually tuned control parameters which are used to infer the network operation from a local standpoint. The underlying coordination mechanism of each control entity is of particular importance so that conflicting device behaviour is prevented. An AIMD algorithm is perfectly suited for such coordinated control despite originating from a different research area. In this section, Section 6.2 the origin and current usage of AIMD are explained to emphasise the algorithm’s suitability and room for improvements.

Originally, AIMD algorithms were applied to congestion management in telecommunication networks using the TCP protocol [191] (i.e. to maximise utilisation while ensuring a fair allocation of data throughput amongst a number of competing

users [192]). Later, AIMD-type algorithms have also been applied to power sharing scenarios in LV distribution networks where the limited resource is the availability of power from the substation’s transformer. For EV charging, one such algorithm was initially proposed by Stüdli et al. in [193] yet this algorithm still required a one-way communication infrastructure to broadcast a “capacity event” [194, 195]. Later, their work was extended to include vehicle-to-grid applications with reactive power support [196], but the ICT requirements were still not reduced. The battery control algorithm that is proposed in this chapter thus builds upon the algorithm used by Stüdli et al. and Mareels et al. [212], where EV charging was organised by including bidirectional power flow and the use of a reference voltage profile that is derived from network model simulations. Similar to the work by Xia et al. [213] who utilised local voltage measurements to adjust the charging rate, the work presented in this chapter only uses voltage measurements at the batteries’ connection sites in order to control the batteries’ operations. However, the fact that the charging of EVs is based upon a traditional (i.e. “dumb”) charging approach and that co-located BESS is used to mitigate this charging impact differentiates the proposed algorithm from the work by Xia et al.

In summary, previous research is extended by developing the bi-directional and individually tuned BESS AIMD control algorithm since it has only utilised common set-point thresholds for controlling each of the Distributed Energy Resources (DERs). The approach proposed in this chapter ensures that unavoidable voltage drops along the feeder do not skew the global control decisions. Nonetheless, despite the robustness to voltage drop, voltage oscillations that are caused by demand variation are still taken into control considerations. Therefore, in strong contrast to previous work where substation monitoring was used to inform control units of the transformer’s present operational capacity, the proposed algorithm does not require this information and does not require such any extensive ICT infrastructure.

6.3 System Modelling

In this section, Section 6.3 the underlying assumptions to validate the research are presented. Then the EV charging model and a BESS model are explained. In the end of this section, the network models that are used to simulate the power distribution networks are presented.

6.3.1 Assumptions

Several underlying assumption were made to obtain the models that are used throughout this work :

1. The uptake of EVs is assumed to increase and, hence, to have a significant impact on the normal operation of the low voltage distribution network. This assumption is based on a well-established prediction that the majority of EV charging will take place at home [214].
2. The transition from internal combustion engine-powered vehicles to EVs is assumed to not impact the users' driving behaviour - apart from the introduction of home-charging. Similar to [215] this assumption allows the utilisation of recent vehicle mobility data [216] to generate leaving, driving and arriving probabilities, from which the EV charging demand can be determined and the resulting energy demand can be calculated.
3. The transition to low carbon technologies will increase the variability of electricity demand and therefore, grid-supporting devices such as BESS are anticipated to play a more important role [217]. Hence, alongside a high uptake of EVs an increased adoption of distributed BESS devices is assumed.
4. A realistic behaviour of BESS is also assumed since they are not 100% efficient at storing and releasing electrical energy as in [95]. Furthermore the assump-

tion is made that BESS start the simulations at 50% State of Charge (SOC). Additionally, it is assumed that BESS utilisation will degrade its energy storage capability and power performance over time as shown in [218]. Therefore, the requirements for equal and fair storage usage is of high importance.

5. It is assumed that the load profiles provided by the IEEE Power and Energy Society (PES) are sufficient as base load profiles for all simulations and capture enough realistic demand variability to generate results from which conclusions (regarding the algorithm performance) can be drawn.

6.3.2 EV charging behaviour

An empirical EV model was developed to capture the underlying driving behaviour that was captured in the publicly-available car mobility dataset named *Mobilität in Deutschland* that was published by the German Department of Transport [216] and validated by Dallinger et al. in [215]. This dataset contained three parts: the probability of starting a trip, $n_s(t)$, the probability of a weekday trip being of a certain distance, $w_{wd}(t)$, and the probability of a weekend trip being of a certain distance, $w_{we}(t)$. Both probabilities are at a 15 minutely period. The probability of starting a trip (i.e. $n_s(t)$) is approximated by three continuous normal distribution functions since it is assumed that driver behaviour is distributed normally around three key times throughout the day. These three key times are: morning time to leave home to drive to work; lunchtime to leave home to run errands; and evening time to return home. It should be noted that the naming is purely for exemplification and that this choice of three normal distributions reflects the average vehicle usage determined in the dataset [216]. However, individual driving behaviour differs from these three events, which is why the models only uses statistical representations. Therefore, and to avoid splitting the dataset into an arbitrarily large number of approximating distributions, these three daily events are chosen as a basis for the subsequent work,

and each distribution is based on the subsequent equation of a normal distribution:

$$\hat{n}_x(\beta_x, \mu_x, \sigma_x, t) := \beta_x \frac{1}{\sigma_x \sqrt{2\pi}} \exp \left[-\frac{(t/24 - \mu_x)^2}{2\sigma_x^2} \right] \quad (6.1)$$

where $t \in [0, 24]$ and $\beta_x \in \mathbb{R}$ and $\mu_x \in \mathbb{R}$ and $\sigma_x \in \mathbb{R}$

For better readability and since they are function specific constants, β_x , μ_x and σ_x are dropped from the equations within the text - i.e. $\hat{n}_x(\beta_x, \mu_x, \sigma_x, t)$ is abbreviated by $\hat{n}_x(t)$. From Equation 6.1 a probability distribution is denoted $\hat{n}_m(t)$ to represent the probability of a vehicle leaving in the morning. $\hat{n}_l(t)$ represents the probability of it leaving during lunch time and $\hat{n}_e(t)$ represents the probability of an EV leaving during the evening. If it is assumed that vehicles perform a round trip from their home to a certain location and back, then a symmetric commuting behaviour (i.e. vehicles departing in the morning return during the evening) and an equality amongst the three probabilities (i.e. a constraint) can be defined as follows:

$$0 = \int_0^{24} \hat{n}_m(\beta_m, \mu_m, \sigma_m, t) + \hat{n}_l(\beta_l, \mu_l, \sigma_l, t) - \hat{n}_e(\beta_e, \mu_e, \sigma_e, t) dt \quad (6.2)$$

To approximate the original probability of starting a trip, the difference between these three probability functions' aggregate and the original distribution (i.e. $n_s(t)$) had to be minimised. Therefore, this minimisation problem is defined as follows:

$$\begin{aligned} \min_{\beta, \mu, \sigma} & \int_0^{24} (\hat{n}_m(\beta_m, \mu_m, \sigma_m, t) + \hat{n}_l(\beta_l, \mu_l, \sigma_l, t) + \hat{n}_e(\beta_e, \mu_e, \sigma_e, t) - n_s(t))^2 dt \\ \text{s.t.} & \begin{cases} 0 = \int_0^{24} \hat{n}_m(\beta_m, \mu_m, \sigma_m, t) + \hat{n}_l(\beta_l, \mu_l, \sigma_l, t) - \hat{n}_e(\beta_e, \mu_e, \sigma_e, t) dt \\ 1 = \int_0^{24} \hat{n}_e(\beta_e, \mu_e, \sigma_e, t) dt \end{cases} \end{aligned} \quad (6.3)$$

where $\beta = \{\beta_m, \beta_l, \beta_e\}$ and $\mu = \{\mu_m, \mu_l, \mu_e\}$ and $\sigma = \{\sigma_m, \sigma_l, \sigma_e\}$

This minimisation problem was solved using a Generalised Reduced Gradient (GRG) algorithm so that the obtained parameters make the three functions fit best to the original dataset. The resulting parameters from the GRG fitting of the three distribution functions are tabulated in Table 6.1. Additionally, the resulting departure probabilities as well as the original data (i.e. $n_s(t)$) are shown in Figure 6.1 for visualisation.

Equation $\hat{n}_x(t)$	μ_x (Mean)	σ_x (SD)	β_x (Weight)
$\hat{n}_m(t)$	0.3049	0.0488	0.00206
$\hat{n}_l(t)$	0.4666	0.0829	0.00314
$\hat{n}_e(t)$	0.7042	0.0970	0.00521

Table 6.1: Parameters for normal distributions.

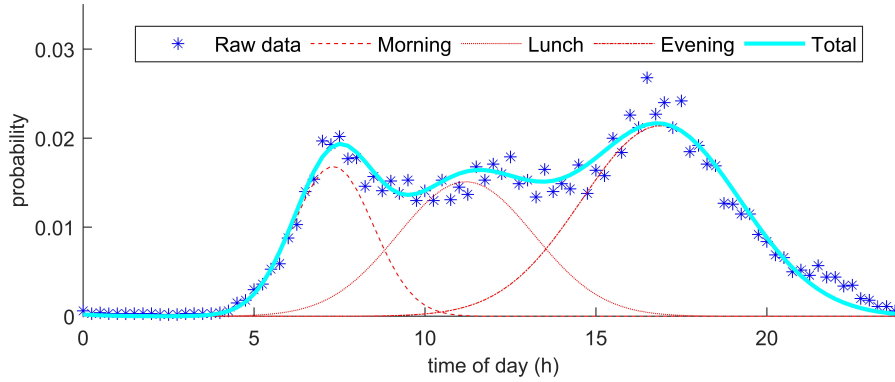


Figure 6.1: The probability of starting a trip at a particular time during a weekday, extrapolated into three normal distributions (RMS error: 9.482%).

The second statistical data (i.e. the data capturing the probability distribution of a trip being of a certain distance) was also extracted from the dataset and approximated using probability distributions. This approximation was performed for both the weekdays (i.e. $w_{wd}(d)$) and weekends (i.e. $w_{we}(d)$) data. The Weibull function was chosen to fit these probability distributions to the original data since it best suited the underlying data distribution - it is defined as follows:

$$\hat{w}_x(\gamma_x, k_x, d) := \begin{cases} \frac{k_x}{\gamma_x} \left(\frac{d}{\gamma_x}\right)^{k_x-1} \exp\left[-\left(\frac{d}{\gamma_x}\right)^{k_x}\right] & \text{if } d \geq 0 \\ 0 & \text{if } d < 0 \end{cases} \quad (6.4)$$

Similar to the approximation of the probability of starting a trip, a minimisation problem was designed to fit the two probability distributions to their original data.

$$\begin{aligned} \min_{\gamma_x, k_x} \int (\hat{w}_x(\gamma_x, k_x, d) - w_x(\gamma_x, k_x, d))^2 dd \\ \text{s.t. } 1 = \int \hat{w}_x(\gamma_x, k_x, d) dd \end{aligned} \quad (6.5)$$

This problem was also solved using the same GRG algorithm and for better readability, γ_x and k_x are dropped within the text - i.e. $\hat{\omega}_x(\gamma_x, k_x, d)$ is abbreviated by $\hat{\omega}_x(d)$. As a result, the weekday trip distance distribution, $\hat{w}_{wd}(d)$, and the weekend trip distribution, $\hat{w}_{we}(d)$, could be estimated. The computed function parameters for these two estimated distribution functions are tabulated in Table 6.2. Furthermore, their resulting probability distributions are plotted in comparison to the real data (i.e. $w_{wd}(d)$ and $w_{we}(d)$) in Figure 6.2.

Equation	$\hat{w}_x(d)$	γ_x (Scale)	k_x (Shape)
	$\hat{w}_{wd}(t)$	15.462	0.6182
	$\hat{w}_{we}(t)$	38.406	0.4653

Table 6.2: Parameters for Weibull distributions.

In addition to these probabilities an average driving speed of 56 kmh or 35 mph is taken from the *UK Government Digital Service* dataset [219] and an average driving energy consumption of 0.1305 kWh/km or 0.21 kWh per mile is used, based on a BMW i3 energy demand measured during its *New European Driving Cycle* (NEDC) [220]. Using the predicted driving distance and driving energy efficiency, it is possible to estimate an EV's energy demand upon arrival. A single EV charging profile is then estimated by starting to charge from the EV's predicted arrival time until the energy

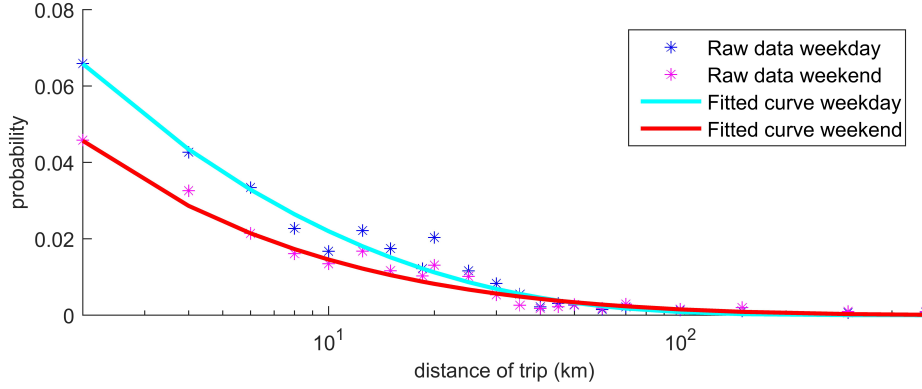


Figure 6.2: The probability of a trip being of a particular distance during a weekday, extrapolated into a Weibull distribution (RMS error: 3.791%).

demand has been met. To do so a maximum charging power of the UK's average household circuit rating (i.e. 7.4kW) and an immediate disconnection of the EV upon charge completion were assumed to comply with the guidance of the UK's *Electric Vehicle Home Charging Scheme* [221]. It is worth mentioning, that a more homogeneous energy demand can also be estimated when using different polynomial efficiency functions. However, to provide a general estimate of charging demand, using the data from a field tested vehicle is assumed sufficient for the work presented here.

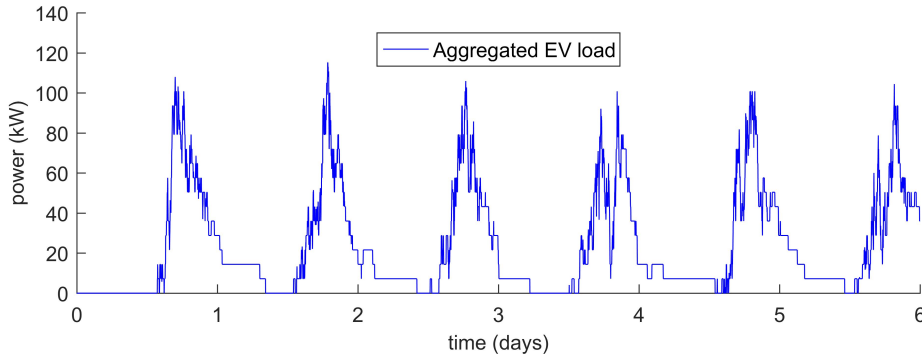


Figure 6.3: Excerpt from the aggregated 50 EVs; charging powers that were each generated from the empirical models.

Generating several of those charging profiles and aggregating them produces an estimated charging demand for an entire fleet of EVs. To provide an example, charge demand profiles for 50 EVs were generated, aggregated and plotted in Figure 6.3. This

plot shows the expected magnitude and variability in energy demand that is required to charge several EVs at consumers' homes based on the vehicles' daily usage.

This model's EV charging behaviour has been implemented to reflect EV demand if applied today without widespread smart charging infrastructure. It does therefore reflect the worst assumable charging scenario. This model's data is used to simulate additional demand in the power network which is supported by batteries whose model is detailed in the next section.

6.3.3 Battery Modelling

In this chapter a similar BESS model is used as the one that has already been introduced in Chapter 3 and in Chapter 4 of this thesis (i.e. see Section 3.3.3 and Section 4.2.1). The following paragraphs are however used as a reminder of this model for convenience. In summary, the battery model consists of a self-discharge loss (i.e. μ where $\mu \in (0, 1]$) that is dependent on the current State Of Charge (SOC) and the model contains an energy conversion efficiency (i.e. η where $\eta \in (0, 1]$) to compute the amount of energy that is lost when charging or discharging this battery.

In an ideal battery the change in SOC is determined by the battery power $p_{\text{bat}}(t)$. By sampling battery operation at a regular period (i.e. Δt) the energy transferred into the battery can be described as $p_{\text{bat}}(t)\Delta t$. The change in SOC for this ideal battery that is of capacity C is therefore defined as:

$$\Delta \text{SOC}(t) := \frac{p_{\text{bat}}(t)\Delta t}{C} = \text{SOC}(t) - \text{SOC}(t - \Delta t) \quad (6.6)$$

Next, the self-discharge loss is determined by μ and is included in this ideal battery model to represent the continual loss of energy in the battery - which is typical for chemical energy storage. This loss, $\Delta \text{SOC}_{\text{self-discharge}}$, is defined as a proportion of the most recent SOC and is determined using the self-discharge loss factor (i.e. μ) as

follows:

$$\Delta\text{SOC}_{\text{self-discharge}}(t) := \mu\text{SOC}(t) \quad (6.7)$$

Additionally, to represent the losses in the power electronics and energy conversion process, an energy conversion loss (i.e. $\Delta\text{SOC}_{\text{conversion}}(t)$) is defined next. This loss is proportional to the rate at which the battery's SOC changes. Since a difference is made between charging and discharging BESS, a “direction dependent energy conversion efficiency” (i.e. $\hat{\eta}$) is derived from η and used as follows:

$$\Delta\text{SOC}_{\text{conversion}}(t) := \hat{\eta}\Delta\text{SOC}(t) \text{ where } \hat{\eta} \in (0, 1] \quad (6.8)$$

Here, the conversion losses in the power electronics are reflected as an asymmetric efficiency that depends on the direction of the flow of energy. This is done by charging the battery at a lower power when consuming energy and discharging it more quickly when releasing energy. Mathematically, this is represented as:

$$\hat{\eta} = \begin{cases} \eta & \text{if } \Delta\text{SOC}(t) \geq 0 \\ \frac{1}{\eta} & \text{if } \Delta\text{SOC}(t) < 0 \end{cases} \text{ where } \eta \in (0, 1] \quad (6.9)$$

When substituting the self-discharge loss from Equation 6.7 (i.e. $\Delta\text{SOC}_{\text{self-discharge}}$) and conversion losses from Equation 6.8 (i.e. $\Delta\text{SOC}_{\text{conversion}}$) into the SOC evolution equation, then the full battery model (i.e. the transition from $\text{SOC}(t)$ to $\text{SOC}(t+\Delta t)$) can be derived as follows:

$$\begin{aligned} \text{SOC}(t + \Delta t) &:= \Delta\text{SOC}(t) - \Delta\text{SOC}_{\text{self-discharge}}(t) - \Delta\text{SOC}_{\text{conversion}}(t) \\ &= (1 - \mu)\Delta\text{SOC}(t) - \hat{\eta}\Delta\text{SOC}(t) \end{aligned} \quad (6.10)$$

In addition, both the SOC and the battery power (i.e. $p_{\text{bat}}(t)$) are constrained

due to the device's maximum and minimum energy storage capabilities (i.e. respectively SOC_{\max} and SOC_{\min} and maximum charge and discharge rate P_{\max}). These limitations are captured in Equations 6.11 and Equation 6.12, respectively.

$$\text{SOC}_{\min} \leq \text{SOC}(t) \leq \text{SOC}_{\max} \quad (6.11)$$

$$|p_{\text{bat}}(t)(t)| \leq P_{\max} \quad (6.12)$$

6.3.4 Network Models

Similar to Chapter 3 of this thesis, the Open Distribution System Simulator (OpenDSS) that is developed by the Electronic Power Research Institute (EPRI) was used in order to simulate the LV energy distribution networks. It requires element-based network models including line, load and transformer information to generate realistic power flow results.

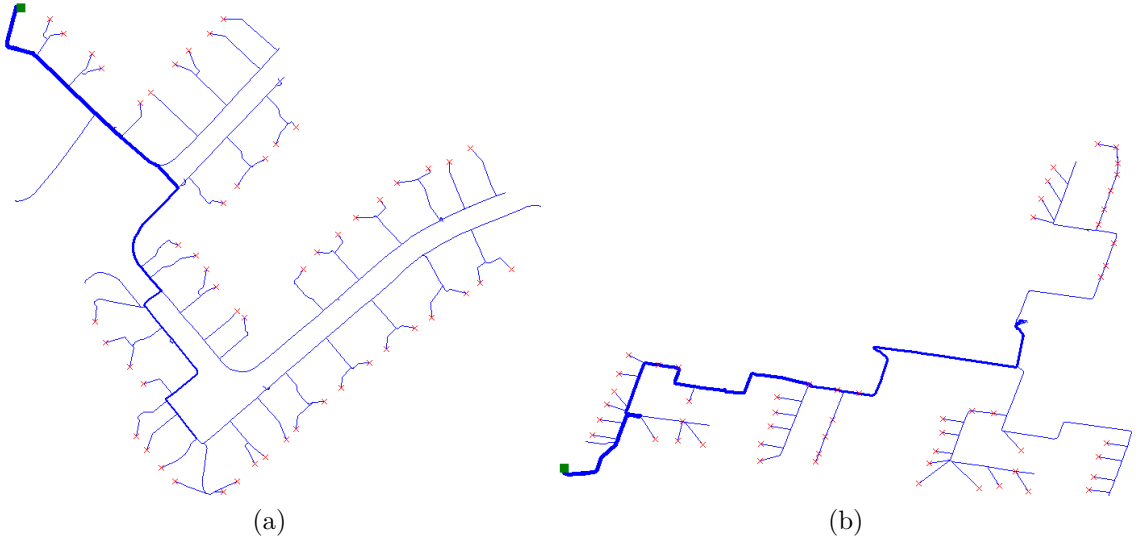


Figure 6.4: Sample OpenDSS power networks, where consumers are indicated as red crosses and 11/0.416-kV substations are marked with a green square. Here, (a) is the IEEE PES EU LV test feeder, and (b) is a SSEN Common Information Model (CIM) based feeder

Initial simulations were conducted using the IEEE’s European Low Voltage Test Feeder [222] and later six detailed UK feeder models were added that are based on real power distribution networks. These models were provided by the project partner Scottish and Southern Electricity Networks (SSEN). The SSEN circuit models were provided as Common Information Models (CIM) during the collaboration on the New Thames Valley Vision (NTVV) project [98]. An example of the IEEE EU LV Test feeder and a UK feeder provided by SSEN are shown in Figure 6.4b and Figure 6.4b, respectively. A summary of all model’s parameters is given in the Table 6.3.

Parameter	IEEE Feeder	SSEN Feeders					
network No.	1	2	3	4	5	6	7
no. of customers	55	56	53	91	59	88	37
mean customer load (VA)	227	227	231	241	224	237	237
max. customer load (kVA)	16.8	16.8	16.8	19.5	16.8	19.5	16.8
mean net. load (kVA)	24.4	24.9	23.9	41.9	25.6	38.9	16.3
max. net. load (kVA)	72.6	72.7	72.2	92.9	73.5	89.6	60.5

Table 6.3: Network model parameters [98].

Throughout the remainder of this chapter, all excerpt and time series results were extracted from experiments with the IEEE EU LV Test feeder (i.e. Network No. 1). Any further results are then based on an aggregation of all networks to include their network diversity in the analysis.

The same model-derived EV data and the IEEE provided consumer demand profiles were used in all power flow simulations. The resulting demand profiles therefore represent the total daily electricity demand of households with connected EVs. These profiles were sampled at $\Delta t = 1$ minute. The OpenDSS simulation environment was controlled using MATLAB that communicated with OpenDSS through its Common Object Model (COM) interface which is accessible using Microsoft’s ActiveX server bridge.

6.4 Storage Control

In this section, the control of the energy storage system is explained. More specifically, all parameters that are used in the Additive-Increase Multiplicative-Decrease (AIMD) algorithm are explained first. Secondly, the structure of the BESS based AIMD algorithm is presented, where its decision mechanism is explained in full. In the end the voltage referencing that is used to extend AIMD to AIMD+ is detailed.

6.4.1 Algorithm Parameters

The proposed distributed battery storage control is shown in Algorithm 2. This algorithm takes the current voltage reading at BESS level (i.e. $v_{\text{bat}}(t)$), the current BESS power (i.e. $p_{\text{bat}}(t)$) and the current state of charge (i.e. $\text{SOC}(t)$) as time-variant inputs. Using a set of reference parameters that include a nominal voltage threshold (i.e. V_{thr}), the minimum voltage level (i.e. V_{min}), the maximum voltage level (i.e. V_{max}), the minimum allowable state of charge (i.e. SOC_{min}), the maximum allowable state of charge (i.e. SOC_{max}) and two control parameters (i.e. α and β), this Algorithm 2 computes the next BESS power (i.e. $p_{\text{bat}}(t + \Delta t)$). Here the two control parameters α (where $\alpha \in [0, 1]$) and β (where $\beta \in [0, 1]$), respectively control the size of the power's additive increase step and the size of the multiplicative decrease. In traditional Internet base applications of AIMD algorithms α is set to a value that slowly increases the number of sent messages (for example 0.1) and β is set to a larger value (for example 0.5) to quickly decrease throughput if congestion is noticed. The constants V_{max} , V_{min} and V_{thr} are the maximum and minimum historic voltage values and the set-point threshold that is used to regulate the BESS operation. In the case when the total demand is too high, the local voltages will fall below V_{thr} and the batteries reduce their charging power and eventually start discharging. This behaviour raises overall voltage levels since the total demand on the feeder is reduced.

Data: $p_{\text{bat}}(t)$, $\text{SOC}(t)$, $v_{\text{bat}}(t)$, V_{thr} , V_{max} , V_{min} , SOC_{max} , SOC_{min} , α , β

Result: $p(t + \Delta t)$

```

1 for  $t \leftarrow 1$  to  $T$  do
2   // Define the rate for the recent voltage reading
3    $r(t) = (v_{\text{bat}}(t) - V_{\text{thr}})$ ;
4   if  $v_{\text{bat}}(t) \geq V_{\text{thr}}$  then
5     // If voltage levels are above a threshold and...
6     if  $\text{SOC}(t) \leq \text{SOC}_{\text{max}}$  then
7       // ...SOC is not at max.: increase charging power
8        $p(t + \Delta t) = p_{\text{bat}}(t) + \alpha P_{\text{max}} r(t)$ 
9     else
10      // ...SOC is at max.: shut off
11       $p(t + \Delta t) = 0$ ;
12    end
13    // If the battery has been discharging...
14    if  $p_{\text{bat}}(t) < 0$  then
15      // ...reduce discharging power by  $\beta$ 
16       $p(t + \Delta t) = \beta p_{\text{bat}}(t)$ ;
17    end
18  else
19    // If voltage levels are below a threshold and...
20    if  $\text{SOC}(t) \geq \text{SOC}_{\text{min}}$  then
21      // ...SOC is not at min.: increase discharging power
22       $p(t + \Delta t) = p_{\text{bat}}(t) - \alpha P_{\text{max}} r(t)$ 
23    else
24      // ...SOC is at min.: shut off
25       $p(t + \Delta t) = 0$ ;
26    end
27    // If the battery has been charging...
28    if  $p_{\text{bat}}(t) > 0$  then
29      // ...reduce charging power by  $\beta$ 
30       $p(t + \Delta t) = \beta p_{\text{bat}}(t)$ ;
31    end
32  end
33  // Restrict power to BESS limits
34   $p_{\text{bat}}(t + \Delta t) = \text{signum}(p_{\text{bat}}(t)) \min(|p_{\text{bat}}(t)|, P_{\text{max}})$ ;
35 end

```

Algorithm 2: Compute battery power

For the simulations in this chapter, V_{\max} is set to the nominal voltage of the substation transformer (i.e. 240V) and V_{thr} is set to a value below V_{\max} which was found by solving a balanced power flow analysis of the underlying network. For each BESS V_{\min} is then chosen as the value below V_{thr} so that V_{thr} lies equidistant to V_{\max} and V_{\min} . The variable $v_{\text{bat}}(t)$ is the battery's local bus voltage and is used to trigger control actions. This value is obtained by solving the power flow of the underlying network and it is used to adjust the battery power (i.e. $p_{\text{bat}}(t)$) as defined in Algorithm 2. To stay within operational limits, P_{\max} is set as the maximum charging/discharging power of the battery. The charging and discharging power of the batteries is increased in proportion to the available headroom on the network (which is inferred from the local voltage measurement $v_{\text{bat}}(t)$) to avoid any sudden overloading of the substation transformer.

6.4.2 AIMD Algorithm Structure

The algorithm itself, as shown in Algorithm 2, contains two decision levels. The first level (lines 4-17) determines whether the network is underloaded by comparing the local bus voltage (i.e. $v_{\text{bat}}(t)$) to the battery's set-point threshold (i.e. V_{thr}). If the network is under low load (i.e. when $v_{\text{bat}}(t) \geq V_{\text{thr}}$) then the BESS is triggered to decrease its power injection until it begins charging. In this case the battery's SOC is compared to its operation limit to check whether the battery can charge (i.e. $\text{SOC} < \text{SOC}_{\max}$). If there is enough charging capacity left then the battery's charging power is linearly increased using α (lines 6-8). Otherwise (i.e. when the BESS is fully charged by reaching its highest charge level of SOC_{\max}) the charging process is turned off (lines 9-11). If the battery was previously discharging however, the related discharging power is multiplicatively reduced (lines 14-17) to begin reducing voltage levels.

The second decision level (lines 18-32) is entered when the network is overloaded.

If the network is under high load (i.e. when $v_{\text{bat}}(t) < V_{\text{thr}}$) then the BESS is triggered to decrease its charging power until it begins to inject energy into the network. In this case the discharging power is linearly increased if the battery has enough energy stored (i.e. $\text{SOC} > \text{SOC}_{\min}$ - lines 20-22). Otherwise (i.e. when the BESS has discharged to its low charge level of SOC_{\min}) the discharging process is turned off (lines 23-25). However, if the battery was previously charging, then its charging power is multiplicatively reduced (line 28-31) to begin increasing voltage levels.

The direction of the charging/discharging power adjustment is determined by the first decision level, as well as the threshold proximity ratio $r(t)$. As the battery's bus voltage (i.e. $v_{\text{bat}}(t)$) approaches the threshold voltage (i.e. V_{thr}) this ratio tends to zero and thus stops the adjustments of the battery operation. Therefore the oscillatory hunting around the BESS threshold is effectively mitigated. The last step of the algorithm (lines 33-34) assures that the battery's charge/discharge power stays within the device's rating (i.e. $|p_{\text{bat}}(t)| \leq P_{\max}$).

6.4.3 Reference Voltage Profile

The difference in the location and load of each customer results in the over-utilisation of the batteries that are located at the feeder end. This is particularly true when using a fixed voltage threshold. To individualise the voltage thresholds, a reference voltage profile is generated by performing a power flow analysis of the network model by subjecting it to its maximum power demand. This approach is comparable to the procedure by Papaioannou et al. in [223] who generated profiles for the control of EV charging. In this chapter however, bi-directional power flow of BESS is controlled. An example of a fixed threshold and reference voltage profile is shown in Figure 6.5.

Therefore, BESSs in the AIMD+ algorithm that are located at the head of the feeder are allocated a higher voltage threshold than those towards the end of the feeder. However, BESSs with lower thresholds are allocated a voltage threshold sim-

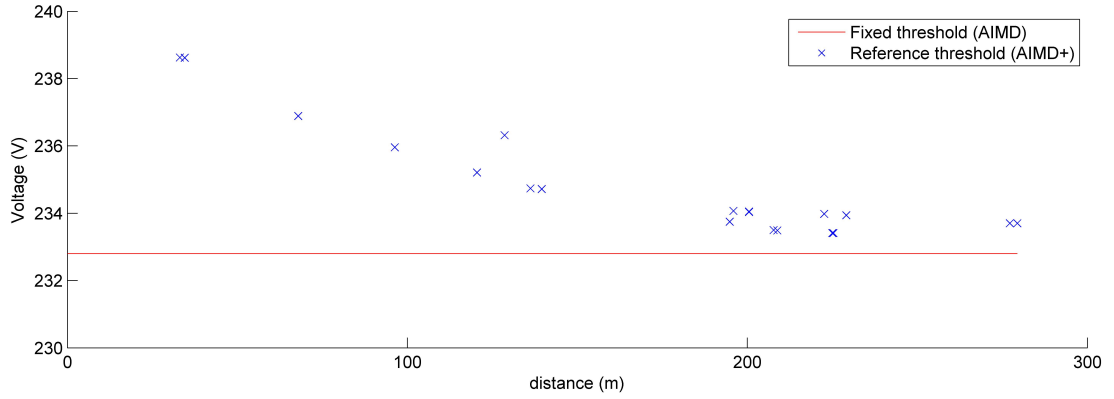


Figure 6.5: An example plot showing the difference between the fixed voltage threshold (AIMD) and the reference voltage profile (AIMD+) against the load’s distance to its feeding substation.

ilar to that of the fixed threshold control. This allocation takes into account the expected voltage drop that occurs along the length of the feeder and hence results in a better tuned utilisation of all battery storage units - regardless of their distance to the substation. For the work presented in this chapter, the voltage threshold is set in such a way as to limit the maximum voltage drop to 3% at the end of the feeder.

6.5 Scenarios and Comparison Metrics

This section covers several scenarios that were used to test the performance of the battery control algorithm. Following that is the definition of three comparison metrics. These metrics quantify the improvements caused by the different algorithms in comparison to the worst case scenario.

6.5.1 Test Cases and Scenarios

In all simulations, the EVs plug-in on arrival and charge at their nominal charging rate until fully charged. The BESS devices were chosen to have a capacity of 7kWh with a maximum power rating of 2kW (i.e. battery specifications are based on the Tesla Powerwall [224]). Four excerpt cases were defined with different levels of EV

and storage uptakes. The detail of these cases are as follows:

Case A A normal scenario, where only household demand is used.

Case B A baseline or worst case scenario, in which EV uptake is 100% and no BESS is used.

Case C An AIMD scenario in which EV uptake is 100% and each household has a battery energy storage device. Here each battery was controlled using the AIMD algorithm using a fixed voltage threshold.

Case D An AIMD+ scenario in which EV uptake is 100% and each household has a battery energy storage device. Here each battery was controlled using the AIMD+ algorithm using the reference voltage profile.

An EV uptake of 100% was adopted to represent the worst case scenario. In addition to the four defined scenarios, a full set of simulations was performed with EV and storage uptake varying between 0% to 100% in steps of 10%.

6.5.2 Performance Metric Definition

In order to compare the network's performance during execution of the predefined cases, three performance metrics (i.e. ζ^* , ζ^{**} and ζ^{***}) are defined. These metrics capture, respectively, the improvements in voltage violation mitigation, line overload reduction and the equality of battery usage. They are derived from the Probability Distribution (PD) of the underlying measurements and thus allow an comparison of the four scenarios. Each PD is generated using the standard kernel density estimation. In the following sections, all subscripts of the metrics notate which scenario they represent (for example $\zeta_{\mathbf{C}}^{**}$ represents results from **Case C** and $\zeta_{\mathbf{D}}^*$ represents results from **Case D**). For reproducibility, all excerpts to showcase the performance metrics

were generated from simulations based on the IEEE EU LV Test feeder. Only the full set of simulations is based on the combination of all network models.

6.5.2.1 Parameter for Voltage Improvement

Metric ζ^* is designed to assess the changes in voltage PD. For instance, a narrow voltage PD around the nominal voltage (i.e. V_{ss}) would indicate a stable voltage at all nodes of the network. A wider or even shifted PD would however indicate that the voltage deviation has increased and that voltage levels are not stable at all nodes. In order to compare the AIMD and AIMD+ cases (i.e. respectively **Case C** and **Case D**), the two voltage PD dependent performance metrics are defined:

$$\zeta_{\mathbf{C}}^* := \sum_{v=V_{\min}}^{V_{\max}} \delta^*(v) [P_{\mathbf{B}}(v) - P_{\mathbf{C}}(v)] \quad (6.13)$$

$$\zeta_{\mathbf{D}}^* := \sum_{v=V_{\min}}^{V_{\max}} \delta^*(v) [P_{\mathbf{B}}(v) - P_{\mathbf{D}}(v)] \quad (6.14)$$

$$\delta^*(v) := \begin{cases} \frac{V_{ss}-v}{V_{ss}-V_{\text{low}}} & \text{if } v \leq V_{ss} \\ \frac{v-V_{ss}}{V_{\text{high}}-V_{ss}} & \text{otherwise} \end{cases} \quad (6.15)$$

where $V_{\text{low}} < V_{ss} < V_{\text{high}}$

Together with their scaling function (i.e. δ^* in Equation 6.15) Equation 6.13 and Equation 6.14 define the performance metrics $\zeta_{\mathbf{C}}^*$ and $\zeta_{\mathbf{D}}^*$, respectively. In these equations $P_{\mathbf{B}}(v)$ represents the probability distribution of all voltages for **Case B** (i.e. the baseline case). The two metric specific PDs (i.e. $P_{\mathbf{C}}(v)$ and $P_{\mathbf{D}}(v)$) represent the voltage PDs (i.e. for **Case C** and **Case D**, respectively). By computing the weighted difference, a reduction in probabilistic voltage deviation is found. The weighting is necessary to emphasise those changes in PD that do not lie close to the nominal sub-

station voltage (i.e. V_{ss}). V_{high} and V_{low} are also used in Equation 6.15 to normalise the deviation at the upper and lower voltage bounds (these constants are also used in the AIMD+ algorithm in Section 6.4). With $\delta^*(v)$, regions outside the nominal operating band are thus weighted higher than those within and surrounding the nominal voltage level. In summary, the proposed voltage comparison parameters ζ_C^* and ζ_D^* show an improvement in voltage PD when they are negative, whereas a positive value implies a voltage PD with higher deviation from the nominal level of V_{ss} .

6.5.2.2 Parameter for Line Overload Reduction

Similar to measuring the voltage level improvements, all line utilisation PDs are also compared with the base case (i.e. **Case B**). This follows a similar approach as in Equations 6.13 to 6.15, but the line utilisation PD uses a different scaling factor. The two line utilisation performance metrics, ζ_C^{**} and ζ_D^{**} , for assessing, respectively, **Case C** and **Case D** are defined as follows:

$$\zeta_C^{**} := \sum_{c=0}^{C_{max}} \delta^{**}(c) [P_C(c) - P_B(c)] \quad (6.16)$$

$$\zeta_D^{**} := \sum_{c=0}^{C_{max}} \delta^{**}(c) [P_D(c) - P_B(c)] \quad (6.17)$$

$$\delta^{**}(c) := \begin{cases} \left(\frac{c}{1-C_{min}}\right)^2 & \text{if } c \geq C_{min} \\ 0 & \text{otherwise} \end{cases} \quad (6.18)$$

where $C_{min} \in [0, 1)$

Here, $P_B(c)$ represents the baseline PD (i.e. **Case B**), $P_C(c)$ represents the line utilisation PD for the AIMD scenario (i.e. **Case C**) and $P_D(c)$ represents the line utilisation PD for the AIMD+ scenario (i.e. **Case D**). Line utilisation is computed

as the ratio between the simulated current in each line and the nominal line rating. A value of one would therefore indicate a fully loaded line. To scale the comparison with the baseline case correctly, a corresponding scaling function $\delta^{**}(c)$ is defined in Equation 6.18. This function is a quadratic function since the relationship between line current and resistive losses is also quadratic. A minimum line current (i.e. C_{\min}) is however used to neglect those probabilities where lines are only lightly loaded. The resulting scaling effect thus amplifies the impact of line current reduction beyond the line's nominal rating and reduces the weight on those improvements within the line's thermal constraints. For the work presented in this chapter, the value for this modifier is set to 0.5 since only line utilisation improvements above 0.5 per unit are considered noteworthy. In summary, a reduction in line overloads would give a negative $\zeta_{\mathbf{C}}^{**}$ or $\zeta_{\mathbf{D}}^{**}$, whereas a positive value implies a higher line utilisation or worse network operation.

It should be noted, that maximised asset utilisation is also of benefit to the DNO since such a state would reflect a best return for the investment. Different ownership of the support asset would therefore reflect different incentives for using the asset. Therefore, in scenarios where a longevity of BESS whilst providing network support is of importance, the above metric is used. Nonetheless, different usage and ownership scenarios are discussed in Section 7.4 of this thesis.

6.5.2.3 Parameter for the Improvement of Battery Cycling

The final metric, ζ^{***} , gives an indication of the inequality of battery cycling. Here, one battery cycle is defined as a full discharge and charge of the BESS at its maximum operating power. Since BESS at the bottom of the feeder are more likely to partake in voltage correcting functions than a BESS located closer to the substation, higher degradation would be expected. To assess the difference in cycling between different BESSs, the ratio between the peak and mean battery cycling is used. Previous

chapters used this so called Peak-to-Average Ratio (PAR) to assess smoothness of load profiles (see Section 3.3.4, Section 4.2.2 and Section 5.3.3 of this thesis). In this chapter however, PAR is used to quantify the maximum deviation in battery usage from the mean battery cycling. The metrics to determine the PAR for **Case C** and **Case D** are defined as follows:

$$\zeta_{\mathbf{C}}^{***} := \frac{\max |\mathbf{c}_{\mathbf{C}}|}{U^{-1} \sum_{u=1}^U |c_{\mathbf{C}}^u|} \text{ where } \mathbf{c}_{\mathbf{C}} = (c_{\mathbf{C}}^u) \quad (6.19)$$

$$\zeta_{\mathbf{D}}^{***} := \frac{\max |\mathbf{c}_{\mathbf{D}}|}{U^{-1} \sum_{u=1}^U |c_{\mathbf{D}}^u|} \text{ where } \mathbf{c}_{\mathbf{D}} = (c_{\mathbf{D}}^u) \quad (6.20)$$

In Equation 6.19 and Equation 6.20 c^u is the total cycling of a BESS unit (i.e. unit u) out of a total number of units U . For simplicity, a BESS cycling vector (i.e. \mathbf{c} where $\mathbf{c} = (c^u)$) is used to combine the cycling of all devices. To differentiate between **Case C** and **Case D**, $\mathbf{c}_{\mathbf{C}}$ (where $\mathbf{c}_{\mathbf{C}} = (c_{\mathbf{C}}^u)$) and $\mathbf{c}_{\mathbf{D}}$ (where $\mathbf{c}_{\mathbf{D}} = (c_{\mathbf{D}}^u)$) are respectively used to indicate the total cycling of each BESS unit for the AIMD and AIM+ case. In the event of a perfectly equal cycling of all batteries, $\zeta_{\mathbf{C}}^{***}$ and $\zeta_{\mathbf{D}}^{***}$ will have a value of one. But these values are expected to be greater than one since batteries are more likely to operate differently. Therefore, values closer to one imply a more equal and therefore fairer utilisation of the deployed batteries whilst values deviating further from one imply the opposite.

6.6 Results and Discussion

In this section, all presented results were generated from the simulation of the different cases. In each of the following three subsections, the performances of the AIMD and AIMD+ algorithm are compared against each other and the baseline cases. To do so, the performance metrics that were outlined in Section 6.5.2 are used. Results from the four test cases, which have been defined as **Case A**, **Case B**, **Case C** and **Case**

D in Section 6.5.1, are explained at first. Then the results from the full analysis over the large range of EV and battery storage uptake is presented.

6.6.1 Voltage Violation Analysis

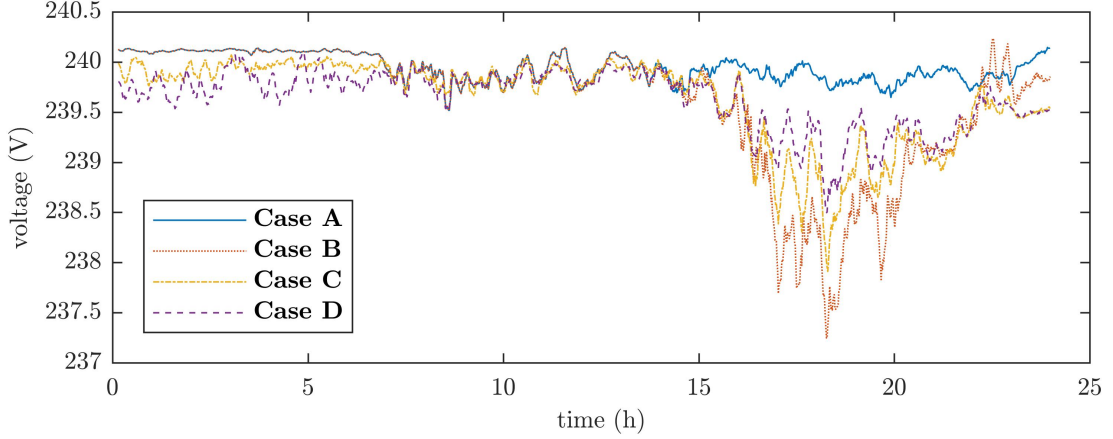


Figure 6.6: Mean voltage profiles for all four test cases over a single day.

For the assessment of improving voltage levels, results are compared for the algorithms' performances at reducing bus voltage deviation - particularly by increasing the lowest recorded bus voltage. Each load's bus voltage was recorded and a sample voltage profile (shown in Figure 6.6) was extracted. Here the bus voltage fluctuation over time becomes apparent. It can be seen that the introduction of EVs has significantly lowered the line-to-neutral voltage. Adding energy BESS devices did raise the voltage levels during times of peak demand. AIMD+ did however outperform AIMD since a further voltage increase can be seen between 17:00 and 21:00 where the AIMD+ algorithm has elevated voltages further than the AIMD scenario. To obtain a better understanding of the level of improvement, the voltage frequency distribution of all buses along the feeder was generated and plotted in in Figure 6.7.

In this figure the voltage PD for all four cases were normalised and plotted against each other. Here the previous drop in voltages that was generated by introducing EVs is recorded as a shift in the voltage distribution towards the left. Additionally, the

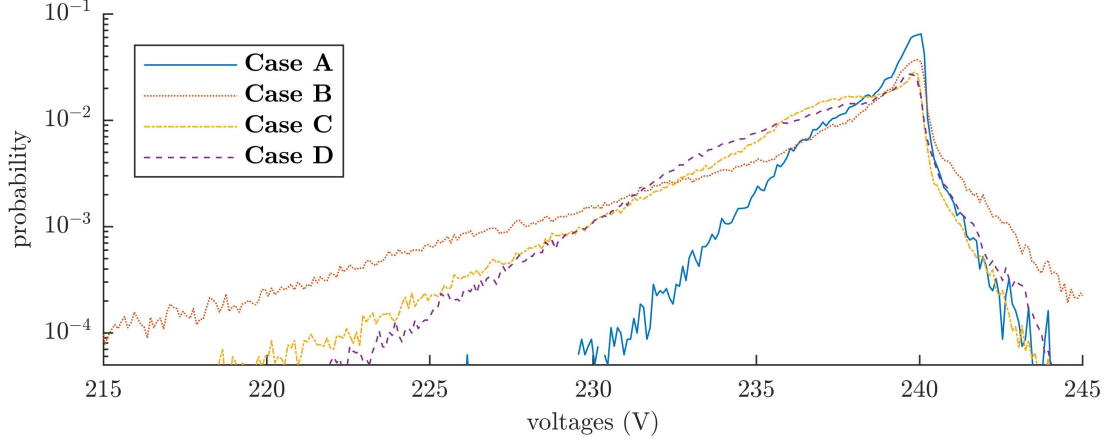


Figure 6.7: Voltage level probability distribution for the entire feeder where $\zeta_{\mathbf{C}}^* = -0.153$ and $\zeta_{\mathbf{D}}^* = -0.135$.

widened left hand tail of **Case B** can be clearly observed in Figure 6.7. This voltage drop and spread is then mitigated by the introduction of the storage solutions since the voltage PD is shifted towards higher voltage bands (i.e. towards the right). Since the difference between the BESS controlled by AIMD and AIMD+ is difficult to see, a comparison of their underlying performance metrics (i.e. values of ζ^*) is necessary. In Figure 6.7 for the IEEE EU LV Test feeder, the AIMD+-controlled batteries outperform the AIMD devices since the resulting $\zeta_{\mathbf{C}}^*$ is greater than $\zeta_{\mathbf{D}}^*$.

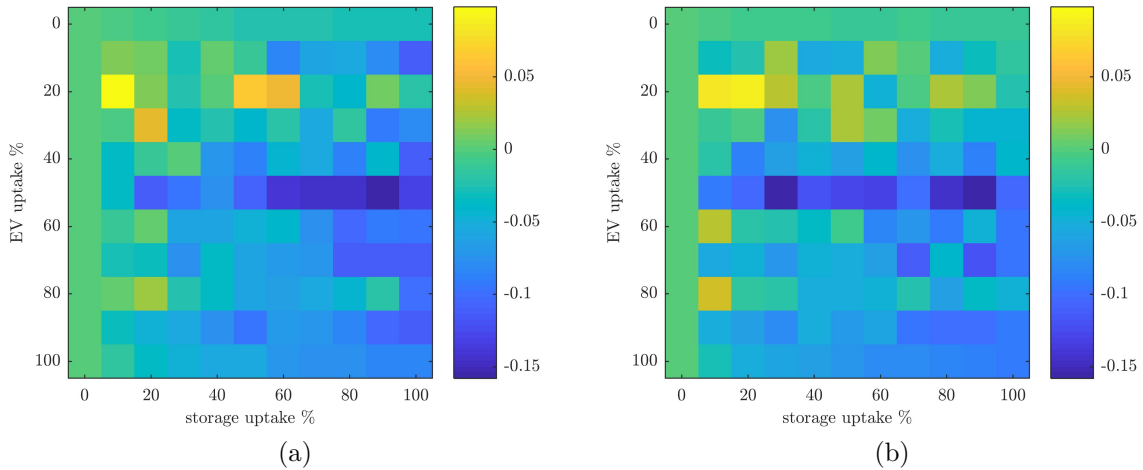


Figure 6.8: Comparison of voltage improvement indices for (a) $\zeta_{\mathbf{C}}^*$ indices (AIMD); (b) $\zeta_{\mathbf{D}}^*$ indices (AIMD+).

However, to gain a full understanding of the performance of the AIMD and AIMD+ algorithms, a full sweep of EV and BESS uptake combinations was simulated on all available power distribution networks. The resulting parameters were averaged and plotted in Figure 6.8.

These figures show that the AIMD+ control algorithm reduces voltage deviation more effectively as the uptake in storage and EVs increases. For low storage uptake, the AIMD algorithm does not perform as strongly since more ζ_C^* values are positive and larger than their corresponding ζ_D^* value. This becomes more apparent when averaging all ζ_C^* and ζ_D^* values across all EV uptakes for their common storage uptake. The resulting averaged metrics are plotted in Figure 6.9.

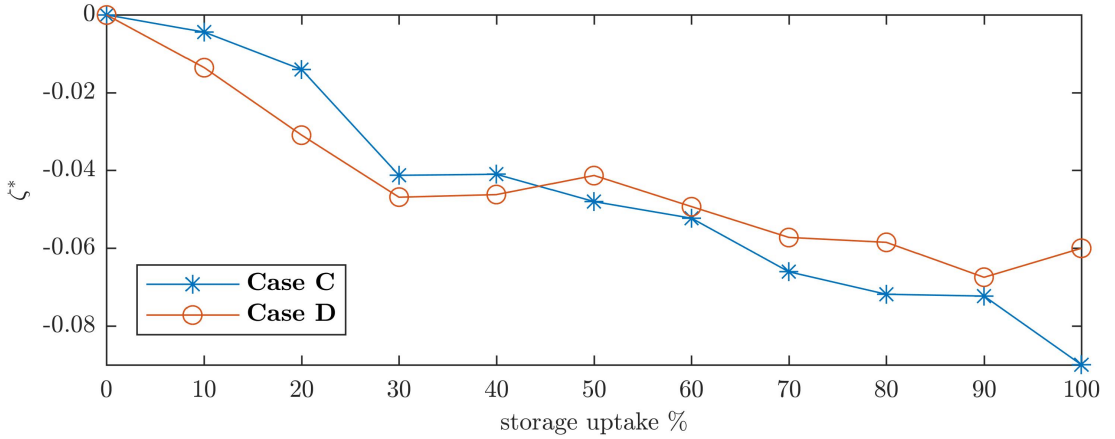


Figure 6.9: Average ζ_C^* and ζ_D^* values recorded against the corresponding storage uptake.

In this last figure (i.e. Figure 6.9) it can be seen how the sole impact of BESS uptake reflects in a continuing improvement of voltage levels. In fact, both compared algorithms improved the bus voltage which coincides with the findings in the case studies. On average, this is the case for all BESS uptakes, as $\zeta_C^* \approx \zeta_D^*$. Nonetheless, it should be noted that for scenarios with lower BESS uptake, the AIMD+ algorithm has better reduced the frequency of severe voltage deviations in comparison to the AIMD algorithm. For scenarios with higher BESS uptake however, AIMD proved more effective.

6.6.2 Line Overload Analysis

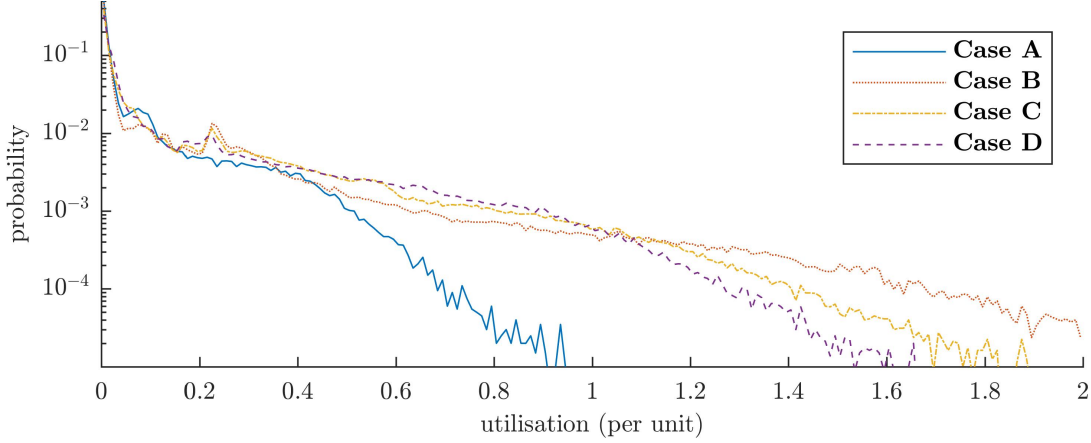


Figure 6.10: Line utilisation probability distribution of all lines in the simulated feeder where $\zeta_{\mathbf{C}}^{**} = -0.360$ and $\zeta_{\mathbf{D}}^{**} = -0.518$.

Similar to the voltage PD analysis, a PD of the line utilisation was generated and plotted in Figure 6.10. This figure shows a normalised PD plot of the per unit current in all lines for each of the four scenarios (here per unit represents a 100% line usage, i.e. a line current of the same value as the line's nominal current rating). Whilst the case without any charging EVs (i.e. **Case A**) shows no overloading, **Case B** has significantly widened the probability spectrum. AIMD and AIMD+ controlled BESS can mitigate the effect of this EV introduction, and the difference in performance becomes more apparent than it did for the voltage PD analysis. In Figure 6.10 the PDs for **Case C** and **Case D** intersect at one per unit load, but overloads were less likely for the AIMD+ scenario than they were for the AIMD controlled scenario. Furthermore, in this figure it can also be observed that the used test network is of insufficient capacity to cater for the chosen EV uptake since the probability of line over-utilisation is still above zero.

Nonetheless, the AIMD+ controlled storage devices yielded a noticeable reduction in line overloads despite being a voltage driven control method. This improvement is apparent through the compressed width of the probability distribution and the

negative $\zeta_{\mathbf{D}}^{**}$ value. In contrast, the AIMD controlled storage devices do not utilise the line capacity as effectively as the AIMD+ controlled devices which resulted in its value of $\zeta_{\mathbf{C}}^{**}$ to be more positive than the value for AIMD+. To evaluate the line utilisation improvement across all simulations, the full range of EV and storage uptake was evaluated. The resulting plots are shown in Figure 6.11.

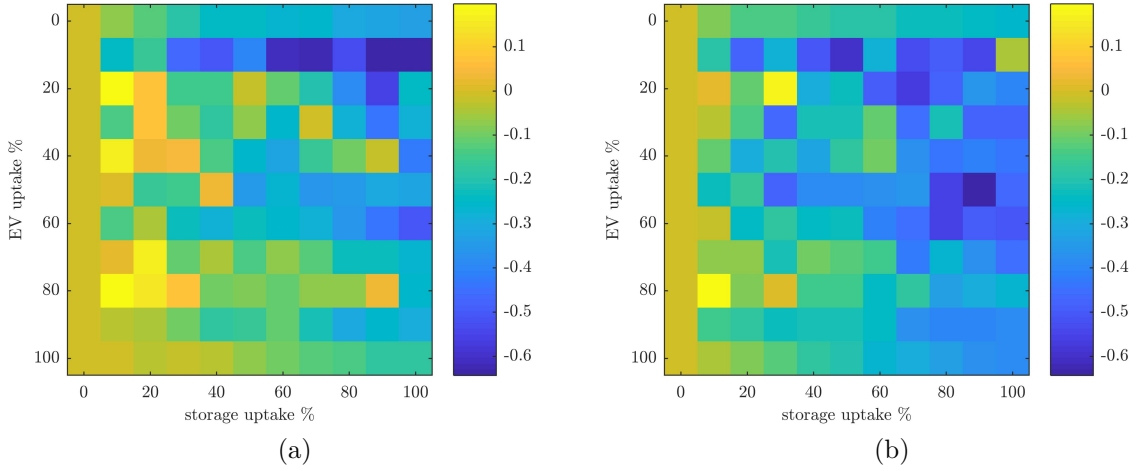


Figure 6.11: Comparison of line utilisation improvement indices for (a) $\zeta_{\mathbf{C}}^{**}$ indices (AIMD); (b) $\zeta_{\mathbf{D}}^{**}$ indices (AIMD+).

In these figures it can be seen how the performance metrics change as EV uptake and storage uptake increase. For the AIMD-controlled BESS, the resulting $\zeta_{\mathbf{C}}^{**}$ values are distributed around zero throughout the entire spectrum of EV and BESS uptake, whereas the AIMD+ algorithm achieved values of $\zeta_{\mathbf{D}}^{**}$ of zero or below for 91% of the performed simulations. These negative values confirm the better usage of available line capacity. This becomes particularly apparent for scenarios where very low EV uptake is combined with larger BESS uptake. Here, AIMD-controlled storage devices commence their initial charge simultaneously. As they are located closer to the substation they do not measure a sufficient bus voltage offset to regulate down their charging power. This behaviour causes a number of line overloads at the very beginning of the simulated days. The AIMD+ algorithm on the other hand, with its

adjusted thresholds, is more responsive to non-optimal network operation and thus increases the charging rate gradually.

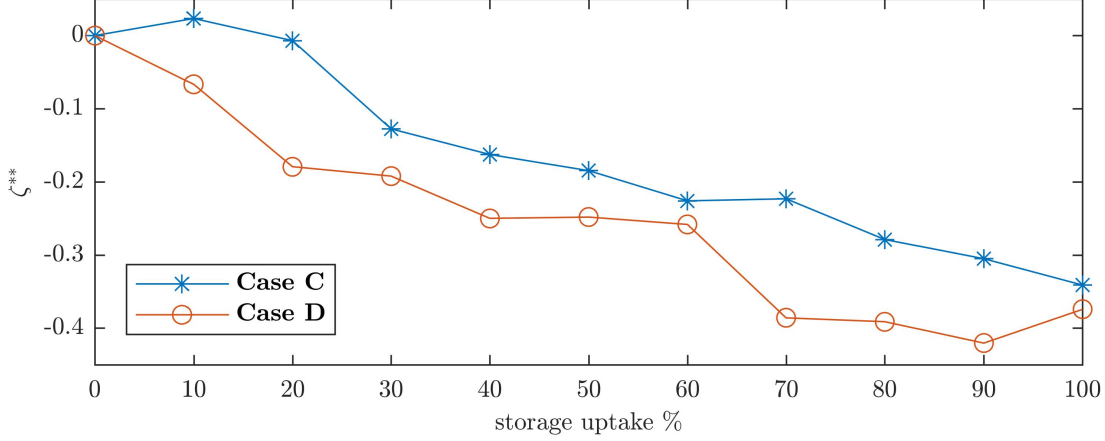


Figure 6.12: Average ζ_C^{**} and ζ_D^{**} values recorded against the corresponding storage uptake.

This gradual adjustment is based on the fact that the bus voltages in the AIMD+ algorithm are closer to their nominal voltages (i.e. bus voltages found by simulating the feeder with its equally-distributed nominal load) than they are in the conventional AIMD case. A greater voltage disparity which is the case in AIMD causes a prolonged additive adjustment to the battery's power. This prolonged adjustment is particularly apparent for batteries situated at the bottom of the feeder since their voltage measurements deviate the furthest from the substation voltage level. AIMD+ on the other hand prevents this behaviour by setting the voltage threshold based on the network's nominal voltage drop - which is dependent on the distance between the BESS and its feeding substation. As a result, the set-point voltage thresholds at the bottom of the feeder are lower than those closer to the substation and hence the additive power adjustment becomes equal for all BESS along the feeder. Therefore, by applying these individualised control thresholds, the sensitivity of the algorithm is corrected, whilst successfully mitigating the severity of line overloads.

Averaging the ζ_C^{**} and ζ_D^{**} values over all EV uptakes gives a clearer indication of performance since this now becomes the only variable in the performance analysis.

The result is plotted in Figure 6.12. Here the hypothesis that AIMD-controlled energy storage devices do not always improve line utilisation is confirmed. In contrast the AIMD+-controlled devices succeed on average at effectively reducing line overloads. This is also demonstrated since the values of $\zeta_{\mathbf{C}}^{**}$ lie close to zero for low BESS uptake and stay above the values for $\zeta_{\mathbf{D}}^{**}$ that are shown Figure 6.12.

Whilst the deployment of energy storage has often been seen as a possible solution to defer network reinforcements, the presented results show that this is not always the case. In fact, due to technical limitations of the algorithm, choosing an appropriate control algorithm enables the BESS to perform optimally. This becomes particularly apparent when energy storage devices need to recharge their injected energy for times of peak demand. For the AIMD case, this recharging was not controlled in accordance to the underlying network properties which led to higher line currents. The proposed AIMD+ algorithm was not as susceptible to this kind of behaviour since it has been designed to take battery location into account. This immunity and well-controlled power flow caused little to no additional strain on the network's equipment, allowing the deployed storage devices to free some of the network resources.

6.6.3 Battery Utilisation Analysis

In this part of the analysis, the batteries' equality of use was evaluated by comparing the battery cycling for each AIMD implementation. As already mentioned, a single battery cycle is defined as a full discharge and recharge. In Figure 6.13 the battery power profiles are plotted along the horizontal axis and they are ordered by increasing distance to the substation:

Figure 6.13 shows a load profile plotted from the left to right for each load, where all loads are numbered in increasing order (top to bottom) as their distance to the substation increases. The shade of the colour indicates the energy consumed or injected into the grid. From this figure, it can be seen that only about one third of the

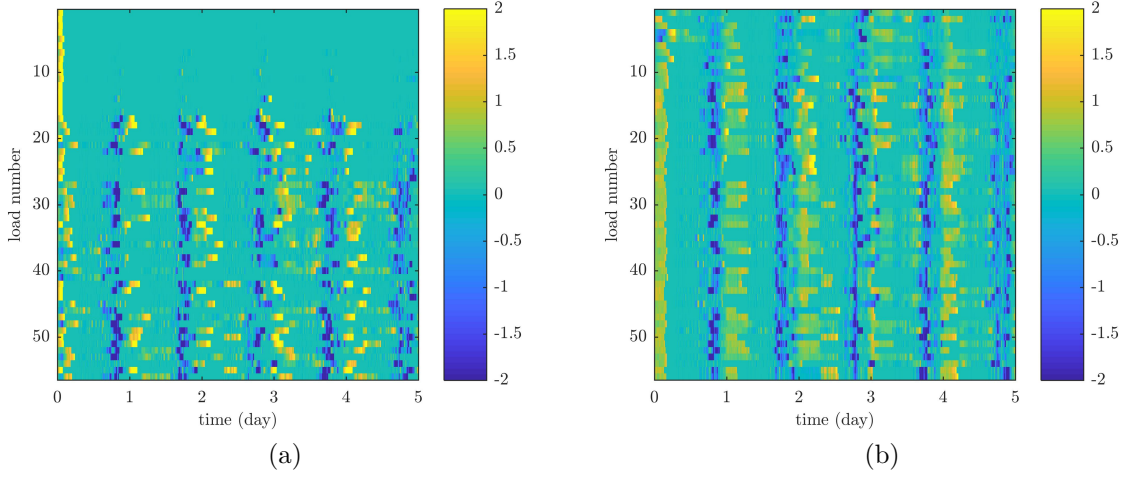


Figure 6.13: Battery power profiles of each load's battery storage device over four days for (a) **Case C** and (b) **Case D**.

deployed storage devices were active in **Case C** (i.e. using AIMD control) whereas all devices are utilised in **Case D** (i.e. using AIMD+ control). Alongside these power profiles, the SOC profiles were also recorded, and from these recorded battery SOC profiles, the net cycling of each battery was computed and divided by the duration of the simulation to give an average daily cycling value. This average battery cycling value is plotted for each load in Figure 6.14a - the corresponding box-plot is included in Figure 6.14b, where the central red mark indicates the median, the bottom and top edges of the blue box indicate the 25th and 75th percentiles, respectively, and the whiskers extend to the most extreme data points not considered outliers.

These two plots in Figure 6.14 show the under-use of AIMD controlled batteries, as well as the variance in battery usage under AIMD control (i.e. **Case C**) and AIMD+ control (i.e. **Case D**). In fact, when using the AIMD control, 20 out of 55 batteries experienced a battery cycling of less than 10% per day whereas the remaining devices were utilised fully. This discrepancy causes the cycling performance metric of **Case C** (i.e. ζ_C^{**}) to be higher than the performance metric of **Case D** (i.e. ζ_D^{**}). Such a difference supports the assumption that AIMD+ yields a more equal battery

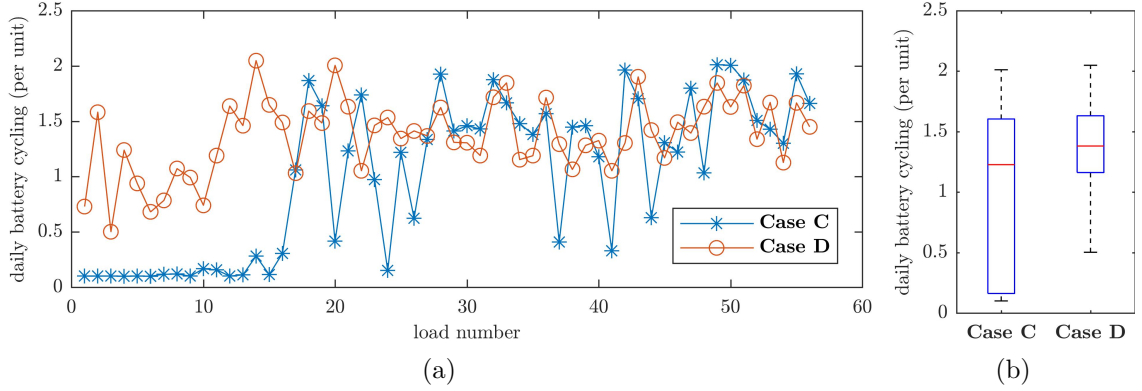


Figure 6.14: Each load's battery cycling compared for (a) each BESS and (b) the two cases, where $\zeta_{\mathbf{C}}^{***} = 3.89$ and $\zeta_{\mathbf{D}}^{***} = 2.54$.

cycling than traditional AIMD. For a more detailed comparison however, the PARs of the batteries' daily cycling over the full range of EV and storage uptake scenarios are plotted in Figure 6.15 (Section 6.5.2 gave details on all performance metrics including ζ^{***} which is the PAR as defined in Equation 6.19 and Equation 6.20):

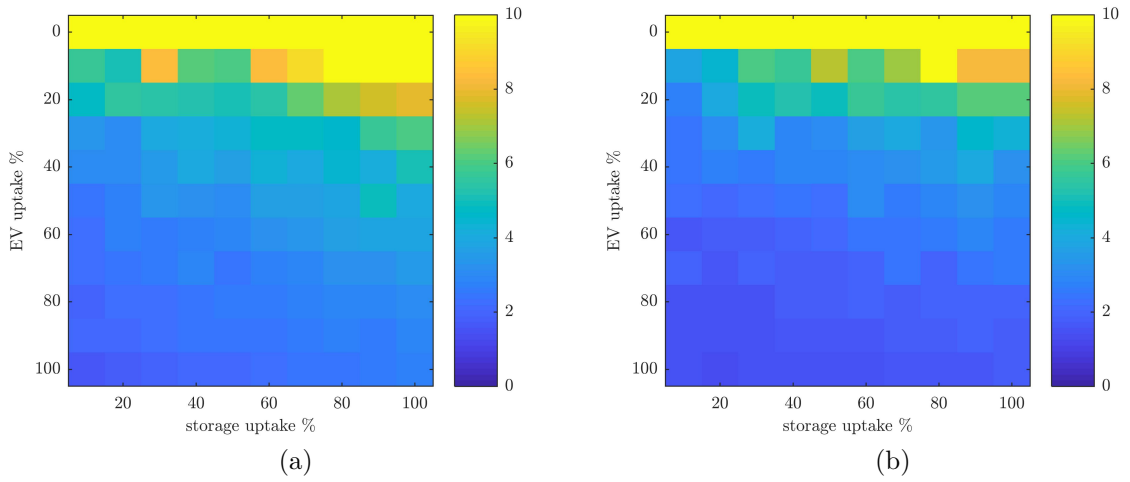


Figure 6.15: Peak-to-Average Ratios (PAR) of the battery cycling profiles of each load's battery storage device over four days for (a) **Case C** and (b) **Case D**.

In Figure 6.15 it can be seen that for any EV uptake scenario, AIMD-controlled energy storage units were cycled less equally than the AIMD+ controlled devices. The results also show that with an increasing storage uptake, BESS were cycled less equally

for both control methods. However, AIMD+ (i.e. **Case D**) always outperformed the traditional AIMD algorithm (i.e. **Case C**). When averaging the values of ζ^{***} over all EV uptake percentages for all batteries' SOC profiles, then a clear performance difference between AIMD and AIMD+ can be observed. These resulting averaged PARs are plotted in the subsequent figure, Figure 6.16.

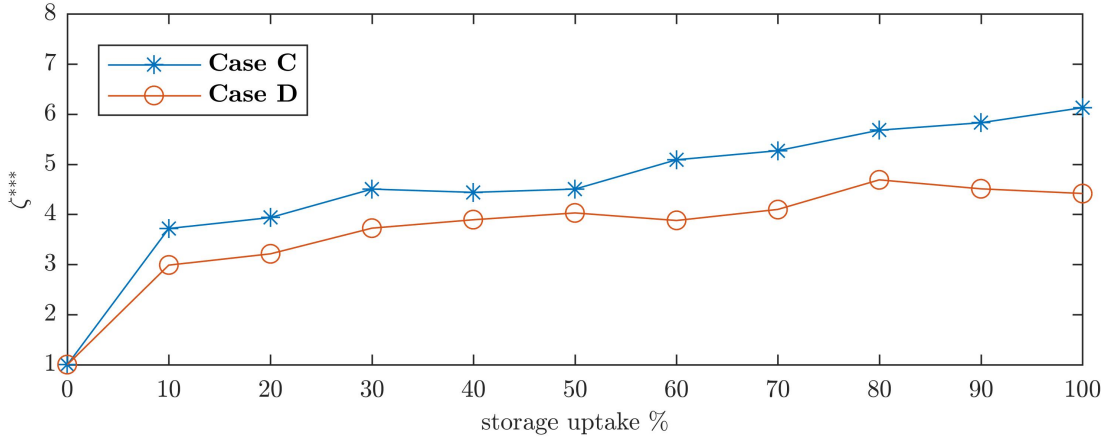


Figure 6.16: The performance index ζ_C^{***} for AIMD storage and ζ_D^{***} for AIMD+ storage control against storage uptake.

Although the AIMD controlled batteries were on average cycled less than the batteries controlled by the proposed AIMD+ algorithm, inspecting the average by itself produces a distorted understanding of the algorithm's performance. After all, since more than a third of the assigned AIMD BESS devices never partook in the network control, a lower average cycling would be expected to begin with. The difference in cycling across all batteries (or the cycling PAR) reveals the difference between usage equality as well as effective usage. And since a lower PAR indicates a more equal usage of the deployed batteries, AIMD+ clearly outperforms AIMD when subjected to the provided power data.

6.7 Summary

In this chapter, Chapter 6 an algorithm is proposed for distributed battery energy storage in order to mitigate the negative impact of highly variable and uncontrolled loads - such as the charging of EVs. Unlike previous algorithms, the improved algorithm (i.e. AIMD+) only uses local bus voltage measurements to issue control instructions. It implements a reference voltage profile which is derived from power flow analysis of the distribution network for its individualised set-point control. Taking the distance to the feeding substation into account allows an optimisation of the algorithm's parameters for each BESS. Simulations were performed on the IEEE EU LV Test feeder and a set of real UK LV network models that were provided by SSEN. Comparisons were made of the standard AIMD algorithm with a fixed voltage threshold against the proposed AIMD+ algorithm with its individualised control. A set of European demand profiles and a realistic EV travel model were used to feed load data into the simulations. For all conducted simulations, network performance was improved by using the AIMD and AIMD+ algorithm in the distributed BESS. However, AIMD+ frequently outperformed the traditional AIMD control. Although the improved algorithm only resulted in a comparable reduction of voltage variation (for example voltage deviation was reduced by an average of 4% when using AIMD and an average of 5% when using AIMD+ in a scenario of 50% BESS uptake), it did outperform AIMD when decreasing line utilisation, thus reducing the frequency of line overloads. But the AIMD+ algorithm made better use of the deployed battery assets since it always reduced the corresponding metric (i.e. $\zeta_{\mathbf{D}}^{**}$) by an additional 7.1% in comparison to the AIMD algorithm's results (i.e. for $\zeta_{\mathbf{C}}^{**}$). Additionally, the same AIMD+ algorithm equalised the cycling and utilisation of battery energy storage to since the BESS located at the top of the feeder were also included into the distributed BESS operation. Quantitatively, this was shown by a reduction in the PAR of battery cycling, where the AIMD+ algorithm outperformed the AIMD

algorithm by an average of 1.3 for all storage uptake scenarios (i.e. when comparing $\zeta_{\mathbf{D}}^{***}$ with $\zeta_{\mathbf{C}}^{***}$). Despite being data driven, all findings indicate a similar improvement in performance when extending the traditional AIMD based control to AIMD+. As a result, **Objective 4** (which was outlined in Section 1.2 of this thesis) has been met since all the aforementioned benefits were achieved without the use of any ICT infrastructure whilst satisfying all assumptions that were outlined in Section 6.3.1.

Chapter 7

Discussion and Conclusion

The aim of this thesis was to present the development of novel control methods for Battery Energy Storage Solutions (BESS) that aid Distribution Network Operators (DNOs) in improving the operation and reliance of their Low-Voltage (LV) networks. Throughout this thesis, methods have been developed and studied that concern the scheduling and control of energy storage in the LV network. Each contribution chapter of this thesis thus built upon the outlined gaps in literature (i.e. presented in Section 2.5), developed control methods, presented its findings and drew conclusions upon those. From the collection of results and findings of each chapter, this thesis provides several contributions to knowledge. Therefore, this chapter is going to retrospectively summarise those contributions to knowledge and link them back to the overarching problem statement that was presented in Section 1.2. At first, the main findings are summarised in Section 7.1. Then, the contributions to knowledge are presented in Section 7.2. The limitations of the conducted research and the potential future work are discussed in Section 7.4 and in the end an overarching conclusion is drawn in Section 7.5.

7.1 Overview of Main Findings

The objective of this thesis, which has been presented in Chapter 1, is summarised as follows:

- It was to investigate how BESS in the LV network should be controlled in order to achieve best possible network support, including the reduction of peak load, voltage deviations and phase unbalance.
- To assess the impact of BESS on the operation of the LV network, simulations were run to compare on-line and off-line control performance.
- Given that BESS can operate flexibly but had a predetermined half-hourly schedule based on half-hourly load forecasts, the presented research studied how sub-half-hourly corrections can improve the performance of LV networks without exceeding the limited energy resource of the BESS.
- Additionally the aim was extended to assess the effects of, and to develop algorithms for, desynchronised and communication less BESS control.

The reviewed literature in Chapter 2 as well as the findings in Chapter 3 emphasised the need for improving methods of control for energy storage in the LV network. Chapter 3 explores how optimising sub-half-hourly BESS operation on a specific metric impacts other metrics, that define network performance. More specifically, using the LV connected BESS, its impact on each of key network parameters was assessed by optimising each parameter through its corresponding cost function. The same BESS would have been operated traditionally with a half-hourly schedule that dictates the active powers of the device. Using this operation as a benchmark, sub-half-hourly phase adjustments were proposed to tune the BESS operation to achieve optimal impact for any given key network parameter without violating the power constraints. As shown in several resulting time-series plots in Section 3.5 that were summarised

in Table 3.1, optimising BESS operation for certain key network parameters had two resulting impacts:

1. The minimisation of a cost function, derived from a specific key network parameter, results in BESS operation improving the associated network operation. For example, when minimising the cost that was linked to distribution losses, then a mean reduction in losses of 5.0kWh was achieved instead of a 1.2kWh reduction which would have been the result for traditional BESS scheduling.
2. The minimisation of a cost function, derived from a specific key network parameter, also results in BESS operation that impacts other parameters, indirectly associated to the same network operation. For example, when minimising the cost that was linked to BESS voltage deviation, then the worst voltage deviation, the worst line loadings and the network's neutral currents were also reduced, but voltage deviation, line loadings and power factor at substation level were worsened.

The analysis of simulations in Chapter 3 also showed that whilst the half-hourly average BESS schedule remained unaffected, there are positive and negative relationships between combinations of metrics being selected for optimisation and network performance assessment. A statistically significant positive impact (i.e. where $p < 0.05$) was proven for only certain pairs of network parameters (for example and as stated earlier, maximum bus voltage deviation, phase unbalance and neutral power when minimising voltage deviation at ESMU level). Nonetheless, showing that sub-half-hourly phase power adjustments can result in improved network operation formed the basis for the next chapter, Chapter 4, where the half-hourly active power constraints were eliminated.

Chapter 4 relaxed the constraint on half-hourly average schedule of a BESS and applied model-predictive approach for sub-half-hourly adjustment. More specifically,

it presented an approach in combining both on-line and off-line energy storage control to dynamically reduce both daily and minutely load peaks. An average peak load reduction of 5kW was achieved for the best algorithm configuration without reaching a surplus or shortage of stored energy since a half-hourly BESS schedule (similar to Chapter 3) was followed. Unlike the preceding chapter however, the BESS control in Chapter 4 had operational flexibility within a certain tolerance band of 10% around its predetermined half-hourly schedule. Combined with a predictor to estimate the sub-half-hourly power volatility, results were achieved that noticeably reduced load peaks in comparison to the traditional forecast driven control. In fact, as shown in Figure 4.9, the mean peak load reduction increased from 1.7kW to around 5kW for different prediction mechanisms. These findings from Chapter 3 and Chapter 4 thus form the contribution to knowledge regarding **Objective 1** and **Objective 2**, respectively.

Chapter 5 explores the impact of communication latency on the coordination of charging for multiple EVs, which demonstrated that the stability of asynchronous coordination is less sensitive to the choice of control parameter values. For example, they simply used all network information when computing BESS control instructions without considering possible latency issues. Therefore, Chapter 5 developed the new smart-charging algorithm and used a novel MAS implementation that operated in an intentionally desynchronised manner. This desynchronisation was to assess the algorithm performance when the previously assumed communication infrastructure becomes less reliable. Since uncoordinated EV charging is expected to put the most significant load on the LV network, any algorithm failure (like failure to coordinate this charging) would become noticeable. And indeed, the results in Chapter 5 showed that the converging behaviour of the algorithm became less sensitive to its control parameters in the desynchronised environment, when compared to the traditional synchronised algorithm execution. For example, when extreme control parameter values

were chosen, an oscillating behaviour was observed for the synchronised case which lead to the repetitive allocation of a 200kW charging spike. However, this oscillating behaviour disappeared in the desynchronised case which meant that the algorithm converged on a global level. In this desynchronised case the algorithm’s performance and convergence became less sensitive to the choice of control parameter values. This fact became particularly apparent when the overall performance of avoiding charging peaks between the synchronised case (i.e. Figure 5.8) and the fully desynchronised case (i.e. Figure 5.12) was compared. Chapter 5 therefore achieved **Objective 3** by developing a robust smart-charging algorithm that is thoroughly assessed in regards to possible communication desynchronisation.

Lastly, Chapter 6 proposes an improvement on an iterative and uncoordinated BESS algorithm for voltage support and the improved algorithm achieves more uniform voltage support. More specifically, in Chapter 6 a communication-less control method for distributed BESS was developed to reduce peak load, voltage deviation and unequal asset utilisation. This communication-less control was achieved by using individualised control parameters in a modified AIMD algorithm. Dynamic loads (i.e. uncoordinated EVs) were simulated on the feeder to maximise the stress on the LV network that the developed control algorithm aimed to mitigate. The results showed that for different EV uptake levels, BESS could always yield improvements for both AIMD and the proposed AIMD+ control methods. However, as seen in Figure 6.13, only the latter method did compensate uniformly across the LV network since it took into account the network specific voltage characteristics like the voltage drop along the feeder. Therefore, these findings formed the contribution to knowledge regarding **Objective 4**.

The research over these four chapters has shown that energy storage algorithms can be improved by merging on-line and off-line control at high and low temporal resolution. Additionally, the research has shown that desynchronised control instruc-

tions can yield significantly different operation of otherwise synchronised control algorithms. However, this issue can be avoided when mitigating the need for communication technology altogether. In each chapter, this thesis comprehensively tested the presented control algorithms on real demand data, allowing it to encapsulate varying demand behaviour and characteristics at both high and low temporal resolutions. All findings were generated from the available datasets and were therefore subject to its properties of comprehensively capturing typical demand behaviours.

In summary, it is concluded that individual control algorithms presented in this thesis provide an improvement on the network operation using different aspects of control, but there is no algorithm presented that combines all aspects. However, results showed that focused control can be tuned to achieve a significantly higher positive impact on a narrow set of key parameters, which is why the chapters that implement such methods did also present the means of implementing their control in regards to the available data (thus achieving the subsequent network improvements which were derived from data driven simulations). Nonetheless, all objectives that were set out in the problem statement of this thesis have been met by making the aforementioned key contributions. One can therefore conclude that the research presented in this thesis is beneficial to both industry and the academic research community. These contributions to knowledge, possible research limitations and future work discussing these benefits, are outlined in the subsequent sections.

7.2 Contribution to Knowledge

The main contribution presented in this thesis is the development of control methods for BESS in the LV network that improve network operation (for example power flow, voltage deviation and phase unbalance) whilst taking into account telecommunication limitations (for example possible desynchronisation or total absence of a communica-

tion infrastructure) in later chapters. With this knowledge, when developing BESS control systems, on-line and off-line control methods can be combined to complement each other whilst keeping in mind limitations regarding their ICT implementation. All in all, the chapters presented in this thesis made contributions within these identified gaps and in accordance to the outlined research objectives, these contributions are summarised as follows:

- In accordance with **Objective 1**, Chapter 3 has proposed a control algorithm to adjust the active and reactive BESS operation whilst maintaining given BESS schedule and achieving improved network operation. Findings in Chapter 3 showed how network issues (for example voltage deviation, neutral currents, phase unbalance and losses) can be reduced individually when adjusting BESS operation at a sub-half-hourly resolution, even though the BESS was constrained by an active power schedule at half-hourly time scale. Knowing how improving one key network parameter impacts different network operation is of relevance to industry since their limited network observability constrains their assessment of any control actions. Being able to infer and possibly predict the overall network impact from a limited set of measurements allows DNOs to better control BESS and thus improve operation of their LV networks.
- Then, in Chapter 4, a method to dynamically correct BESS schedules was developed in order to control DNO owned BESS and to maximise its capabilities at reducing both daily demand peaks whilst also mitigating volatile load peaks. This method is thus in accordance with **Objective 2** and findings in Chapter 4 showed how the control method outperformed traditional BESS control and how the probability of reducing peak load could be noticeably increased. Having developed such a method that functions despite the underlying errors in the load forecasts allows DNOs to reduce the occurrence of power peaks and thus prevent possible tripping of protection equipment, for example. Therefore,

DNOs will be able to leverage the proposed dynamic control method instead of only relying on the accuracy of the underlying load forecast when aiming to ensure an undisrupted supply of electricity.

- Regarding **Objective 3**, in Chapter 5, a smart-charging algorithm for distributed control of an EV fleet was developed and simulated on a standardised Multi-Agent System (MAS) in both a synchronised and desynchronised environment to study the performance of the algorithm. Findings showed that the algorithm became less dependent on the underlying control parameters when executed in a desynchronised environment, yet the overall performance of the algorithm remained intact. This difference in performance highlights the danger of assuming that distributed algorithms will function in any environment. With this knowledge, both academic and industry based research can take into account the effect of latency on an algorithm when designing their own BESS control systems.
- Lastly, in accordance with **Objective 4**, a communication-less control method for distributed BESS was developed in Chapter 6 to assess the ability at reducing the negative impact from the charging of co-located EVs. Findings showed that the developed AIMD+ algorithm did not only reduce load peaks and voltage deviation, but that it also harmonised the asset utilisation across the entire feeder. The achievement of this improvement was due to the individual algorithm tuning which was based on the properties of the underlying power delivery network. Whilst academic and industry based research projects typically use historic demand data to derive set-points for their control algorithms, system models allow better tuning when the traditional demand assumptions no longer hold. This was done in Chapter 6 which is why a stochastic EV model was developed to simulate a future load scenarios. Such an approach in combination

with the proposed AIMD+ algorithm would therefore benefit the planning and performance assessment of future power distribution networks.

7.3 Research Limits

Throughout Chapters 3 to 6, several models, algorithms and assumptions were presented that formed the basis of the conducted research. This basis allowed a focused research execution, but also imposed limitations on the developed methods. After all, since these models, algorithms and assumptions formed the basis of the conducted research, their limitations and their implications for academia and industry should be discussed. This is done in the following subsections.

7.3.1 Energy storage model

From an academic standpoint, modelling is seen as a first step to mathematically represent a system to simulate experiments that are conducted before investing in larger field trials. The energy store model that was developed during the *NTVV* project with *SSEN* is such an academic model since it was targeted at only representing the deployed BESS. Whilst this model did predict SOC behaviour, conversion and energy storage efficiencies, it did not take into account external effects, for example. For the assessment of BESS in a half-hourly and minutely environment, this model was adequately accurate since the power and time scales were sufficiently large so as to neglect small discrepancies. However, when taking into account external disturbances, more work needs to be done in the future. A possible extension should include the non-linear discharging behaviour as a result of battery stress or due to different operating temperatures since they have a noticeable impact on the battery operation. Nonetheless, having established the presented model for simulated experiments is the first step towards field testing BESS.

On that note, and as mentioned in the literature review (Section 2.3.2), *SSEN* did in fact deploy several ESMUs in the town of Bracknell as a result of the *NTVV* project and the work presented in this thesis. This deployment allowed to draw a first conclusion regarding the industrial applicability of the developed model. It was found that latency issues, dynamic control restrictions and safety precautions played a much larger role when managing the operation of BESS than the above-mentioned non-linear effect. On a positive note, however, and as may be taken from the *NTVV* project reports [3] when operating within its nominal mode the behaviour of the BESS did match the predictions made by the model. Although different battery models including RC-bridges, steady state systems or more complex feedback systems exist, these preliminary results showed that it was valid to use the developed model at least within the scope of the *NTVV* project.

7.3.2 Electric vehicle charging

In Chapter 6 of this thesis a stochastic EV model was developed to simulate the predicted increase in electricity demand. Being based on statistical data from 2008, this model does however bring inherent temporal limitations since driving behaviour most likely changed since then. Also, the typical commuter leaving home in the morning or lunch time and returning (or leaving work) in the evening has also seen changes. After all, fleet-cars, home-office and night-shifts can avoid commuting at those times and are reasonable possibilities impacting the driving behaviour. Therefore, assuming that charging will take place at home is an assumption necessary for the conducted work and valid at the time of formulating the research objective. However, charging stations or power sockets at work weaken this assumption since the necessity for home-based charging is being steadily removed.

Therefore, one concludes that the EV demand model has noticeable limitations, but for the sake of academic research and focus on the problem of home-charging, a

worst case assumption was still worth considering. After all, if co-located BESS is able to provide noticeable network support during the most extreme scenarios, then a proportionally larger impact can be achieved when the network is less stressed. Nonetheless, since EV technology and the use of EV technology has noticeably changed over less than a decade, providing a future proof EV demand model is a challenge worthy of its own doctoral research project. It is therefore reasonable to consider the presented model as a sufficient first step to provide an estimated charging demand for commuters. Possible extensions are therefore discussed in the Future Work section (Section 7.4) of this thesis.

7.3.3 Data

All findings throughout the presented work were generated from historic demand data. This data has both limitations in temporal resolution and data length, which therefore limit the ability to capture a number of load scenarios necessary to guarantee correct algorithm operation. After all, since the entire work presented in this thesis relies on carrying out data driven simulations, using these datasets with varying demand characteristics is of high importance. More specifically, the size of the used Irish dataset allows to cover such a range with high certainty, but it has a low temporal resolution of only half an hour. Using minutely data from the IEEE and the *NTVV* project complemented this Irish dataset since they compensate for its temporal deficiencies. It is worth mentioning, that obtaining domestic demand data is a challenge to begin with; partially due to privacy, but also due to IP issues. However, constructing models and stating the corresponding assumptions that validate their utilisation is sufficient for the development and testing of the presented BESS control methods. Needless to say, the scope of this thesis was put on the development of BESS control methods and not on development of load prediction mechanisms.

By differentiating between measurable and theoretical data (for example data

measurable at a substation and data only obtainable from simulations) motivations to develop targeted measurement systems are also better understood. For instance, measuring or better estimating feeder voltages is of larger interest than precise calculation of neutral currents since obtaining those network parameters in reality can only be done at significant financial cost or at unusable low resolution. Substation monitoring and voltage measurements at the BESS were a certain prerequisite for most of the presented research and do not pose such financial issues. Therefore, being able to include data acquisition mechanisms that are comparable to reality (for example data acquisition through the deployment of smart-meters) would strengthen the validity of the findings. In cases where data acquisition is not possible, however, either due to the lack of measuring equipment or legal barriers to uphold customer privacy, endpoint data needs to be estimated instead. Developing a reliable method of estimating this endpoint data from a limited number of measuring points is still an open research challenge. This point is also briefly addressed in the Future Work section of this thesis (Section 7.4), but more emphasis is put on data handling and acquisition from an industrial point of view. All in all however, the domestic demand predictions and publicly available datasets do serve as a valid starting point for the conducted academic research.

7.3.4 Network models and Power Flow Simulations

The dominant network model that was used throughout the research was a European LV model published by the IEEE. This so called “LV Test Case” complemented some of the in-house network models that were provided by SSEN - particularly since reproducibility of the findings can assured with the IEEE model. However, this model aims at presenting a typical European feeder, yet feeding two households per lateral on a single-phase basis is a characteristic shared by only by some distribution networks in the UK. In the German distribution networks, each household is always connected to

all three phases and specialised technicians aim to balance the three-phase load when connecting large domestic appliances in the house. Since the focus of the research is however targeted at supporting UK based networks to begin with, the use of models of several UK power networks is still valid. When, for example assessing whether the algorithms function where three-phase loads are connected, different models need to be considered.

The method of averaging the results from multiple simulations is only statistically valid if the number of network models is of sufficient size. After all, the correctness of the models cannot be guaranteed (for example due to degradation or misinformation). In conclusion, a higher number of detailed and accurate network models allows the proposed algorithms to be tested with larger network variety, which in turn improves certainty that the proposed algorithms functions correctly if deployed. This is also briefly addressed in the Future Work section.

7.3.5 Different Control Methods

So far, the selection of control methods was based on both literature recommendations and the scope of the presented research. As already stated in Chapters 4 and 6, the modifications and tuning of the control methods was unconventional. For a valid contribution in the field of control systems for example, a more formal approach would have to be formulated to assure stability and convergence of the proposed predictor. The complexity of the underlying network and battery models did however increase the difficulty of establishing this formal approach. This means that the associated work is certainly worth its own doctoral research and due to the time constraints a different solution was pursued instead. Therefore, assuring stability and convergence for the used data was considered the valid approach. This assumption goes hand in hand with the preceding discussion about data and number of used network models. After all, since this data captured sufficient load variation, findings are seen as valid.

Further, since the stability and convergence can be guaranteed for this dataset, it is also reasonable to assume that the methods will operate similarly when deployed. Nonetheless, the above-mentioned formal approach would also proof stability and convergence mathematically, which is why this proof is indeed worth pursuing as part of the future work.

7.3.6 Communication System

Lastly, Chapter 5 addressed the common assumption that control instructions propagate in a synchronised manner. However, other communication issues beside message desynchronisation do still remain an open research challenge. As mentioned in the beginning of this section, the field trials during the *NTVV* project found that delay and “hidden” safety systems increase the difficulty of providing scheduled BESS control. Also, a sudden loss of communication will result in a cluster of control devices, operating in a so called “islanded” or unsupervised manner (especially from an ICT point of view). However, the assumption made for assessing the effect of desynchronisation are valid, especially since the focus of the research had to be targeted at the known problem at hand. With the posterior knowledge regarding ESMU operation from the *NTVV* field trials, further studies regarding the communication system are worth pursuing. However, these further issues do lie beyond the scope of the presented research, but should be included in the future work.

7.4 Future Work

The models, algorithms and control methods presented in this thesis provide an assessment of the impact of BESS on LV distribution networks in the UK. Regarding the limitations outlined in Section 7.3 it is worth discussing the next steps for improving the models from an academic standpoint to eventually make them “industry ready”.

These considerations are discussed in the subsequent subsections before concluding on the entire work presented in this thesis.

7.4.1 Modelling

The developed BESS model did perform to accurately schedule the ESMU operation during the field trials of the *NTVV* project. However, there are still certain enhancements that should be considered in future research to extend this BESS model. The non-linearity regarding the battery's charging behaviour for instance should be included since a better understanding of battery characteristics has been established over the recent past. This is partially due to the increased number of EVs where battery information is continuously fed back to manufacturers, but also due to the increased industrial demand for improved battery cells. Constant-current constant-voltage charging paradigms, temperature, mechanical integrity, degradation and battery conditioning are only some examples of battery characteristics that have become better understood. Additionally, from the lessons learnt during the *NTVV* field trials, safety mechanisms, operating independent of the BESS instructions (i.e. instructions sent from a control centre) should also be included into the model. After all, it were those safety mechanisms that physically limited BESS to operate as scheduled; and this limitation occurred without warning. Predicting when these safety mechanisms will allow a better schedule generation. For example, taking into account temperature increase allows a better prediction of when the safety mechanism will disconnect the battery and a more strategic charging profile can be generated in advance. The data collected during the field trials is therefore a great starting point to continue the further research for enhanced BESS models. In future work, such data does not only highlight unconsidered issues, but also aids the simulation of battery control algorithms since it also takes into account the battery conditions itself.

Equally, the EV demand model where it was assumed that vehicles charge at home

and begin doing so immediately after being connected, is considered an outdated assumption. Although this so called “dumb-charging” is still seen as the baseline when determining the worst impact of EVs on power networks, more sophisticated and coordinated charging mechanisms (like the one hinted at in Chapter 5) do certainly mitigate the impact of EV charging. For example, the proposed AIMD+ algorithm can be run on EVs directly and such an inclusion of smart charging is a promising future work project. However, the implementation, validation and extension of available smart-charging schemes currently lies beyond the scope of this thesis.

Regarding the use of network models to assess the impact on the LV network is also considered as future work. It is even contemplated to use real-time simulations in order to support BESS control. After all, power flow solvers like OpenDSS, PowerSim, GridLab-D or similar tools are frequently used throughout literature to create accurate assessments of network impact and they are being continuously improved, too. Using such faster and more accurate tools allows real-time response to system changes that were not possible at the beginning of the presented doctoral research. OpenDSS, for example, only recently became multi-threaded and opened its repository for open-source development. Also, having learnt how the standardised IEEE network model is structured allows future work to fully utilise the updated collection of network models in an IEEE compliant manner. Such compliance does not only allow a better comparative studies, but with the updated tools enables assessment of network failures, harmonics and islanded operation. Furthermore, with improved and updated network information that is provided by SSEN, simulations will give more realistic results regarding the location and scaling of LV assets. In fact, private correspondence with researchers at the Electric Power Research Institute (EPRI) and the National Energy Research Laboratory (NERL) in the United States has become possible as a result of this doctoral research and a cooperative development to extend OpenDSS for multiple platforms is currently ongoing. This cooperation entails the

acceleration of simulations of network models by parallelising the power flow solver and porting the execution to different programming languages. Therefore, the possibility of extending the number of simulated trials would improve the certainty of BESS performance before committing it to further field trials. However, for the scope of the conducted research and time limitation imposed, any improvements of network models and simulation tools will only be part of the future work.

7.4.2 Realisation considerations for DNO

Regarding industrial applicability, the main question to make BESS control algorithm viable depends on the ownership and revenue mechanisms. Future research work is therefore required to assess the monetary benefits of the proposed algorithms for BESS owners since they would not have invested into the asset, unless it generates them a profit. Optimisation objectives under a range of the BESS ownership models and commercial arrangements should therefore be considered beside the aspect regarding safety, improved modelling, data privacy and data security. After all, different owners prioritise different use cases for the asset. For example, if a DNO owned the BESS, they would want it to operate at maximum capacity to fully utilise the asset and produce the largest return for their investment. On the other hand, if BESS was owned by a household, a reduction of the electricity bill would be more interesting than providing network support. Therefore, establishing means to compensate or pay private owners for providing network support is considered as an incentive for private owners to partake in network support.

Finally, although the topic of data privacy and security is not part of the presented research as such, it is still worth discussing possible considerations in light of era of big data with Industry 4.0 and the Internet of Things. Put briefly, because the trend of computer based decision making is also becoming increasingly popular in the field of power delivery, risks regarding privacy concerns and ethics associated with

the decision making need to be considered. This is especially true since artificial intelligence is likely to outperform traditional deterministic and probabilistic control methods in the near future. In summary, an inter-disciplinary research category should focus on power delivery, control systems and telecommunication issues with particularly target of AI in power networks, and this should most certainly be part of the future work.

7.5 Conclusion

As identified in Chapter 1 of this thesis the aim of the presented work was to:

[...] make a contribution in control of Battery Energy Storage Systems (BESS) that can aid Distribution Network Operators (DNOs) in improving the operation and reliance of their Low-Voltage (LV) networks.

To achieve this aim, four objectives were identified from the literature review in Chapter 2 and met in the four contribution chapters of this thesis (i.e. Chapter 3 to Chapter 6). Within these chapters, key network parameters were identified to assess the impact of BESS control methods on the underlying power delivery network when adjusting BESS phase powers whilst conforming to a half-hourly schedule. When alleviating this scheduling constraint, it was shown how a developed dynamic BESS control can achieve greater reduction of power peaks. Then coordinated control of multiple BESS was assessed regarding the desynchronisation of control instructions. Since this analysis showed the sensitivity of control methods on their implementation (even when operating in a desynchronised environment) a truly communication less control algorithm was developed next. Through developing these algorithms and testing them by simulating several LV distribution network models, aspects involving network operation, system deployability, information propagation and telecommunication restrictions were studied. Therefore, a technical contribution that can aid

DNOs in improving the operation and reliance of LV networks has been achieved and thus the overarching aim was met.

The limitations of the presented research do, however, ask for future work to be conducted in order to ready the algorithms and methods for implementation in industry. Beside the restrictions outlined in Section 7.3 due to time constraints and the targeted research focus, future work will comprise further improvement of network and BESS models, mathematical formulation of proof of stability and convergence. Furthermore, DNOs should address the issue of ownership and possible means of incentivising customers to provide network support with their home-connected assets. Also, safety, security and ethics associated with emerging control methods and data handling should also be considered, not only by academics, but also by industry, their customers and legislation makers.

Overall, in the context of power systems, the conducted research focused on providing improvements at the fringes of the electricity network; that is at the LV distribution level. With the international aim of transitioning towards a low-carbon economy, national issues are mostly expected to occur in the transmission and interconnection of electricity grids. This issue is particularly apparent when planning the generation of bulk power at remote locations (for example offshore) without having installed the required power lines. Equally, with higher reliance on renewable energy resources, national power systems must become more flexible to not only cater for the volatility in demand but also for the expected intermittency in supply. Whilst energy storage on a national scale would address the difficulty of matching modern supply and demand, the complexity of a project, the size and the associated cost make deployment of such a system a significant logistic challenge. By focusing on smaller scaled projects first (i.e. BESS in the LV networks) the first step is provided towards this larger goal. After all, it is easier to develop, test and eventually deploy control algorithms on such a smaller scale than it is for larger scaled projects. Also, at the

end of the day, it is the DNO that needs to provide the final physical link between demand and supply and their power delivery networks are expected to cater for the immediate increase in volatile demand. Therefore, targeting research at this fringe of the electricity network provides a small contribution to the overall operation of the electricity network, but this research still provides support for DNOs when catering for the future load scenarios.

References

- [1] National Grid, “Future Energy Scenarios How to use this document To help you find the information you need quickly and easily we have published the FES,” Tech. Rep. July, 2017.
- [2] Deloitte, “Energy storage: Tracking the technologies that will transform the power sector,” tech. rep., 2016.
- [3] M. Coulthard, M. Fila, G. Evans, R. Potter, and Scottish and Southern Energy Power Distribution, “New Thames Valley Vision, SDRC 9.8a (4) Report, LV Network Energy Storage ESMU Trials,” tech. rep., 2015.
- [4] Power and Energy Society, “Distribution Test Feeders,” 2017.
- [5] HM Government, *The UK Low Carbon Transition Plan: National strategy for climate and energy*. 2009.
- [6] Royal Academy of Engineering, *Generating the Future: UK energy systems fit for 2050*. 2010.
- [7] A. Poghosyan, D. V. Greetham, S. Haben, and T. Lee, “Long term individual load forecast under different electrical vehicles uptake scenarios,” *Appl. Energy*, vol. 157, pp. 699–709, 2014.
- [8] National Grid, “Winter Review and Consultation - 2017,” Tech. Rep. June, 2017.

- [9] National Grid, “Winter Outlook Report 2009/10,” Tech. Rep. October 2009, 2010.
- [10] UK Power Networks, “Design and Planning - Framework for underground networks in UK Power Networks,” tech. rep., 2014.
- [11] Statutory Instruments, “The Electricity (Connection Standards of Performance) Regulations 2015,” Tech. Rep. 698, 2015.
- [12] S. Cuddihey and S. Mockford, “Engineering Design Standar - EDS 08-0115 - Loading of Secondary Distribution Transformers,” Tech. Rep. 1, UK Power Networks, 2015.
- [13] Health and Safety Executive, “Electricity Safety, Quality and Continuity Regulations (ESQCR),” 2002.
- [14] Energy Networks Association, “Engineering Recommendation G59 Issue 3: Recommendations for the Connection of Generating Plant to the Distribution Systems of Licensed Distribution Network Operators,” tech. rep., 2013.
- [15] Electricity North West Ltd, “Low Voltage Network Solutions, A First Tier Low Carbon Networks Fund Project, Closedown Report,” Tech. Rep. June, 2014.
- [16] A. Woyte, V. V. Thong, R. Belmans, and J. Nijs, “Voltage fluctuations on distribution level introduced by photovoltaic systems,” *IEEE Trans. Energy Convers.*, vol. 21, no. 1, pp. 202–209, 2006.
- [17] I. Richardson, M. Thomson, D. Infield, and C. Clifford, “Domestic electricity use: A high-resolution energy demand model,” *Energy Build.*, vol. 42, no. 10, pp. 1878–1887, 2010.

- [18] T. Yunusov, D. Frame, W. Holderbaum, and B. Potter, “The impact of location and type on the performance of low-voltage network connected battery energy storage systems,” *Appl. Energy*, vol. 165, pp. 202–213, 2016.
- [19] X. Fang, S. Misra, G. Xue, and D. Yang, “Smart Grid — The New and Improved Power Grid: A Survey,” *IEEE Commun. Surv. Tutorials*, vol. 14, no. 4, pp. 944–980, 2012.
- [20] G. Ault, D. Frame, N. Hughes, and N. Strachan, “Electricity Network Scenarios for Great Britain in 2050,” tech. rep., 2008.
- [21] H. Chen, T. N. Cong, W. Yang, C. Tan, Y. Li, and Y. Ding, “Progress in electrical energy storage system: A critical review,” *Prog. Nat. Sci.*, vol. 19, no. 3, pp. 291–312, 2009.
- [22] G. P. Harrison, A. Piccolo, P. Siano, and a. R. Wallace, “Exploring the tradeoffs between incentives for distributed generation developers and DNOs,” *IEEE Trans. Power Syst.*, vol. 22, no. 2, pp. 821–828, 2007.
- [23] M. J. Zangs, P. B. E. Adams, T. Yunusov, W. Holderbaum, and B. A. Potter, “Distributed energy storage control for dynamic load impact mitigation,” *Energies*, vol. 9, no. 8, 2016.
- [24] T. van der Klauw, J. Hurink, and G. Smit, “Scheduling of Electricity Storage for Peak Shaving with Minimal Device Wear,” *Energies*, vol. 9, p. 465, 2016.
- [25] D. M. Greenwood, N. S. Wade, P. C. Taylor, P. Papadopoulos, and N. Heyward, “A Probabilistic Method Combining Electrical Energy Storage and Real-Time Thermal Ratings to Defer Network Reinforcement,” *IEEE Trans. Sustain. Energy*, vol. 8, no. 1, pp. 374–384, 2017.

- [26] N. S. Wade, P. C. Taylor, P. D. Lang, and P. R. Jones, "Evaluating the benefits of an electrical energy storage system in a future smart grid," *Energy Policy*, vol. 38, no. 11, pp. 7180–7188, 2010.
- [27] O. Palizban and K. Kauhaniemi, "Energy storage systems in modern grids — Matrix of technologies and applications," *J. Energy Storage*, vol. 6, pp. 248–259, 2016.
- [28] Y. Yang, H. Li, A. Aichhorn, J. Zheng, and M. Greenleaf, "Sizing strategy of distributed battery storage system with high penetration of photovoltaic for voltage regulation and peak load shaving," *IEEE Trans. Smart Grid*, vol. 5, no. 2, pp. 982–991, 2014.
- [29] C. J. Bennett, R. A. Stewart, and J. W. Lu, "Development of a three-phase battery energy storage scheduling and operation system for low voltage distribution networks," *Appl. Energy*, vol. 146, pp. 122–134, 2015.
- [30] L. Wang, D. Liang, A. F. Crossland, P. C. Taylor, D. Jones, and N. S. Wade, "Coordination of Multiple Energy Storage Units in a Low Voltage Distribution Network," *IEEE Trans. Power Syst.*, vol. 6, no. 6, pp. 2906–2918, 2015.
- [31] C. Cecati, C. Citro, and P. Siano, "Combined operations of renewable energy systems and responsive demand in a smart grid," *IEEE Trans. Sustain. Energy*, vol. 2, no. 4, pp. 468–476, 2011.
- [32] A. Chaouachi, R. M. Kamel, R. Andoulsi, and K. Nagasaka, "Multiobjective Intelligent Energy Management for a Microgrid — Aymen Chaouachi - Academia," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1688–1699, 2013.
- [33] R. Palma-Behnke, C. Benavides, F. Lanas, B. Severino, L. Reyes, J. Llanos, and D. Saez, "A microgrid energy management system based on the rolling horizon strategy," *IEEE Trans. Smart Grid*, vol. 4, no. 2, pp. 996–1006, 2013.

- [34] A. Khodaei, “Microgrid Optimal Scheduling With Multi-Period Islanding Constraints,” *IEEE Trans. Power Syst.*, vol. 29, no. 3, pp. 1383–1392, 2014.
- [35] S. Salinas, M. Li, P. Li, and Y. Fu, “Dynamic Energy Management for the Smart Grid With Distributed Energy Resources,” *Smart Grid, IEEE Trans.*, vol. 4, no. 4, pp. 2139–2151, 2013.
- [36] Y. Huang, S. Mao, and R. M. Nelms, “Adaptive electricity scheduling in microgrids,” in *INFOCOM, 2013 Proc. IEEE*, pp. 1142–1150, 2013.
- [37] Y. Huang, S. Mao, and R. M. Nelms, “Adaptive electricity scheduling in microgrids,” *IEEE Trans. Smart Grid*, vol. 5, no. 1, pp. 270–281, 2014.
- [38] S. Sun, M. Dong, and B. Liang, “Joint Supply, Demand, and Energy Storage Management Towards Microgrid Cost Minimization,” *IEEE Int. Conf. Smart Grid Commun. Jt.*, pp. 109–114, 2014.
- [39] G. Mokhtari, G. Nourbakhsh, and A. Ghosh, “Smart coordination of energy storage units (ESUs) for voltage and loading management in distribution networks,” *IEEE Trans. Power Syst.*, vol. 28, no. 4, pp. 4812–4820, 2013.
- [40] M. R. Sarker, M. A. Ortega-Vazquez, and D. S. Kirschen, “Optimal Coordination and Scheduling of Demand Response via Monetary Incentives,” *IEEE Trans. Smart Grid*, vol. 6, no. 3, pp. 1341–1352, 2015.
- [41] K. Baker, J. Guo, G. Hug, and X. Li, “Distributed MPC for Efficient Coordination of Storage and Renewable Energy Sources Across Control Areas,” *IEEE Trans. Smart Grid*, vol. 7, no. 2, pp. 992–1001, 2016.
- [42] T. Baumann and F. Baumgartner, “Home Batteriespeicher Studie für solarspar,” tech. rep., Zurich University of Applied Science - School of Engineering, 2017.

- [43] E. Sortomme, M. M. Hindi, S. D. J. MacPherson, and S. S. Venkata, “Coordinated Charging of Plug-In Hybrid Electric Vehicles to Minimize Distribution System Losses,” *IEEE Trans. Smart Grid*, vol. 2, no. 1, pp. 198–205, 2011.
- [44] M. G. Vaya and G. Andersson, “Centralized and decentralized approaches to smart charging of plug-in Vehicles,” in *IEEE Power Energy Soc. Gen. Meet.*, (San Diego, CA), pp. 1–8, IEEE, 2012.
- [45] J. García-Villalobos, I. Zamora, J. San Martín, F. Asensio, and V. Aperribay, “Plug-in electric vehicles in electric distribution networks: A review of smart charging approaches,” *Renew. Sustain. Energy Rev.*, vol. 38, pp. 717–731, oct 2014.
- [46] E. L. Karfopoulos and N. D. Hatziaargyriou, “A Multi-Agent System for Controlled Charging of a Large Population of Electric Vehicles,” *IEEE Trans. Power Syst.*, vol. 28, pp. 1196–1204, may 2013.
- [47] P. Samadi, H. Mohsenian-Rad, R. Schober, and V. W. S. Wong, “Advanced Demand Side Management for the Future Smart Grid Using Mechanism Design,” *IEEE Trans. Smart Grid*, vol. 3, no. 3, pp. 1170–1180, 2012.
- [48] Y. Liu, C. Yuen, S. Huang, N. Ul Hassan, X. Wang, and S. Xie, “Peak-to-average ratio constrained demand-side management with consumer’s preference in residential smart grid,” *IEEE J. Sel. Top. Signal Process.*, vol. 8, no. 6, pp. 1084–1097, 2014.
- [49] H. Liang, A. K. Tamang, W. Zhuang, and X. S. Shen, “Stochastic Information Management in Smart Grid,” *IEEE Commun. Surv. Tutorials*, vol. PP, no. 99, pp. 1–25, 2014.
- [50] T. L. Baldwin and S. A. Lweis, “Distribution Load Flow Methods for Shipboard Power Systems,” *IEEE Trans. Ind. Appl.*, vol. 40, no. 5, pp. 1183–1190, 2004.

- [51] N. L. Díaz, J. C. Vasquez, and J. M. Guerrero, “A Communication-less Distributed Control Architecture for Islanded Microgrids with Renewable Generation and Storage,” *IEEE Trans. Power Electron.*, vol. 8993, no. c, pp. 1–1, 2017.
- [52] M. Wilks, “Demand side response : Conflict between supply and network driven optimisation. A report to DECC,” Tech. Rep. November, 2010.
- [53] US Department of Energy, “DOE Global Energy Storage Database,” 2017.
- [54] G. Garton and D. E. A. Grimwood, “Energy Storage in the UK An Overview,” Tech. Rep. 07621, 2016.
- [55] F. R. Kalhammer, “Energy-Storage Systems,” *Sci. Am.*, vol. 241, no. 6, pp. 42–51, 1979.
- [56] J. Eyer and G. Corey, “Energy Storage for the Electricity Grid : Benefits and Market Potential Assessment Guide,” tech. rep., Sandia National Laboratories, 2010.
- [57] M. Katsanevakis, R. A. Stewart, and J. Lu, “Aggregated applications and benefits of energy storage systems with application-specific control methods: A review,” *Renew. Sustain. Energy Rev.*, vol. 75, no. August 2016, pp. 719–741, 2017.
- [58] M. S. Guney and Y. Tepe, “Classification and assessment of energy storage systems,” *Renew. Sustain. Energy Rev.*, vol. 75, no. February 2016, pp. 1187–1197, 2017.
- [59] R.-C. Leou, “An economic analysis model for the energy storage systems in a deregulated market,” *Electr. Power Energy Syst.*, vol. 34, no. 1, p. 132, 2012.

- [60] S. Koochi-Kamali, V. V. Tyagi, N. A. Rahim, N. L. Panwar, and H. Mokhlis, “Emergence of energy storage technologies as the solution for reliable operation of smart power systems: A review,” *Renew. Sustain. Energy Rev.*, vol. 25, pp. 135–165, 2013.
- [61] H. Khani, M. R. D. Zadeh, and R. Seethapathy, “Large-Scale Energy Storage Deployment in Ontario Utilizing Time-of-Use and Wholesale Electricity Prices: An Economic Analysis,” in *2014 CIGRÉ Canada Conf. Int. Cent.*, 2014.
- [62] N. K. C. Nair and N. Garimella, “Battery energy storage systems: Assessment for small-scale renewable energy integration,” *Energy Build.*, vol. 42, no. 11, pp. 2124–2130, 2010.
- [63] R. Luthander, J. Widén, J. Munkhammar, and D. Lingfors, “Self-consumption enhancement and peak shaving of residential photovoltaics using storage and curtailment,” *Energy*, vol. 112, pp. 221–231, 2016.
- [64] B. Zakeri and S. Syri, “Electrical energy storage systems: A comparative life cycle cost analysis,” *Renew. Sustain. Energy Rev.*, vol. 42, pp. 569–596, 2015.
- [65] W. Jewell and R. Ramakumar, “The effects of moving clouds on electric utilities with dispersed photovoltaic generation,” *IEEE Trans. Energy Convers.*, vol. EC-2, no. 4, pp. 570–576, 1987.
- [66] A. Chakraborty, S. K. Musunuri, A. K. Srivastava, and A. K. Kondabathini, “Integrating STATCOM and battery energy storage system for power system transient stability: A review and application,” *Adv. Power Electron.*, p. 12, 2012.
- [67] W. C. Dobie, “Electrical Energy Storage,” *Power Eng. J.*, vol. 12, no. 4, pp. 177–181, 1998.

- [68] S. Rehman, L. M. Al-Hadhrani, and M. M. Alam, “Pumped hydro energy storage system: A technological review,” *Renew. Sustain. Energy Rev.*, vol. 44, pp. 586–598, 2015.
- [69] E. Barbour, “Energy Storage Sense,” 2015.
- [70] E. Barbour, I. A. G. Wilson, J. Radcliffe, Y. Ding, and Y. Li, “A review of pumped hydro energy storage development in significant international electricity markets,” *Renew. Sustain. Energy Rev.*, vol. 61, pp. 421–432, 2016.
- [71] H. Bevrani and T. Hiyama, *Intelligent Automatic Generation Control*. CRC Press, 2011.
- [72] J. F. Cole, “Battery energy-storage systems — an emerging market for lead/acid batteries,” *J. Power Sources*, vol. 53, no. 2, pp. 239–243, 1995.
- [73] M. A. Kashem and G. Ledwich, “Energy requirement for distributed energy resources with battery energy storage for voltage support in three-phase distribution lines,” *Electr. Power Syst. Res.*, vol. 77, no. 1, pp. 10–23, 2007.
- [74] P. Kulkarni, J. H. Sayer, J. D. Boyes, G. P. Corey, and G. H. Peek, “The United States of Storage,” *IEEE Power Energy Mag.*, vol. 3, no. 2, pp. 31–39, 2005.
- [75] P. Kundur, *Power System Stability And Control*. McGraw-Hill Inc., 1993.
- [76] S. Kolluri, S. Member, and N. Orleans, “Application of Distributed Superconducting Magnetic Energy Storage System (D-SMES) in the Entergy System to Improve Voltage Stability,” in *IEEE Power Eng. Soc. Winter Meet.*, (New York, NY, USA), pp. 838–841, 2002.
- [77] L. Wang, L. Muh, and L. Huang, “Damping subsynchronous resonance using superconducting magnetic energy storage unit,” *IEEE Trans. Energy Convers.*, vol. 9, no. 4, pp. 770–777, 1994.

- [78] J. H. Sayer, “Guide to Estimating Benefits and Market Potential for Electricity Storage in New York,” tech. rep., 2007.
- [79] G. Huff, A. B. Currier, B. C. Kaun, D. M. Rastler, S. B. Chen, D. T. Bradshaw, and W. D. Gauntlett, “DOE/EPRI 2013 electricity storage handbook in collaboration with NRECA,” Tech. Rep. July, 2013.
- [80] A. Saez-de Ibarra, A. Milo, H. Gaztanaga, I. Etxeberria-Otadui, P. Rodríguez, S. Bacha, and V. Debusschere, “Analysis and comparison of battery energy storage technologies for grid applications,” *PowerTech (POWERTECH), 2013 IEEE Grenoble*, pp. 1–6, 2013.
- [81] E. Reihani, M. Motalleb, R. Ghorbani, and L. Saad Saoud, “Load peak shaving and power smoothing of a distribution grid with high renewable energy penetration,” *Renew. Energy*, vol. 86, pp. 1372–1379, 2016.
- [82] M. E. T. Gerards and J. L. Hurink, “Robust peak-shaving for a neighborhood with electric vehicles,” *Energies*, vol. 9, no. 8, 2016.
- [83] S. M. Schoenung and W. Hassenzahl, “Characteristics and Technologies for Long-vs. Short-Term Energy Storage A: Study by the DOE Energy Storage Systems Program,” Tech. Rep. March, 2001.
- [84] A. Oudalov, R. Cherkaoui, S. Member, and A. Beguin, “Sizing and Optimal Operation of Battery Energy Storage System for Peak Shaving Application,” in *2007 IEEE Lausanne Power Tech*, pp. 621–625, 2007.
- [85] K. Mackey, R. McCann, K. Rahman, and R. Winkelman, “Evaluation of a battery energy storage system for coordination of demand response and renewable energy resources,” *2013 4th IEEE Int. Symp. Power Electron. Distrib. Gener. Syst.*, pp. 1–8, 2013.

- [86] J. Aghaei and M. I. Alizadeh, "Demand response in smart electricity grids equipped with renewable energy sources: A review," *Renew. Sustain. Energy Rev.*, vol. 18, pp. 64–72, 2013.
- [87] G. Putrus, J. Wijayakulasooriya, and P. Minns, "Power quality: Overview and monitoring," in *ICIIS 2007 - 2nd Int. Conf. Ind. Inf. Syst. 2007, Conf. Proc.*, pp. 551–558, 2007.
- [88] J. Miret, M. Castilla, J. Matas, J. Guerrero, and J. Vasquez, "Selective Harmonic-Compensation Control for Single-Phase Active Power Filter With High Harmonic Rejection," *IEEE Trans. Ind. Electron.*, vol. 56, no. 8, pp. 3117–3127, 2009.
- [89] P. Taylor, C. Patsios, S. Munoz Vaca, D. Greenwood, and N. Wade, *Energy Storage Integration*. Elsevier Inc., 2016.
- [90] R. J. Bravo, R. Salas, T. Bialek, and C. Sun, "Distributed energy resources challenges for utilities," *2015 IEEE 42nd Photovolt. Spec. Conf. PVSC 2015*, 2015.
- [91] A. Mohd, E. Ortjohann, A. Schmelter, N. Hamsic, D. Morton, S. Westphalia, A. Sciences, D. Soest, and L. Ring, "Challenges in integrating distributed Energy storage systems into future smart grid," in *2008 IEEE Int. Symp. Ind. Electron.*, pp. 1627–1632, 2008.
- [92] G. N. Koureoumpezis, A. S. Safigianni, G. S. Demetzos, and J. G. Kendristakis, "Investigation of the distributed generation penetration in a medium voltage power distribution network," *Int. J. Energy Res.*, vol. 34, no. 7, pp. 585–593, 2010.
- [93] I. T. H. E. Resilience, "The Grid: Stronger, Bigger, Smarter?," *IEEE Power Energy Mag.*, vol. 13, no. April, pp. 58–66, 2015.

- [94] S. Grillo, M. Marinelli, S. Massucco, and F. Silvestro, “Optimal management strategy of a battery-based storage system to improve renewable energy integration in distribution networks,” *IEEE Trans. Smart Grid*, vol. 3, no. 2, pp. 950–958, 2012.
- [95] M. Rowe, T. Yunusov, S. Haben, C. Singleton, W. Holderbaum, and B. Potter, “A Peak Reduction Scheduling Algorithm for Storage Devices on the Low Voltage Network,” *IEEE Trans. Smart Grid*, vol. 5, no. 4, pp. 2115–2124, 2014.
- [96] M. Hosseina, S. Mohammad, and T. Bathaee, “Optimal scheduling for distribution network with redox flow battery storage,” *Energy Convers. Manag.*, vol. 121, pp. 145–151, 2016.
- [97] N. Li, C. Uckun, E. M. Constantinescu, J. R. Birge, K. W. Hedman, and A. Botterud, “Flexible Operation of Batteries in Power System Scheduling with Renewable Energy,” *IEEE Trans. Sustain. Energy*, vol. 7, no. 2, pp. 685–696, 2016.
- [98] Scottish and Southern Energy Power Distribution, DNV-GL, GE, Honeywell, L. Fund, University of Reading, and Bracknell Forest Council, “Thames Valley Vision - Project library - Published documents,” 2016.
- [99] P. F. Lyons, N. S. Wade, T. Jiang, P. C. Taylor, F. Hashiesh, M. Michel, and D. Miller, “Design and analysis of electrical energy storage demonstration projects on UK distribution networks,” *Appl. Energy*, vol. 137, pp. 677–691, 2015.
- [100] E.ON Energy, “E.ON breaks ground on Blackburn Meadows battery project,” 2017.
- [101] L. Dann, “Scottish Power pilots smart batteries in customer homes,” 2016.

- [102] P. D. F. Ferreira, P. M. S. Carvalho, L. A. F. M. Ferreira, and M. D. Ilic, "Distributed energy resources integration challenges in low-voltage networks: Voltage control limitations and risk of cascading," *IEEE Trans. Sustain. Energy*, vol. 4, no. 1, pp. 82–88, 2013.
- [103] W. Shi, N. Li, C. C. Chu, and R. Gadh, "Real-time energy management in microgrids," *IEEE Trans. Smart Grid*, vol. PP, no. 99, pp. 228–238, 2015.
- [104] H. Sun, Q. Guo, B. Zhang, W. Wu, and J. Tong, "Development and applications of system-wide automatic voltage control system in China," *2009 IEEE Power Energy Soc. Gen. Meet. PES '09*, pp. 1–5, 2009.
- [105] M. Zangs, T. Yunusov, W. Holderbaum, and B. Potter, "On-line adjustment of battery schedules for supporting LV distribution network operation," in *2016 Int. Energy Sustain. Conf. IESC 2016*, 2016.
- [106] M. Liserre, T. Sauter, and J. Y. Hung, "Future energy systems: Integrating renewable energy into the smart power grid through industrial electronics," *IEEE Ind. Electron. Mag.*, vol. 4, no. March, pp. 18–37, 2010.
- [107] N. Wade, P. Taylor, P. Lang, and J. SVENSSON, "Energy storage for power flow management and voltage control on an 11kV UK distribution network," *20th Int. Conf. Electr. Distrib.*, no. June, p. 0824, 2009.
- [108] F. Overbeeke and S. Cobben, "Operational aspects of a microgrid with battery storage," in *Innov. Smart Grid Technol. Eur. (ISGT Eur. IEEE)*, pp. 1–5, 2010.
- [109] GROWDERS, "Grid Reliability and Operability with Distributed Generation using Transportable Final activity report," tech. rep., 2011.
- [110] H. Sugihara, K. Yokoyama, O. Saeki, K. Tsuji, and T. Funaki, "Economic and efficient voltage management using customer-owned energy storage systems in

- a distribution network with high penetration of photovoltaic systems,” *IEEE Trans. Power Syst.*, vol. 28, no. 1, pp. 102–111, 2013.
- [111] UK Power Networks, “Use of smart meter information for network planning and operation,” tech. rep., 2014.
- [112] Ofgem, “RIIO - Electricity Distribution - Annual Report 2015-16,” Tech. Rep. February, 2017.
- [113] Ofgem, “December 2013 UK Storms Review – impact on electricity distribution customers,” Tech. Rep. March, 2014.
- [114] G. Putrus, P. Suwanapingkarl, D. Johnston, E. Bentley, and M. Narayana, “Impact of electric vehicles on power distribution networks,” in *2009 IEEE Veh. Power Propuls. Conf.*, pp. 827–831, 2009.
- [115] J. R. Pillai and B. Bak-Jensen, “Vehicle-to-grid systems for frequency regulation in an islanded Danish distribution network,” *2010 IEEE Veh. Power Propuls. Conf. VPPC 2010*, 2010.
- [116] H. J. Kunisch, K. G. Kramer, and H. Dominik, “Battery Energy Storage - Another Option for Load-Frequency-Control and Instantaneous Reserve,” *IEEE Power Eng. Rev.*, vol. PER-6, no. 9, pp. 24–25, 1986.
- [117] H. J. Kunisch, K. G. Kramer, and H. Dominik, “Battery Energy Storage Another Option for Load-Frequency-Control and Instantaneous Reserve,” *IEEE Trans. Energy Convers.*, vol. EC-1, no. 3, pp. 41–46, 1986.
- [118] A. Engler and N. Soultanis, “Droop control in LV-grids,” in *2005 Int. Conf. Futur. Power Syst.*, (Amsterdam), IEEE, 2005.

- [119] U. B. Tayab, M. A. B. Roslan, L. J. Hwai, and M. Kashif, "A review of droop control techniques for microgrid," *Renew. Sustain. Energy Rev.*, vol. 76, no. March, pp. 717–727, 2017.
- [120] Y. Riffonneau, S. Bacha, F. Barruel, and S. Ploix, "Optimal Power Flow Management for Grid Connected PV Systems With Batteries," *IEEE Trans. Sustain. Energy*, vol. 2, no. 3, pp. 309–320, 2011.
- [121] A. Sani Hassan, L. Cipcigan, and N. Jenkins, "Optimal battery storage operation for PV systems with tariff incentives," *Appl. Energy*, vol. 203, pp. 422–441, 2017.
- [122] A. De Paola, D. Angeli, and G. Strbac, "Distributed Control of Micro-Storage Devices With Mean Field Games," *IEEE Trans. Smart Grid*, vol. 7, no. 2, pp. 1119–1127, 2016.
- [123] Scottish and Southern Electricity Networks, "Battery Storage Workshop - Walton Park," Tech. Rep. April, 2016.
- [124] M. Rowe, T. Yunusov, S. Haben, W. Holderbaum, and B. Potter, "The real-time optimisation of DNO owned storage devices on the LV network for peak reduction," *Energies*, vol. 7, no. 6, pp. 3537–3560, 2014.
- [125] K. H. Chua, Y. S. Lim, P. Taylor, S. Morris, and J. Wong, "Energy storage system for mitigating voltage unbalance on low-voltage networks with photovoltaic systems," *IEEE Trans. Power Deliv.*, vol. 27, no. 4, pp. 1783–1790, 2012.
- [126] K. Baker, G. Hug, and X. Li, "Energy Storage Sizing Taking Into Account Forecast Uncertainties and Receding Horizon Operation," *IEEE Trans. Sustain. Energy*, vol. 8, pp. 331–340, jan 2017.

- [127] Y. Wang, X. Lin, and M. Pedram, “Adaptive control for energy storage systems in households with photovoltaic modules,” *IEEE Trans. Smart Grid*, vol. 5, no. 2, pp. 992–1001, 2014.
- [128] S. Haben, J. Ward, D. Vukadinovic Greetham, C. Singleton, and P. Grindrod, “A new error measure for forecasts of household-level, high resolution electrical energy consumption,” *Int. J. Forecast.*, vol. 30, no. 2, pp. 246–256, 2014.
- [129] F. Blaabjerg, R. Teodorescu, M. Liserre, and A. V. Timbus, “Overview of Control and Grid Synchronization for Distributed Power Generation Systems,” *IEEE Trans. Ind. Electron.*, vol. 53, no. 5, pp. 1398–1409, 2006.
- [130] L. Malesani and P. Tenti, “A Novel Hysteresis Control Method for Current-Controlled Voltage-Source PWM Inverters with Constant Modulation Frequency,” *IEEE Trans. Ind. Appl.*, vol. 26, no. 1, pp. 88–92, 1990.
- [131] Z. Xu, J. Ostergaard, and M. Togeby, “Demand as frequency controlled reserve,” *IEEE Trans. Power Syst.*, vol. 26, no. 3, pp. 1062–1071, 2011.
- [132] M. C. Such and C. Hill, “Battery energy storage and wind energy integrated into the Smart Grid,” in *2012 IEEE PES Innov. Smart Grid Technol.*, pp. 1–4, 2012.
- [133] T. Gybel, L. F. S. Larsen, K. Edlund, and J. Bagterp, “Model predictive control technologies for efficient and flexible power consumption in refrigeration systems,” *Energy*, vol. 44, no. 1, pp. 105–116, 2012.
- [134] N. D. Hatziaargyriou, D. Škrlec, T. Capuder, P. S. Georgilakis, and M. Zidar, “Review of energy storage allocation in power distribution networks: applications, methods and future research,” *IET Gener. Transm. Distrib.*, pp. 1–8, 2015.

- [135] W. Li and Z. G. Zhang, “Based on time sequence of ARIMA model in the application of short-term electricity load forecasting,” *ICRCCS 2009 - 2009 Int. Conf. Res. Challenges Comput. Sci.*, pp. 11–14, 2009.
- [136] H. Nie, G. Liu, X. Liu, and Y. Wang, “Hybrid of ARIMA and SVMs for short-term load forecasting,” *Energy Procedia*, vol. 16, no. PART C, pp. 1455–1460, 2011.
- [137] T. Sannomiya, H. Hayashi, T. Ishii, and R. Ikeda, “Test results of compensation for load fluctuation under a fuzzy control by a 1 kWh/1 MW SMES,” *IEEE Trans. Appl. Supercond.*, vol. 11, no. 1, pp. 1908–1911, 2001.
- [138] S. X. Chen, H. B. Gooi, and M. Q. Wang, “Solar radiation forecast based on fuzzy logic and neural networks,” *Renew. Energy*, vol. 60, pp. 195–201, 2013.
- [139] H. Xia, H. Chen, Z. Yang, F. Lin, and B. Wang, “Optimal energy management, location and size for stationary energy storage system in a metro line based on genetic algorithm,” *Energies*, vol. 8, no. 10, pp. 11618–11640, 2015.
- [140] H. Liu, H. Tian, X. Liang, and Y. Li, “New wind speed forecasting approaches using fast ensemble empirical model decomposition, genetic algorithm, Mind Evolutionary Algorithm and Artificial Neural Networks,” *Renew. Energy*, vol. 83, pp. 1066–1075, 2015.
- [141] S. A. Kalogirou, E. Mathioulakis, and V. Belessiotis, “Artificial neural networks for the performance prediction of large solar systems,” *Renew. Energy*, vol. 63, pp. 90–97, 2014.
- [142] H. Quan, D. Srinivasan, and A. Khosravi, “Short-term load and wind power forecasting using neural network-based prediction intervals,” *IEEE Trans. Neural Networks Learn. Syst.*, vol. 25, no. 2, pp. 303–315, 2014.

- [143] D. Lee and R. Baldick, “Short-term wind power ensemble prediction based on gaussian processes and Neural networks,” *IEEE Trans. Smart Grid*, vol. 5, no. 1, pp. 501–510, 2014.
- [144] H. Pezeshki, P. Wolfs, S. Member, and G. L. S. Member, “A Model Predictive Approach for Community Battery Energy Storage System Optimization,” in *PES Gen. Meet. / Conf. Expo. 2014 IEEE*, pp. 27–31, 2014.
- [145] A. G. R. Vaz, B. Elsinga, W. G. J. H. M. van Sark, and M. C. Brito, “An artificial neural network to assess the impact of neighbouring photovoltaic systems in power forecasting in Utrecht, the Netherlands,” *Renew. Energy*, vol. 85, pp. 631–641, 2016.
- [146] L. Xiao, W. Shao, M. Yu, J. Ma, and C. Jin, “Research and application of a hybrid wavelet neural network model with the improved cuckoo search algorithm for electrical power system forecasting,” *Appl. Energy*, vol. 198, pp. 203–222, 2017.
- [147] M. Mansouri-Samani and M. Sloman, “Monitoring Distributed Systems,” *IEEE Netw.*, vol. 5, no. 6, pp. 20–30, 1993.
- [148] M. D. Nelson, “Load Management from a Power System Operator’s Perspective,” *IEEE Power Eng. Rev.*, vol. PER-5, no. 2, pp. 38–39, 1985.
- [149] K. Matsuzawa, M. Suzuki, Y. Okuhara, Y. Kishida, Y. Kudo, and T. Yamashita, “New energy management system for central dispatching center of Tokyo Electric Power Co., Inc,” *IEEE Trans. Power Syst.*, vol. 5, no. 4, pp. 1112–1117, 1990.
- [150] National Grid, “Managing the UK’s electricity system,” 2017.

- [151] P. N. Vovos, A. E. Kiprakis, A. R. Wallace, and G. P. Harrison, “Centralized and distributed voltage control: Impact on distributed generation penetration,” *IEEE Trans. Power Syst.*, vol. 22, no. 1, pp. 476–483, 2007.
- [152] J. M. Guerrero, L. Hang, and J. Uceda, “Control of Distributed Uninterruptible Power Supply Systems,” *IEEE Trans. Ind. Electron.*, vol. 55, no. 8, pp. 2845–2859, 2008.
- [153] A. Bidram, F. Lewis, and A. Davoudi, “Distributed Control Systems for Small-Scale Power Networks,” *IEEE Control Syst.*, vol. 34, no. December, pp. 56–77, 2014.
- [154] O. M. Toledo, D. Oliveira, A. Diniz, J. H. Martins, and M. H. M. Vale, “Methodology for Evaluation of Grid-Tie Connection of Distributed Energy Resources-Case Study With Photovoltaic and Energy Storage,” *IEEE Trans. Power Syst.*, vol. 28, no. 2, pp. 1132–1139, 2013.
- [155] F. Marra, G. Y. Yang, Y. T. Fawzy, C. Træholt, E. Larsen, R. Garcia-Valle, and M. M. Jensen, “Improvement of local voltage in feeders with photovoltaic using electric vehicles,” *IEEE Trans. Power Syst.*, vol. 28, no. 3, pp. 3515–3516, 2013.
- [156] S. Gill, I. Kockar, and G. W. Ault, “Dynamic optimal power flow for active distribution networks,” *IEEE Trans. Power Syst.*, vol. 29, no. 1, pp. 121–131, 2014.
- [157] M. J. Dolan, G. W. Ault, D. F. Frame, S. Gill, I. Kockar, O. Anaya-Lara, S. Galloway, B. O’Neill, C. Foote, and A. Svalovs, “Northern Isles New Energy Solutions: Active network management stability limits,” *Innov. Smart Grid Technol. (ISGT Eur. 2012 3rd IEEE PES Int. Conf. Exhib.*, pp. 1–9, 2012.

- [158] R. Atia and N. Yamada, "Sizing and Analysis of Renewable Energy and Battery Systems in Residential Microgrids," *IEEE Trans. Smart Grid*, vol. 7, no. 3, pp. 1204–1213, 2016.
- [159] A. Bidram and A. Davoudi, "Hierarchical Structure of Microgrids Control System," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1963–1976, 2012.
- [160] Z. Wang, B. Chen, J. Wang, and J. Kim, "Decentralized Energy Management System for Networked Microgrids in Grid-Connected and Islanded Modes," *IEEE Trans. Smart Grid*, vol. 7, no. 2, pp. 1097–1105, 2016.
- [161] J. M. Guerrero, M. Chandorkar, T.-L. Lee, and P. C. Loh, "Advanced Control Architectures for Intelligent Microgrids - Part I: Decentralized and Hierarchical Control," *IEEE Trans. Ind. Electron.*, vol. 60, pp. 1254–1262, apr 2013.
- [162] J. M. Guerrero, P. C. Loh, T.-L. Lee, and M. Chandorkar, "Advanced Control Architectures for Intelligent Microgrids - Part II: Power Quality, Energy Storage, and AC/DC Microgrids," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1263–1270, 2013.
- [163] S. Russell and P. Norvig, *Artificial Intelligence - A modern Approach (Third Edition)*. Prentice Hall, 2010.
- [164] M. Wooldridge and N. R. Jennings, "The Knowledge Engineering Review," in *Knowl. Eng. Rev.*, vol. 10, ch. Intelligen, pp. 115–152, Cambridge University Press, jul 1995.
- [165] A. Al-Hinai and A. Feliachi, "Application of intelligent control agents in power systems with distributed generators," in *Power Syst. Conf. Expo. 2004. IEEE PES*, pp. 1514–1519 vol.3, IEEE, 2004.

- [166] A. L. Dimeas and N. D. Hatziargyriou, "Operation of a multiagent system for microgrid control," *IEEE Trans. Power Syst.*, vol. 20, no. 3, pp. 1447–1455, 2005.
- [167] C. Dou, Z. Zhang, D. Yue, and Y. Zheng, "MAS-Based Hierarchical Distributed Coordinate Control Strategy of Virtual Power Source Voltage in Low-Voltage Microgrid," *IEEE Access*, vol. 5, pp. 11381–11390, 2017.
- [168] M. Vasirani, R. Kota, R. L. Cavalcante, S. Ossowski, and N. R. Jennings, "An Agent-Based Approach to Virtual Power Plants of Wind Power Generators and Electric Vehicles," *IEEE Trans. Smart Grid*, vol. 4, pp. 1314–1322, sep 2013.
- [169] J. J. Gómez-Sanz, S. Garcia-Rodriguez, N. Cuartero-Soler, and L. Hernandez-Callejo, "Reviewing Microgrids from a Multi-Agent Systems Perspective," *Energies*, vol. 7, pp. 3355–3382, may 2014.
- [170] J. K. Kok, C. J. Warmer, and I. G. Kamphuis, "PowerMatcher: Multiagent control in the electricity infrastructure," *Proc. fourth Int. Jt. Conf. Auton. agents multiagent Syst. - AAMAS '05*, vol. 48, no. 3, p. 75, 2005.
- [171] H. Li, H. Sun, J. Wen, S. Cheng, and H. He, "A fully decentralized multi-agent system for intelligent restoration of power distribution network incorporating distributed generations," *IEEE Comput. Intell. Mag.*, vol. 7, no. 4, pp. 66–76, 2012.
- [172] F. Ding and K. A. Loparo, "Feeder Reconfiguration for Unbalanced Distribution Systems With Distributed Generation: A Hierarchical Decentralized Approach," *IEEE Trans. Power Syst.*, vol. 31, no. 2, pp. 1633–1642, 2016.
- [173] M. a. López, S. Martín, J. a. Aguado, and S. De La Torre, "Optimal microgrid operation with electric vehicles," in *IEEE PES Innov. Smart Grid Technol. Conf. Eur.*, (Manchester), pp. 1–8, IEEE, 2011.

- [174] B. Ramachandran, S. K. Srivastava, and D. A. Cartes, “Intelligent power management in micro grids with EV penetration,” *Expert Syst. Appl.*, vol. 40, pp. 6631–6640, nov 2013.
- [175] I. Grau Unda, P. Papadopoulos, S. Skarvelis-Kazakos, L. M. Cipcigan, N. Jenkins, and E. Zabala, “Management of electric vehicle battery charging in distribution networks with multi-agent systems,” *Electr. Power Syst. Res.*, vol. 110, pp. 172–179, may 2014.
- [176] M. E. Baran and I. M. El-Markabi, “A Multiagent-Based Dispatching Scheme for Distributed Generators for Voltage Support on Distribution Feeders,” *IEEE Trans. Power Syst.*, vol. 22, no. 1, pp. 52–59, 2007.
- [177] V. M. Catterson, E. Davidson, and S. D. J. McArthur, “Issues in Integrating Existing Multi-Agent Systems for Power Engineering Applications,” in *Proc. 13th Int. Conf. on, Intell. Syst. Appl. to Power Syst.*, (Arlington, VA), pp. 396–401, Ieee, 2005.
- [178] S. D. J. McArthur, S. M. Strachan, and G. Jahn, “The design of a multi-agent transformer condition monitoring system,” *IEEE Trans. Power Syst.*, vol. 19, no. 4, pp. 1845–1852, 2004.
- [179] J. A. Hossack, J. Menal, S. D. J. McArthur, and J. R. McDonald, “A multiagent architecture for protection engineering diagnostic assistance,” *IEEE Trans. Power Syst.*, vol. 18, no. 2, pp. 639–647, 2003.
- [180] W. He, G. Chen, Q.-l. Han, W. Du, J. Cao, and F. Qian, “Multiagent Systems on Multilayer Networks : Synchronization Analysis and Network Design,” *IEEE Trans. Syst. Man, Cybern. Syst.*, vol. 47, no. 7, pp. 1655–1667, 2017.

- [181] A. R. Hota, M. Juvvanapudi, and P. Bajpai, “Issues and solution approaches in PHEV integration to smart grid,” *Renew. Sustain. Energy Rev.*, vol. 30, pp. 217–229, feb 2014.
- [182] L. Liu, F. Kong, X. Liu, Y. Peng, and Q. Wang, “A review on electric vehicles interacting with renewable energy in smart grid,” *Renew. Sustain. Energy Rev.*, vol. 51, pp. 648–661, 2015.
- [183] V. Shah and J. Booream-Phelps, “F.I.T.T. for Investors: Crossing the Chasm,” tech. rep., 2015.
- [184] A. H. Mohsenian-Rad, V. W. S. Wong, J. Jatskevich, R. Schober, and A. Leon-Garcia, “Autonomous demand-side management based on game-theoretic energy consumption scheduling for the future smart grid,” *IEEE Trans. Smart Grid*, vol. 1, no. 3, pp. 320–331, 2010.
- [185] S. Deilami and A. S. Masoum, “Real-time coordination of plug-in electric vehicle charging in smart grids to minimize power losses and improve voltage profile,” *IEEE Trans. Smart Grid*, vol. 2, no. 3, pp. 456–467, 2011.
- [186] W. Surles and G. P. Henze, “Evaluation of automatic priced based thermostat control for peak energy reduction under residential time-of-use utility tariffs,” *Energy Build.*, vol. 49, pp. 99–108, 2012.
- [187] A. S. Masoum, S. Deilami, and M. A. S. Masoum, “Fuzzy Approach for Online Coordination of Plug-In Electric Vehicle Charging in Smart Grid,” *IEEE Trans. Sustain. Energy*, vol. 6, no. 3, pp. 1112–1121, 2015.
- [188] J. Leadbetter and L. Swan, “Battery storage system for residential electricity peak demand shaving,” *Energy Build.*, vol. 55, pp. 685–692, 2012.

- [189] H. Thieblemont, F. Haghighat, R. Ooka, and A. Moreau, “Predictive Control Strategies based on Weather Forecast in Buildings with Energy Storage System: A Review of the State-of-the Art,” *Energy Build.*, vol. Available, 2017.
- [190] Z. Jiang, L. Gao, and R. A. Dougal, “Adaptive Control Strategy for Active Power Sharing in Hybrid Fuel Cell/Battery Power Sources,” *IEEE Trans. Energy Convers.*, vol. 22, no. 2, pp. 507–515, 2007.
- [191] D.-M. Chiu and R. Rain, “Analysis of the increase and decrease algorithms for congestion avoidance in computer networks,” in *Comput. Networks ISDN Syst.*, pp. 1–14, Elsevier, 1989.
- [192] F. Wirth, S. Stuedli, J. Y. Yu, M. Corless, and R. Shorten, “IBM Research Report: Nonhomogeneous Place-Dependent Markov Chains, Unsynchronised AIMD, and Network Utility Maximization,” tech. rep., IBM, 2014.
- [193] S. Stüdli, E. Crisostomi, R. Middleton, and R. Shorten, “A flexible distributed framework for realising electric and plug-in hybrid vehicle charging policies,” *Int. J. Control*, vol. 85, no. 8, pp. 1130–1145, 2012.
- [194] S. Studli, W. Griggs, E. Crisostomi, and R. Shorten, “On Optimality Criteria for Reverse Charging of Electric Vehicles,” *IEEE Trans. Intell. Transp. Syst.*, vol. 15, no. 1, pp. 451–456, 2014.
- [195] S. Stüdli, E. Crisostomi, R. Middleton, and R. Shorten, “Optimal real-time distributed V2G and G2V management of electric vehicles,” *Int. J. Control*, vol. 87, no. 6, pp. 1153–1162, 2014.
- [196] S. Stüdli, E. Crisostomi, R. Middleton, J. Braslavsky, and R. Shorten, “Distributed Load Management Using Additive Increase Multiplicative Decrease Based Techniques,” in *Plug Electr. Veh. Smart Grids*, pp. 173–202, Springer Singapore, 2015.

- [197] T. Yunusov, W. Holderbaum, and B. Potter, “Cost function for sub-agent elements in multi-agent energy management system,” in *2011 2nd IEEE PES Int. Conf. Exhib. Innov. Smart Grid Technol.*, pp. 1–8, 2011.
- [198] American National Standards Institute Inc., “ANSI/NEMA MG 1-2011,” tech. rep., American National Standards Institute Inc., 2011.
- [199] H. A. Mostafa, R. E. Shatshat, and M. M. A. Salama, “A Correlated Equilibrium Game-Theoretic Approach for Multiple Participants Electric Distribution Systems Operation,” *IEEE Trans. Smart Grid*, vol. 7, no. 1, pp. 32–42, 2016.
- [200] “Foundation for Intelligent Physical Agents (FIPA) Standard Status Specification.”
- [201] Commission for Energy Regulation (CER), “Irish Social Science Data Archive. CER Smart Metering Project,” 2002.
- [202] M. Luck, R. Ashri, and M. D’Inverno, *Agent-Based Software Development*. Norwood, MA, USA: Artech House, Inc., 2004.
- [203] Telecom Italia, “Java Agent Development Framework,” 2015.
- [204] Foundation For Intelligent Physical Agents, “FIPA Agent Management Specification,” tech. rep., Foundation For Intelligent Physical Agents, 2002.
- [205] F. Y. S. Eddy and H. B. Gooi, “Multi-agent system for optimization of microgrids,” in *8th Int. Conf. Power Electron. - ECCE Asia*, (Jeju), pp. 2374–2381, Ieee, may 2011.
- [206] M.-T. Kuo and S.-D. Lu, “Design and Implementation of Real-Time Intelligent Control and Structure Based on Multi-Agent Systems in Microgrids,” *Energies*, vol. 6, pp. 6045–6059, nov 2013.

- [207] S. Mocci, N. Natale, S. Ruggeri, and F. Pilo, “Multi-agent control system for increasing hosting capacity in active distribution networks with EV,” in *2014 IEEE Int. Energy Conf.*, (Cavtat), pp. 1409–1416, Ieee, may 2014.
- [208] W. Li, T. Logenthiran, V. T. Phan, and W. L. Woo, “Intelligent Multi-Agent System for Power Grid Communication,” *IEEE Reg. 10 Annu. Int. Conf. Proceedings/TENCON*, pp. 3386–3389, 2017.
- [209] P. H. Nguyen, W. L. Kling, I. G. Kamphuis, and P. Ribeiro, “Integration of agent-based functions to facilitate operation of Smart Distribution Networks,” in *2011 2nd IEEE PES Int. Conf. Exhib. Innov. Smart Grid Technol.*, (Manchester), pp. 1–5, Ieee, dec 2011.
- [210] T. Nagata and S. Fukunaga, “An autonomous distributed agent approach to power system restoration,” *16th Int. Conf. Intell. Syst. Appl. to Power Syst.*, pp. 1–5, sep 2011.
- [211] T. Nagata, Y. Ueda, and M. Utatani, “A multi-agent approach to smart grid energy management,” in *2012 10th Int. Power Energy Conf.*, (Ho Chi Minh City), pp. 327–331, Ieee, nov 2012.
- [212] I. Mareels, T. Alpcan, M. Brazil, J. de Hoog, and D. a. Thomas, “A distributed electric vehicle charging management algorithm using only local measurements,” in *Innov. Smart Grid Technol. Conf. (ISGT), 2014 IEEE PES*, (Washington, DC), pp. 1–5, 2014.
- [213] L. Xia, J. D. Hoog, T. Alpcan, and M. Brazil, “Electric Vehicle Charging : A Noncooperative Game Using Local Measurements,” in *Int. Fed. Autom. Control*, (Cape Town), pp. 5426–5431, 2014.
- [214] J. Munkhammar, J. D. Bishop, J. J. Sarraide, W. Tian, and R. Choudhary, “Household electricity use, electric vehicle home-charging and distributed pho-

- tovoltaic power production in the city of Westminster,” *Energy Build.*, vol. 86, pp. 439–448, 2015.
- [215] D. Dallinger and M. Wietschel, “Grid integration of intermittent renewable energy sources using price-responsive plug-in electric vehicles,” *Renew. Sustain. Energy Rev.*, vol. 16, pp. 3370–3382, jun 2012.
- [216] Infas and Deutsches Zentrum für Luft- und Raumfahrt e.V, “Mobilität in Deutschland 2008,” tech. rep., Bonn und Berlin, Deutschland, 2008.
- [217] National Grid, “Future Energy Scenarios 2015,” Tech. Rep. July, 2015.
- [218] I. Laresgoiti, S. Käbitz, M. Ecker, and D. U. Sauer, “Modeling mechanical degradation in lithium ion batteries during cycling: Solid electrolyte interphase fracture,” *J. Power Sources*, vol. 300, pp. 112–122, 2015.
- [219] UK Government Digital Service, “Vehicle free-flow speeds (SPE01),” 2013.
- [220] B. P. Release, “The new BMW i3 - born to be electric,” 2013.
- [221] UK Office for Low Emission Vehicles, “Electric Vehicle Homecharging Scheme - Guidance for manufacturers and installers,” tech. rep., 2016.
- [222] I. P. Society and Energy, “European Low Voltage Test Feeder,” 2015.
- [223] I. T. Papaioannou, A. Purvins, and C. S. Demoulias, “Reactive power consumption in photovoltaic inverters: a novel configuration for voltage regulation in low-voltage radial feeders with no need for central control,” *Prog. Photovoltaics Res. Appl.*, vol. 23, no. 5, pp. 611–619, 2015.
- [224] Tesla Motors Inc., “Tesla Powerwall,” 2015.


Appendix A

Additional Results


A.1 Improving operation performance of battery schedules at sub-half-hourly resolution

A.1.1 Additional Time Series Analysis

Since the plots in Section 3.5.1 are averages over a 10 minute moving average window (in order to aid visual representation of the volatile data), the raw and unfiltered data is included for reference in this appended section.

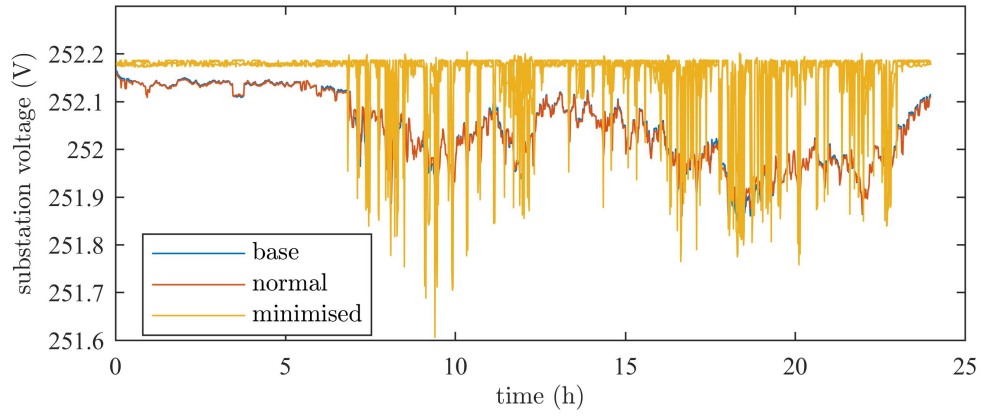


(a) Voltage levels as measured at the substation

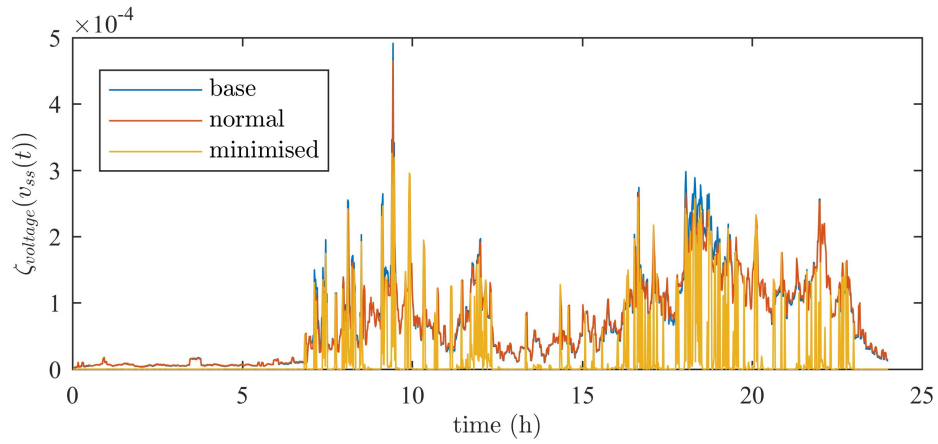


(b) Cost associated with the voltage levels as measured at the substation

Figure A.1: Additional substation voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.

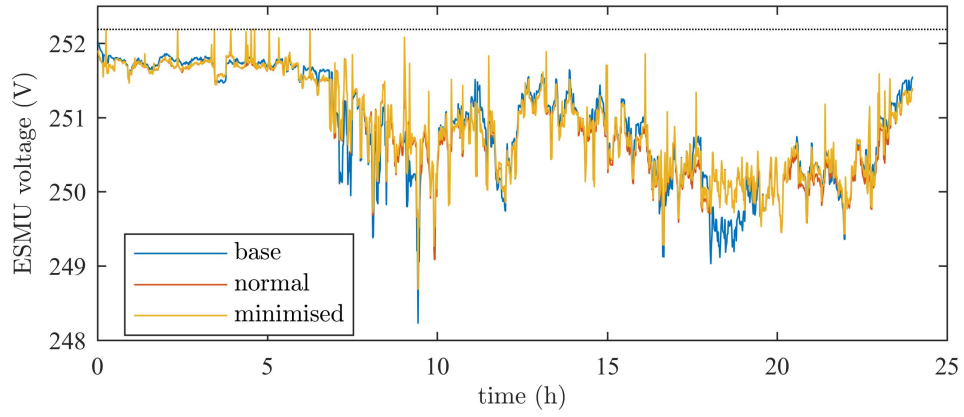


(a) ESMU voltage levels

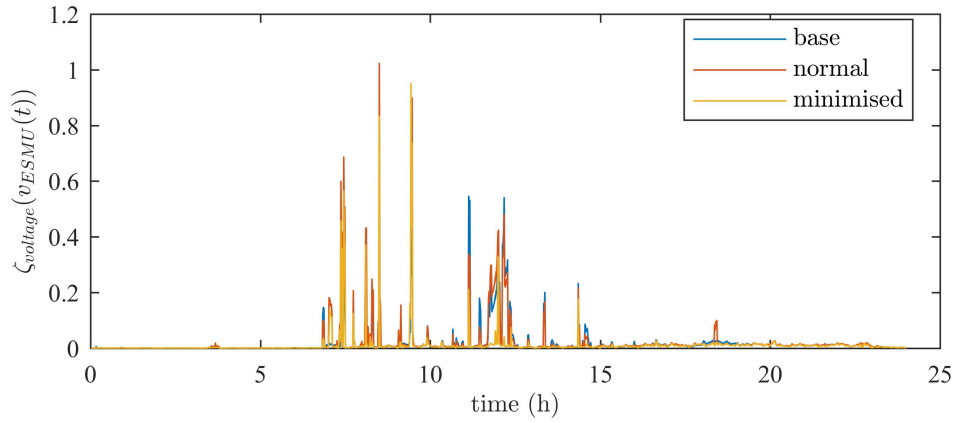


(b) Cost associated with the ESMU voltage levels

Figure A.2: Additional ESMU voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.

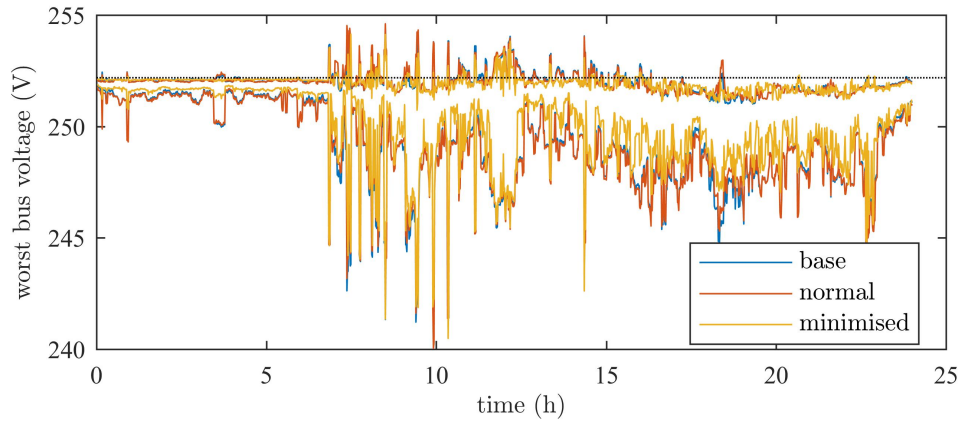


(a) Highest and lowest voltage levels in entire network

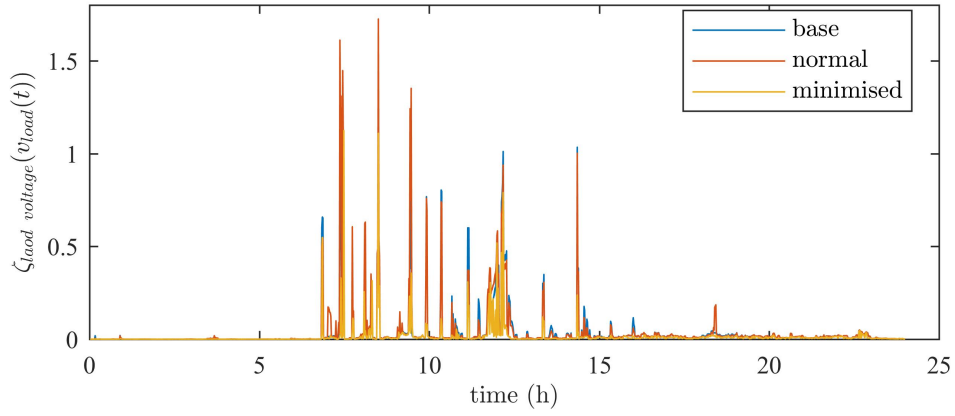


(b) Cost associated with highest and lowest voltage levels in entire network

Figure A.3: Additional voltage level comparison between base, normal and the case where the ESMU's schedule was adjusted.

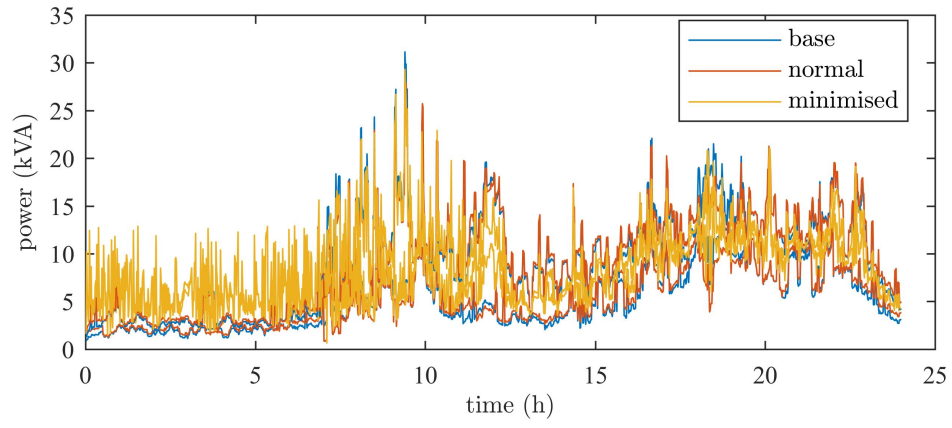


(a) Highest and lowest phase power

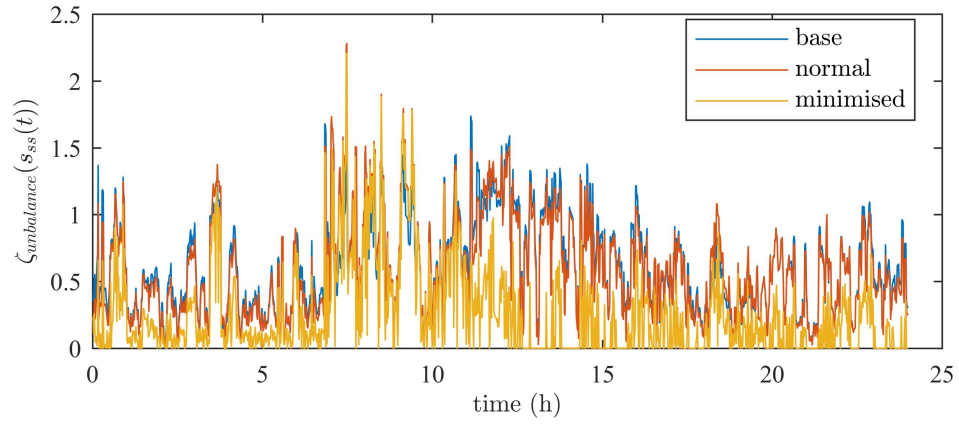


(b) Phase unbalance cost

Figure A.4: Additional phase unbalance cost comparison between base, normal and the case where the ESMU's schedule was adjusted.

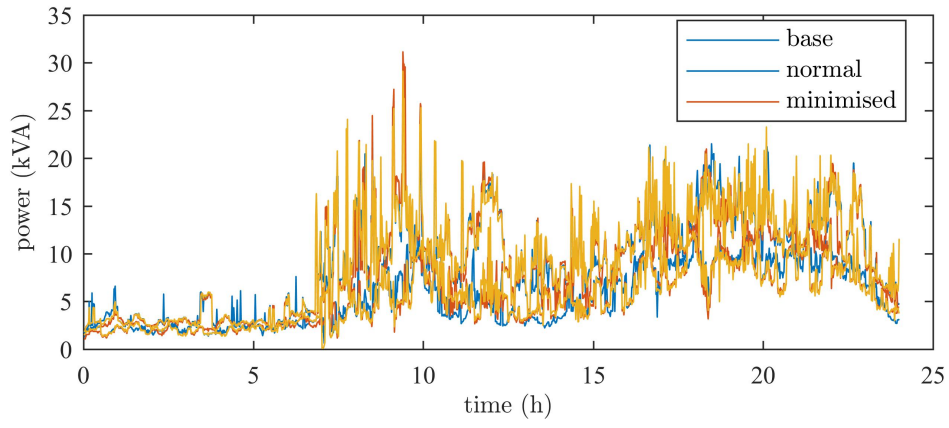


(a) Network load

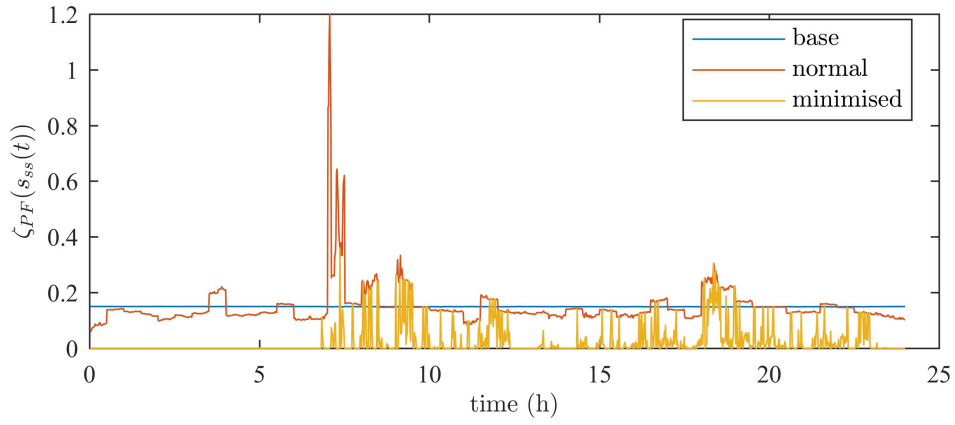


(b) Power factor

Figure A.5: Additional power factor cost comparison between base, normal and the case where the ESMU's schedule was adjusted.

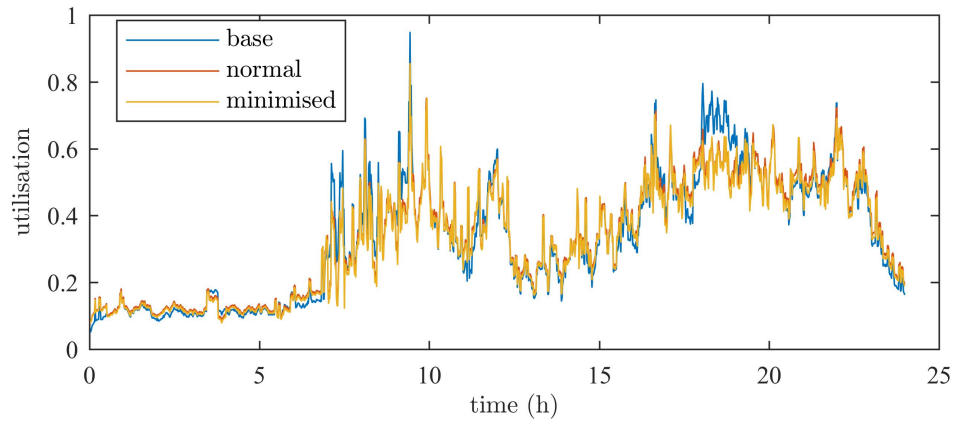


(a) Utilisation of the substation fuse

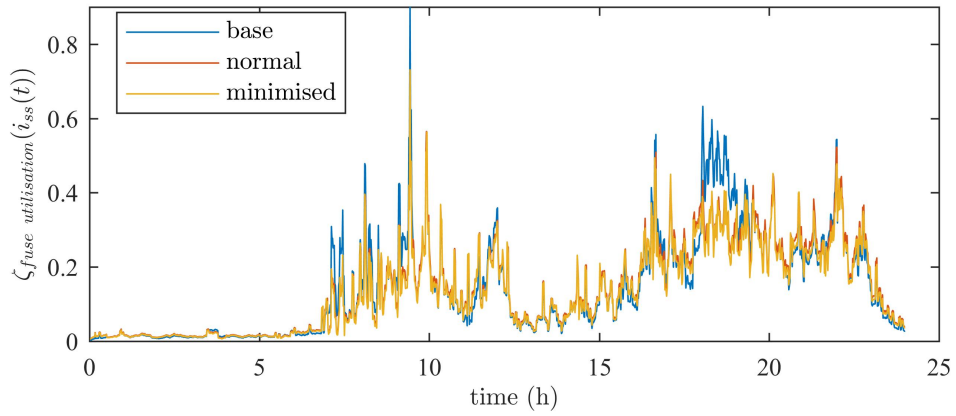


(b) Cost associated with the utilisation of the substation fuse

Figure A.6: Additional comparison of the substation fuse utilisation between base, normal and the case where the ESMU's schedule was adjusted.

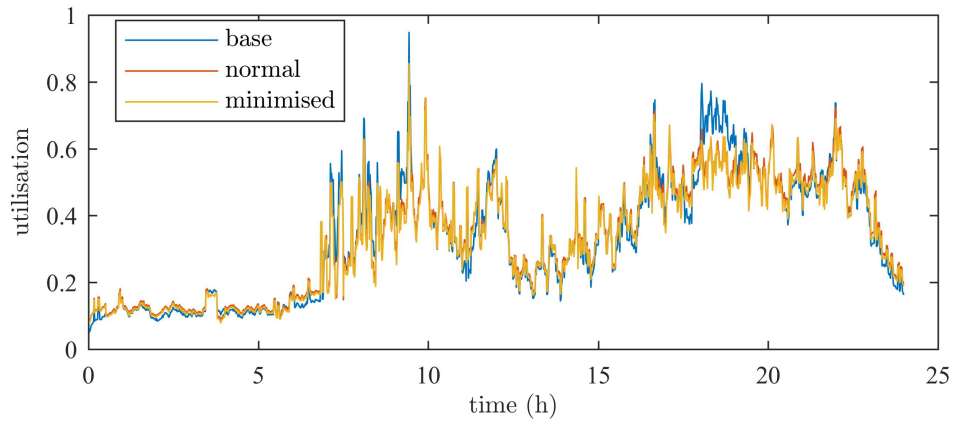


(a) The highest line utilisation of any line in the entire network

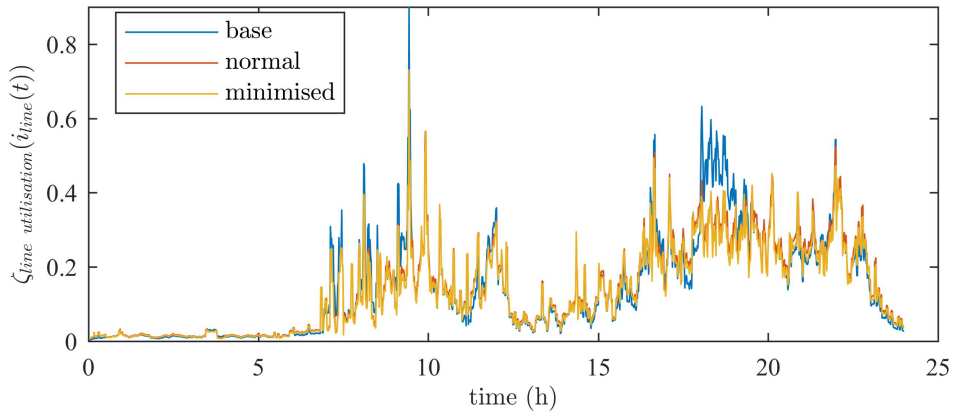


(b) The highest cost associated to the highest line utilisation of any line in the entire network

Figure A.7: Additional line utilisation comparison between base, normal and the case where the ESMU's schedule was adjusted.

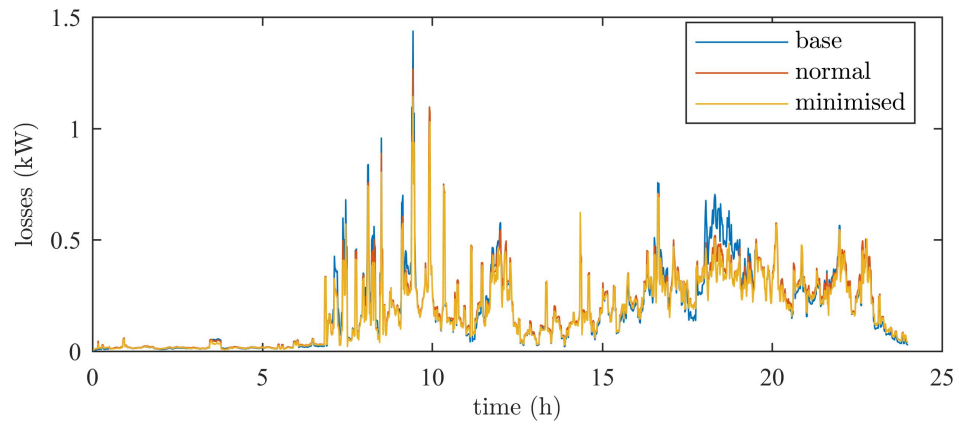

(a) Distribution losses

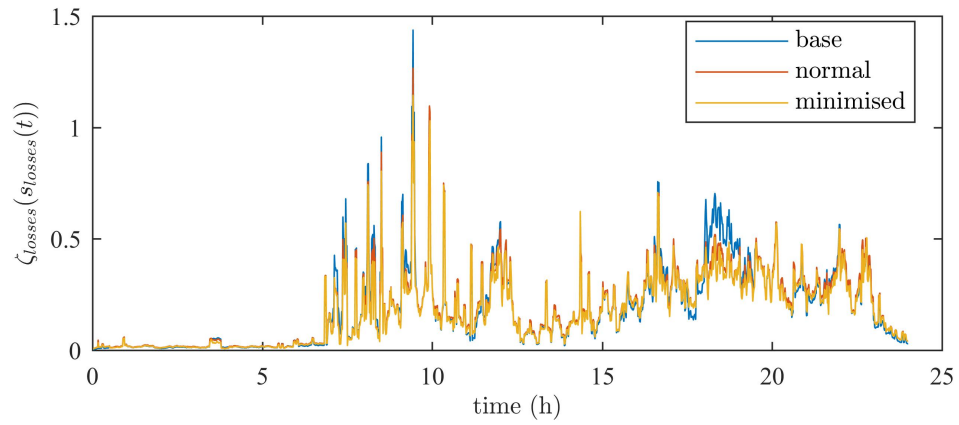

(b) Cost associated to distribution losses

Figure A.8: Additional comparison of distribution loss cost between base, normal and the case where the ESMU's schedule was adjusted.

A.1.2 Additional Difference Analysis

Only the cost differences for the case of actual cost minimisation were compared in Section 3.5.2. Therefore, all remaining cost differences have been included in this appended section.

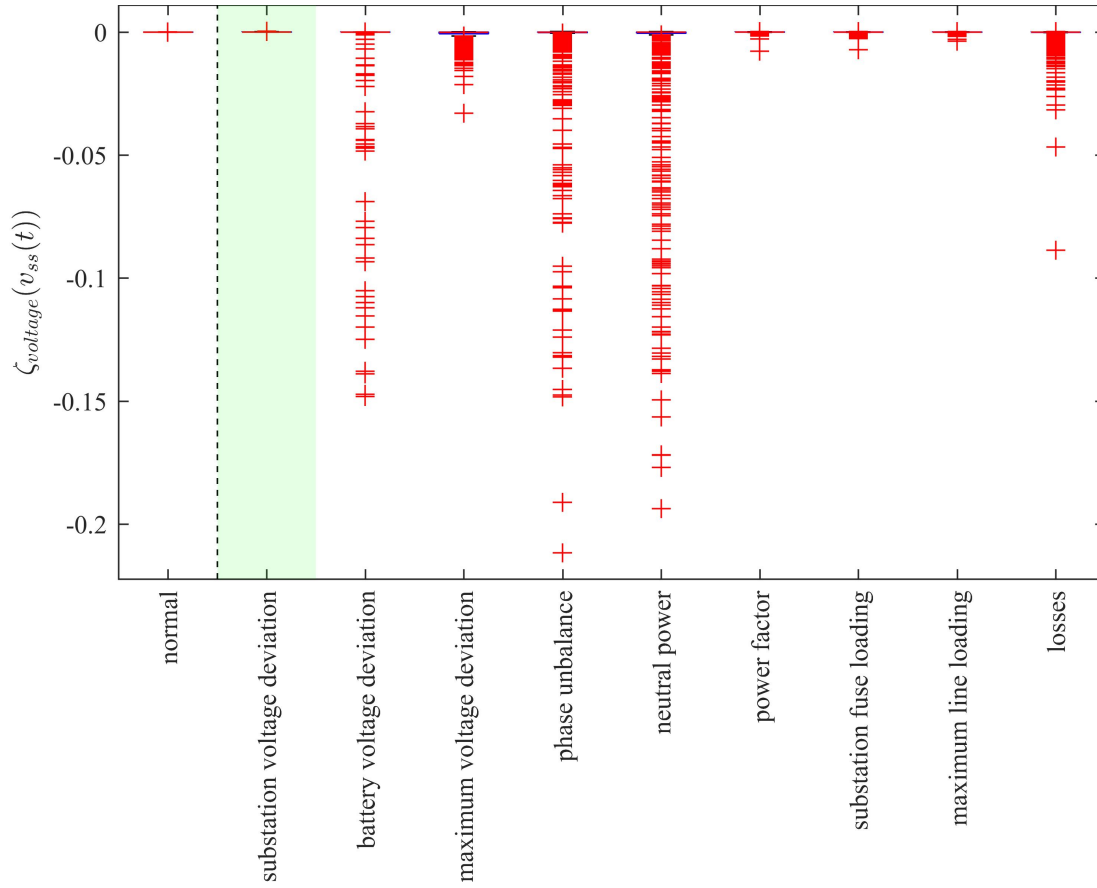


Figure A.9: Cost difference spread, based on the ESMU schedule adjustment to minimise substation voltage deviation

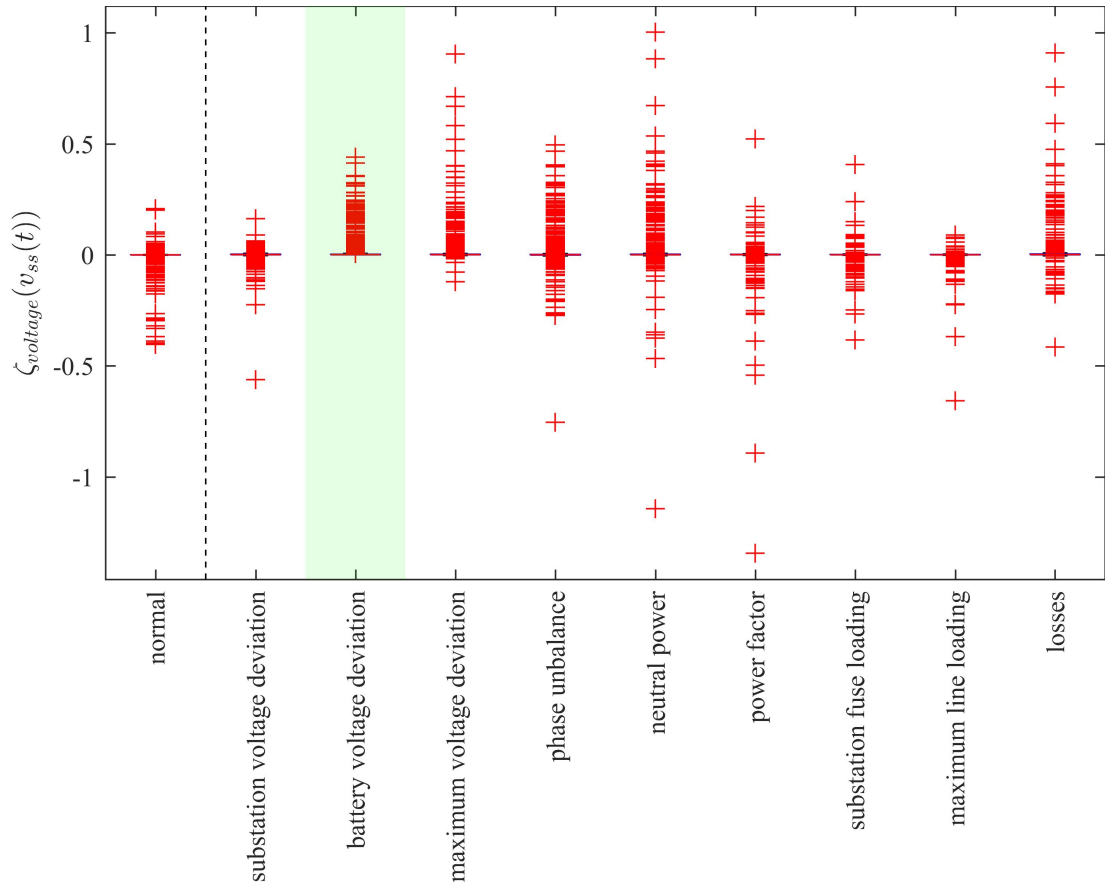


Figure A.10: Cost difference spread, based on the ESMU schedule adjustment to minimise ESMU's PCC voltage deviation

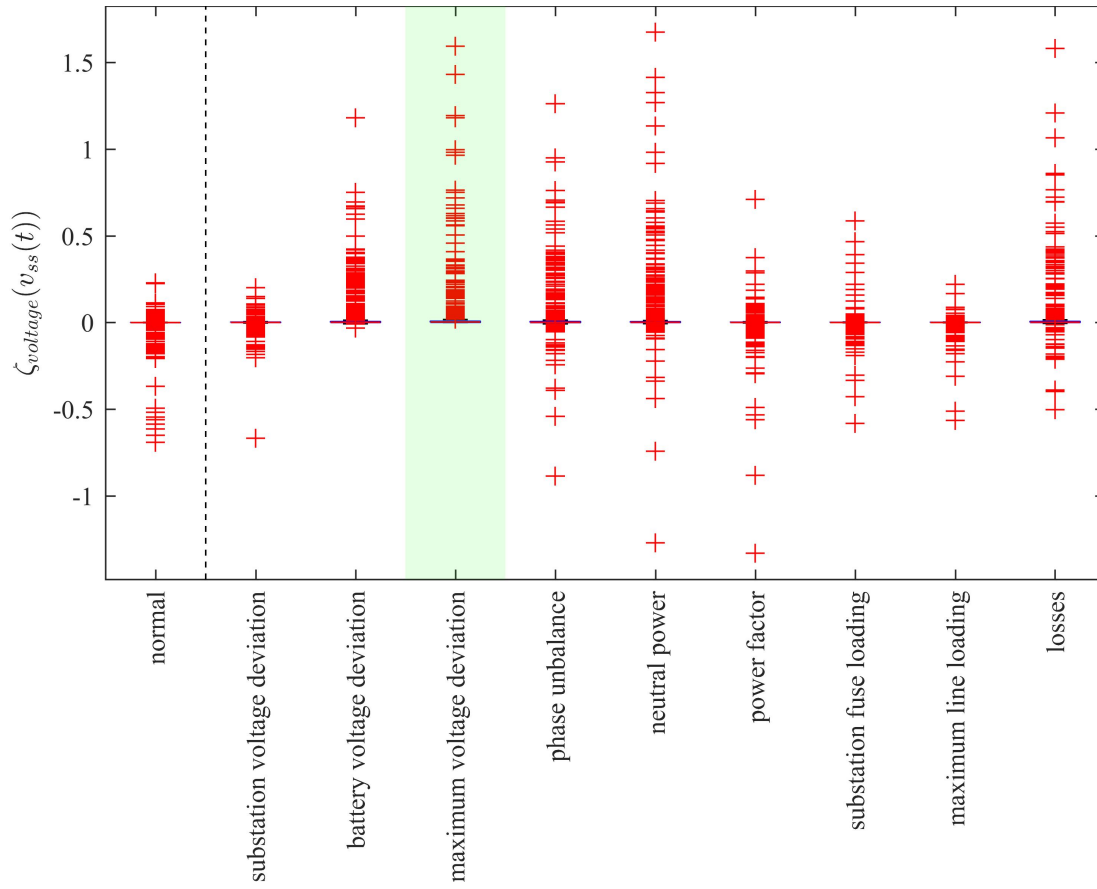


Figure A.11: Cost difference spread, based on the ESMU schedule adjustment to minimise the maximum voltage deviation on any bus of the network

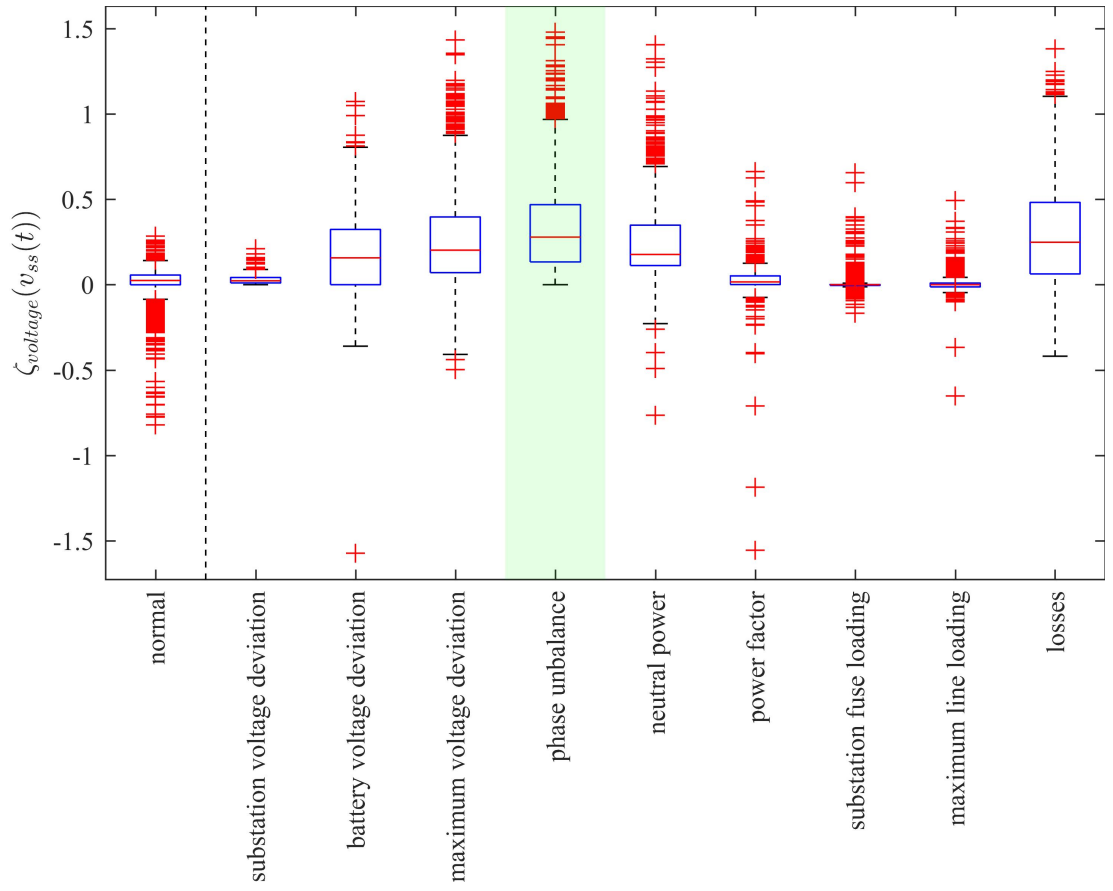


Figure A.12: Cost difference spread, based on the ESMU schedule adjustment to minimise the network's phase unbalance

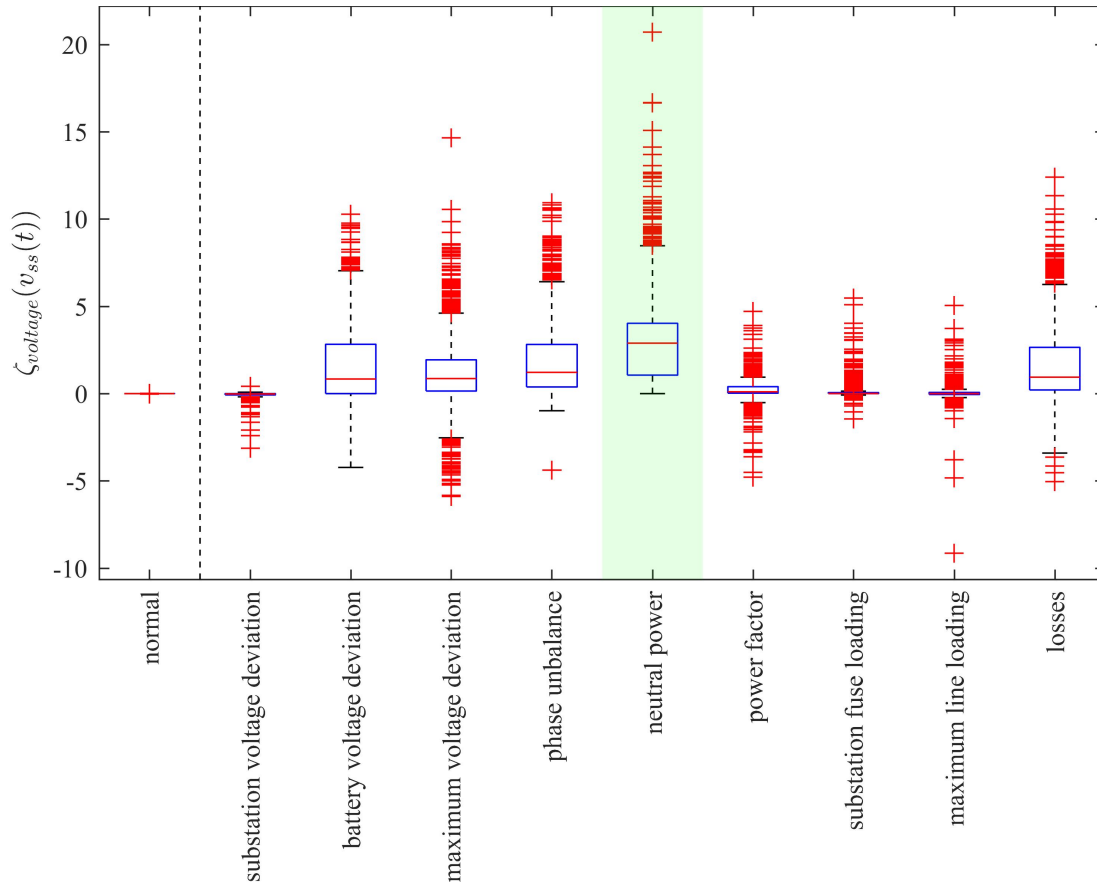


Figure A.13: Cost difference spread, based on the ESMU schedule adjustment to minimise the network's power flow in the neutral conductor

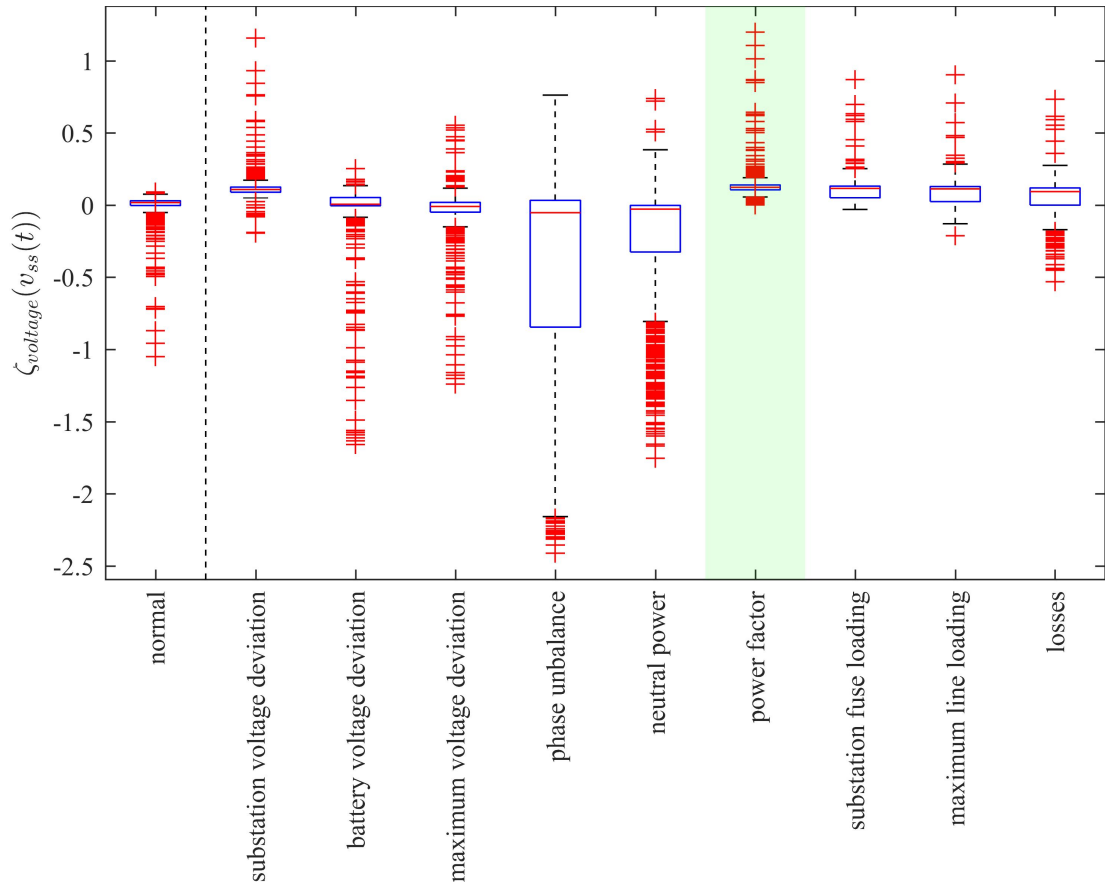


Figure A.14: Cost difference spread, based on the ESMU schedule adjustment to minimise the network's offset to unity power factor

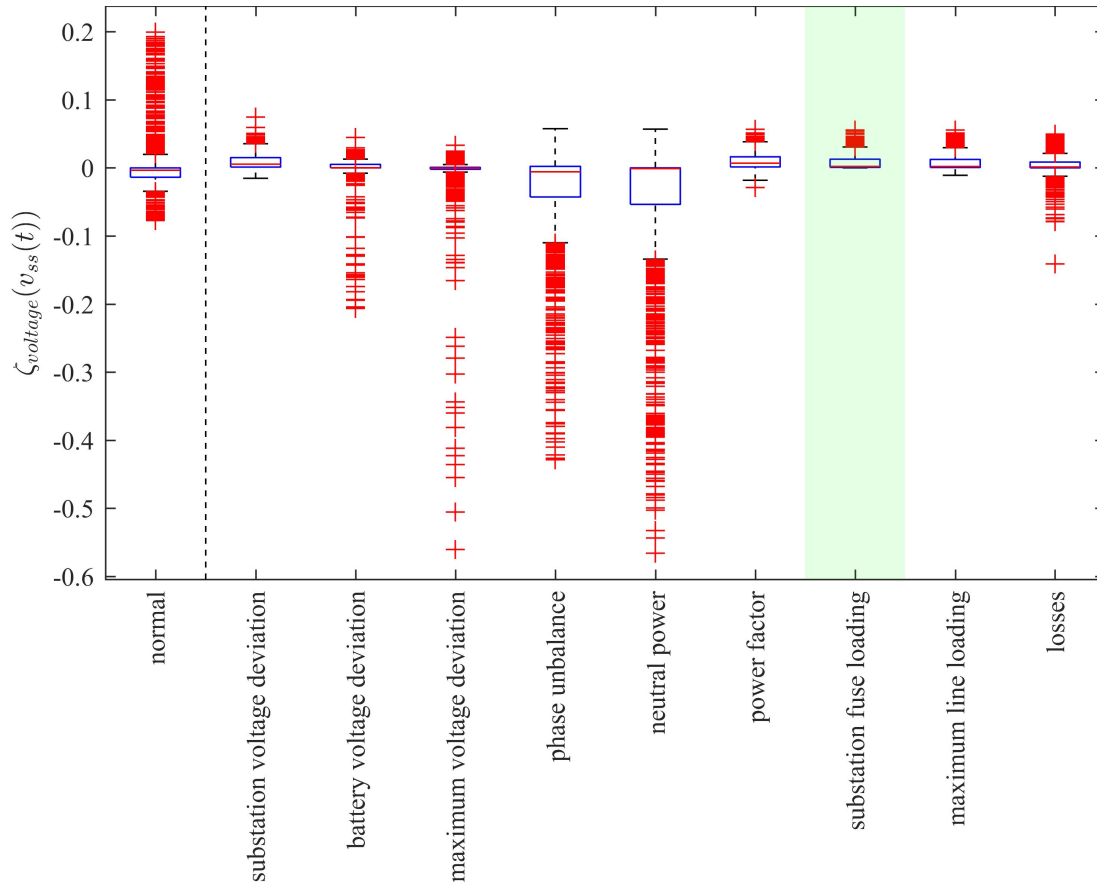


Figure A.15: Cost difference spread, based on the ESMU schedule adjustment to minimise the substation's fuse utilisation

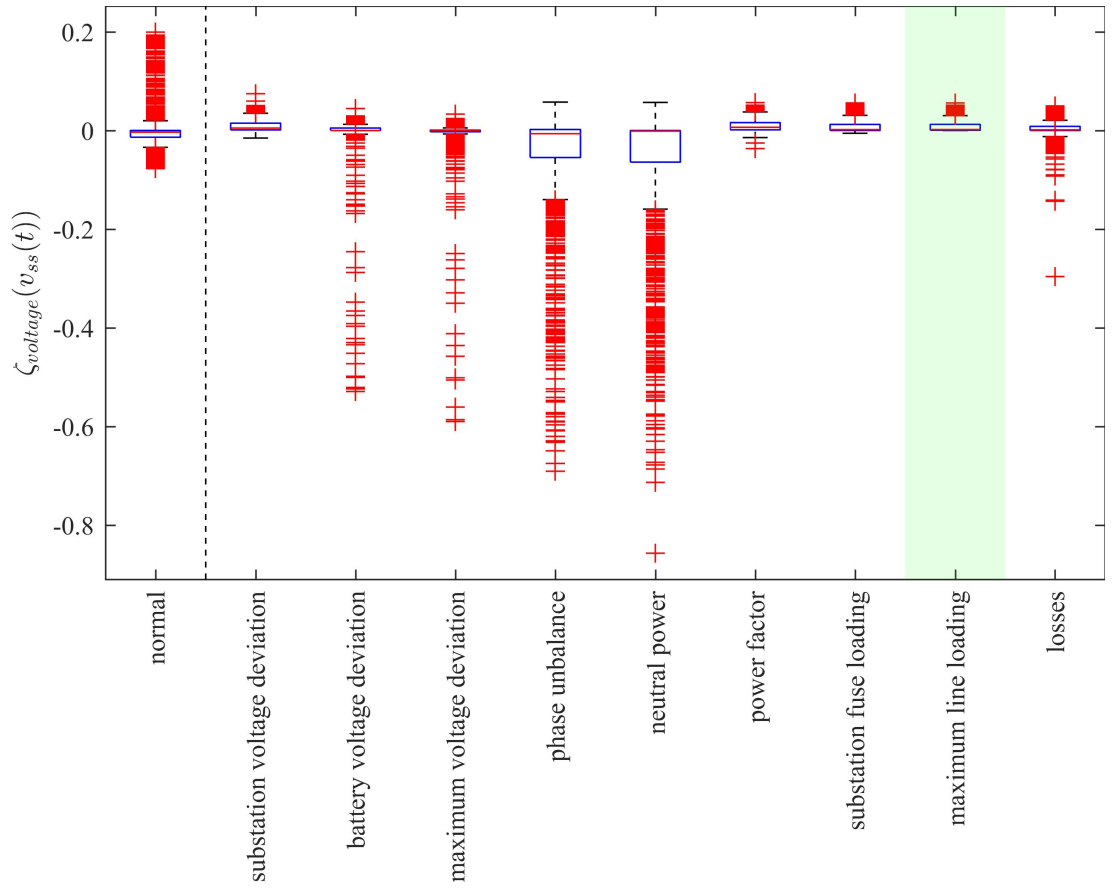


Figure A.16: Cost difference spread, based on the ESMU schedule adjustment to minimise the maximum line utilisation of any line in the network

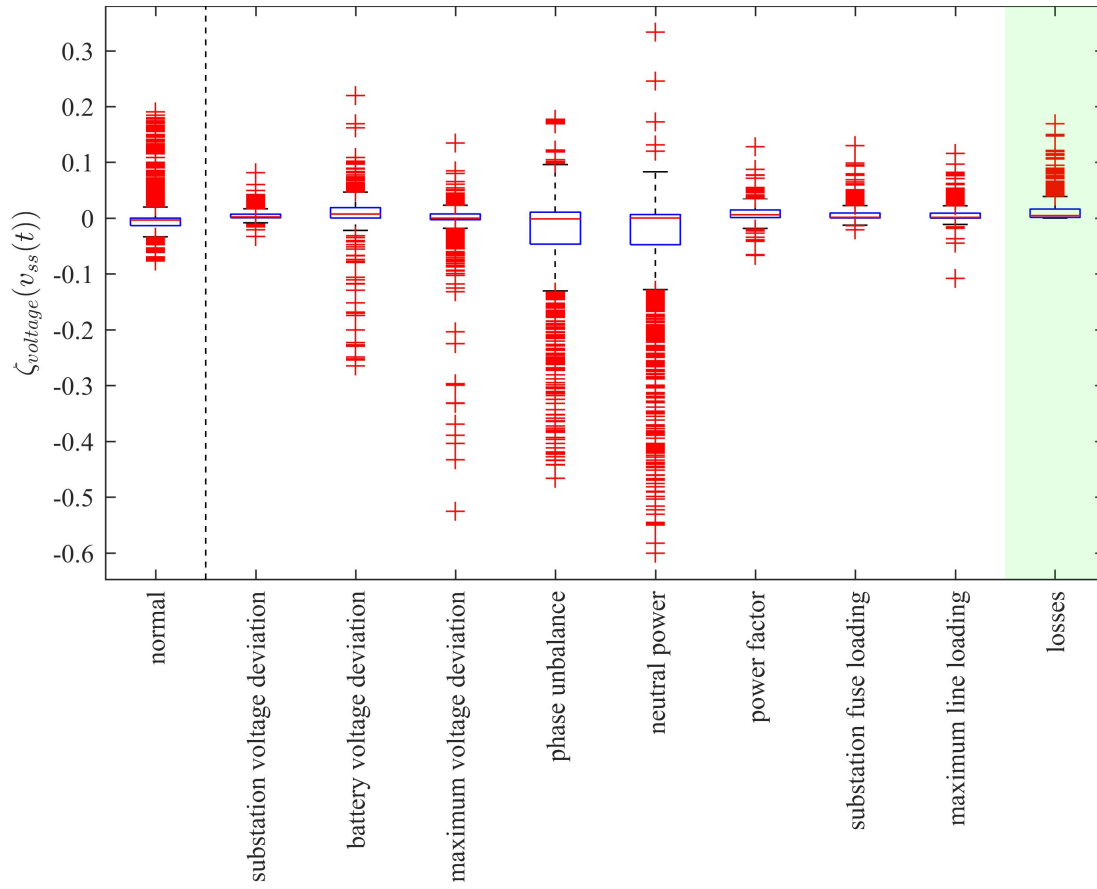


Figure A.17: Cost difference spread, based on the ESMU schedule adjustment to minimise distribution losses

A.1.3 Probability Density Analysis

The details described in this section address the prerequisites for the performed null hypothesis test in Section 3.5.3. These steps lie beyond the content of the corresponding chapter, yet have been included for completeness. Here, each step to condition the raw data for the t -test is explained in detail.

The original data is a highly volatile and non-stationary time-series that has a non-gaussian probability distribution. However, in order to apply the t -test, these criteria have to be met. Data conditioning steps were followed for each dataset that would modify the properties of the time-series without modifying their context. These steps are listed below and go as follows: First

1. the time-series is rescaled using the $\log()$ function, then
2. the rescaled values is averaged over N samples, then
3. the averages are split into two distinct sections (one prior to 11am and one after 11am), then
4. the sections are compared against each other (i.e. by computing the difference), then
5. the comparison's auto-correlation is computed to check for the presence of self-dependence.
 - (a) If the self-dependence is low enough (i.e. within confidence interval) the t -test is executed
 - (b) otherwise the data is feathered and the auto-correlation is tested again, and
 - (c) if the results still indicate a self-dependence, then a different N is chosen and the steps are repeated.

To visualise this procedure, the dataset corresponding to the minimisation of distribution losses, i.e. $\zeta_{\text{losses}}()$, is presented and the data modifications are explained. Since the steps apply to all data sets, only one is being presented in this appendix.

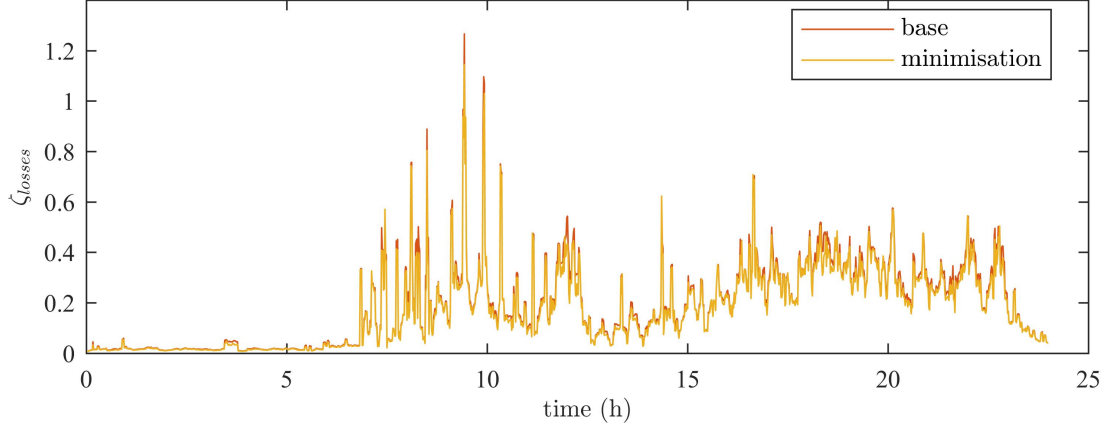


Figure A.18: Raw time-series that are supposed to be compared.

Figure A.18 shows the raw data of the two time-series that are going to be compared in the t -test. Since this data is very spiky and has many values located closely to zero, they are scaled using the $\log()$ function.

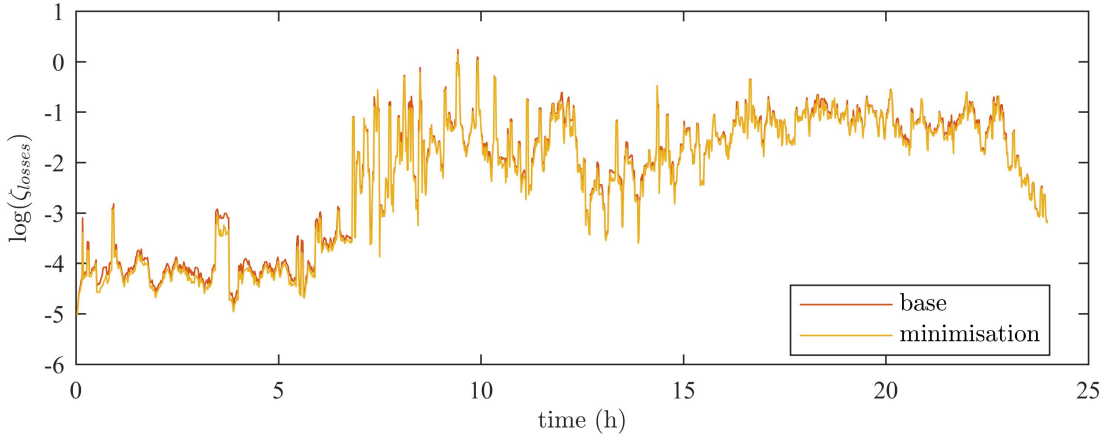


Figure A.19: Rescaled time-series that are supposed to be compared.

Figure A.19 shows this rescaled cost. It can be observed how differences, like the increase in load during the morning hours, has become more apparent. Nonetheless, this data is still volatile and is averaged over N values.

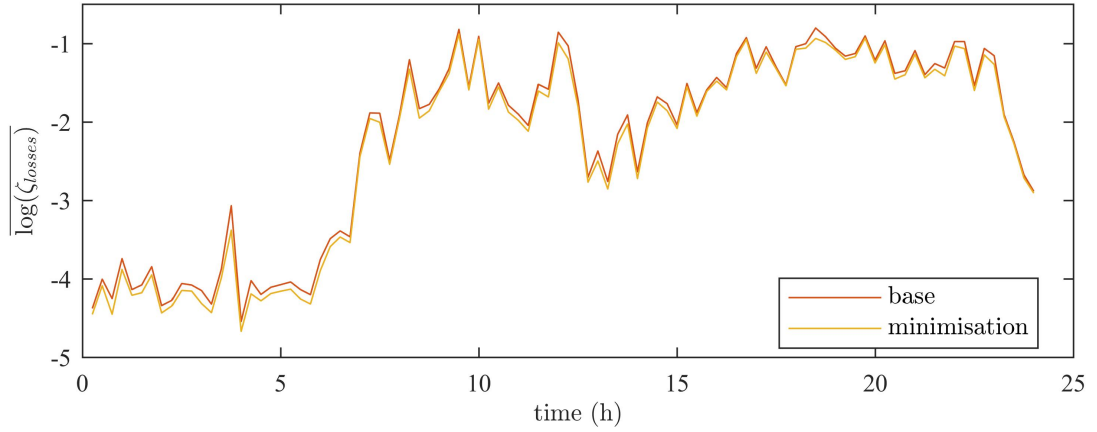


Figure A.20: Averaged log-scaled time-series.

The two different levels in the data can clearly be observed in Figure A.20. This distinction in levels allows an easy separation of the data into two sections: *morning* and *afternoon*.

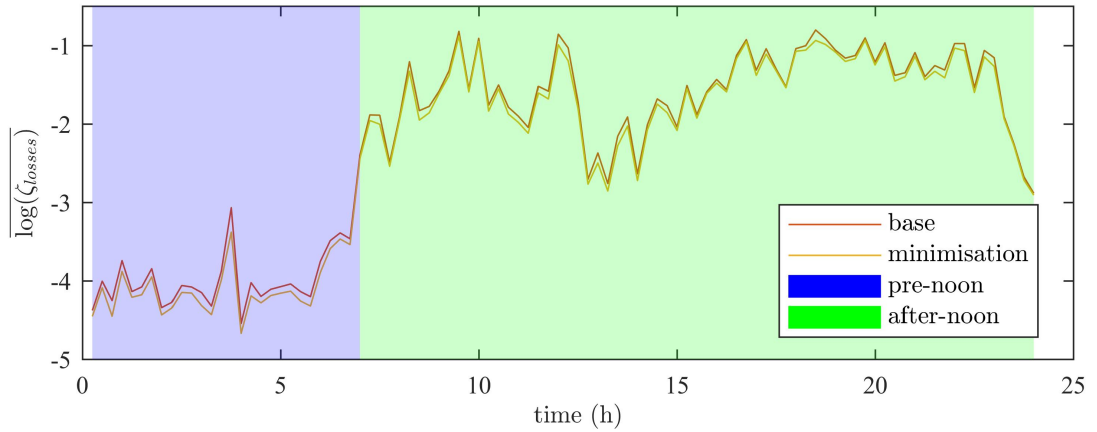


Figure A.21: Splitting of the conditioned data into two stationary sections

The preconditioned data in the two sections, that are highlighted in Figure A.21, are now compared by computing their difference. Figure A.22 shows this difference.

This difference is now auto-correlated and to indicate if any “self-dependence” (i.e. indicating auto-regression) is still present in the data. Results from both sections are shown in Figure A.23

Using the statistics package *MINITAB*, the significance bounds are determined. If any auto-correlation value lies outside this bound, then the data still contains

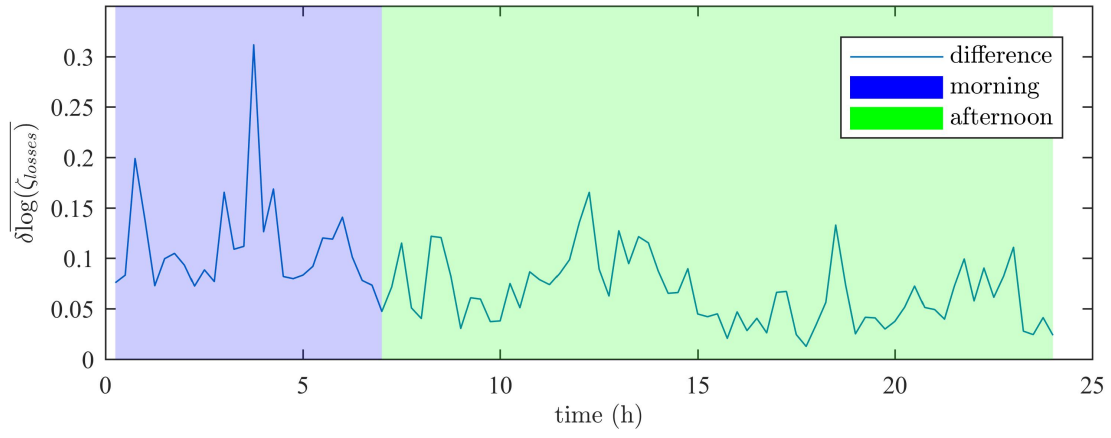


Figure A.22: Difference of the two pre-conditioned time-series.

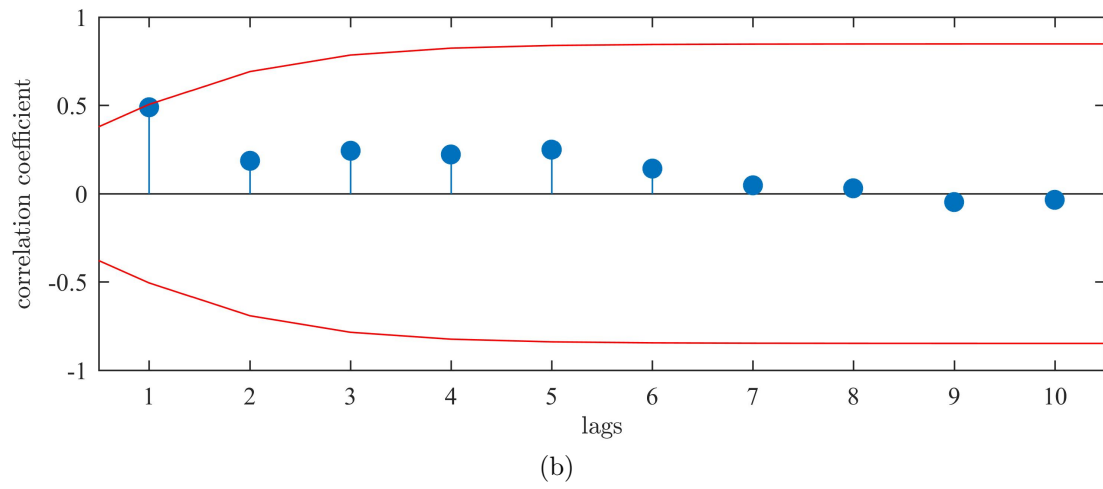
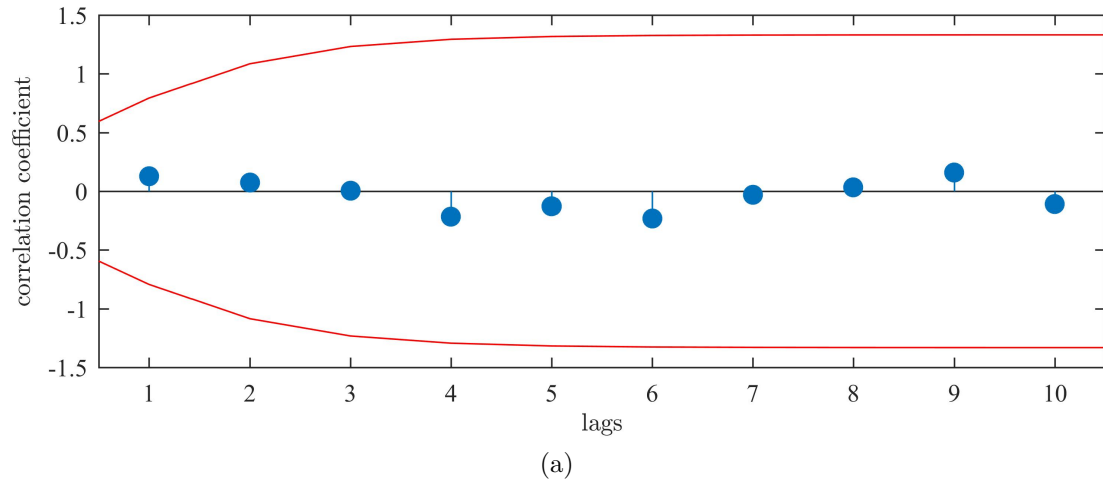


Figure A.23: Auto-correlation of signal for (A.23a) morning and (A.23b) afternoon sections

significant self-dependence and must be re-conditioned. In the case presented in Figure A.23 however, the auto-correlation indices lie within the bounds for all lags. Therefore, the criteria for the t -test are met and the data can be assessed. In this case, the t -test resulted in $p < 0.001$, which is the same value that is used in the “Probability Density Analysis” Section 3.5.

Appendix B

Multi-Agent Systems

This appendix, Appendix B, presents additional details on the MAS implementation. More specifically, the method used to implement FIPA are presented, and the main communication protocols that were used within this method are detailed.

B.1 FIPA Implementation

The Foundation for Intelligent Physical Agents (FIPA) has established a standard set of protocols that allow agents to interact with each other. These protocols form the so called Agent Communication Language (ACL). Telecom Italia has successively begun to develop a JAVA Agent Development Framework (JADE) that puts the entire ACL at the programmer's disposal. Published under LGPL (i.e. the Lesser General Public License Version 2), JADE is a free software package that can easily be used to construct large MASs.

In order to perform optimisation functions however, a way to interact with OpenDSS was required. On Microsoft Windows, the ActiveX COM server provided a simple access point to MATLAB and OpenDSS specific functions, and the JAVA COM Bridge (JACOB) made this server accessible to the JAVA run-time environment.

JADE and JACOB were, respectively, obtained from the following two sources:

- JADE: <http://jade.tilab.com>
- JACOB: <https://sourceforge.net/projects/jacob-project/>

By including the *jade.jar* and *jacob.jar*, and the corresponding Dynamic Linked Libraries (DLLs) *jacob-1.8-M2-x86.dll* and *jacob-1.8-M2-x64.dll*, FIPA was fully implemented and linked to MATLAB and OpenDSS.

B.2 Communication Protocols

The main three protocols that were used within Chapter 5 are:

1. FIPA Query Protocol (FIPA-standard-SC00027H)
2. FIPA Brokering Protocol (FIPA-standard-SC00033H)
3. FIPA ContractNet Protocol (FIPA-standard-SC00029H)

The flowcharts for these three protocols were taken from the corresponding standards and, for completeness, are explained in the following three subsections.

B.2.1 FIPA Query Protocol

Figure B.1 shows the complete flow chart of the FIPA Query protocol. This protocol is initiated by an “*initiator*” that send a “*query*” message (either “if” or “reference” message) to a “*Participant*”. In Chapter 5, the initiators were the brokering agents of the loads and the participant were the brokering agents of the energy supplier. The *participant* replies either with an “*agree*” to inform the *initiator* that the query is received, or a “*refuse*” message is sent to terminate the communication. After an *agree* message, the *participant* sends the required information in an “*inform*” message (as a reply to the “if” or “reference” query), or a “*failure*” is sent when no data is available. In Chapter 5, the data that is sent in the *inform* messages includes the daily load profile onto which the EV agents should superimpose their charging demand.

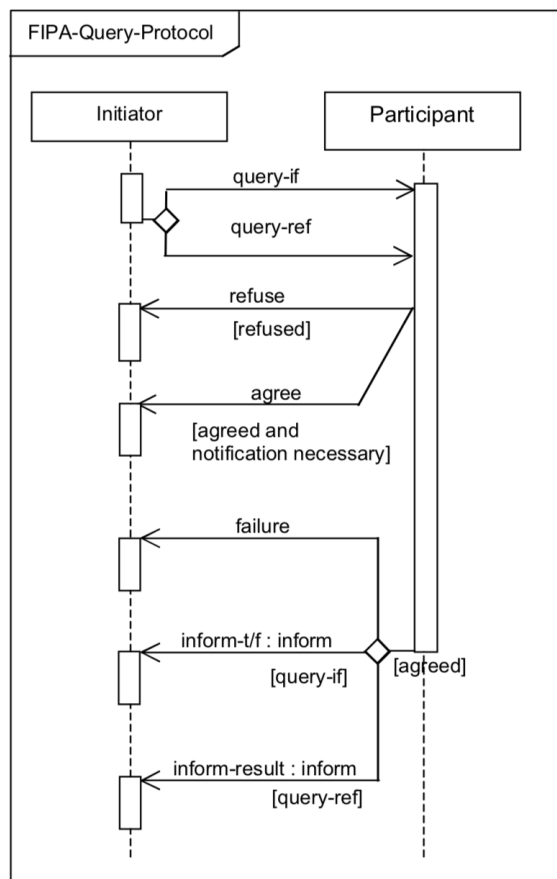


Figure B.1: FIPA Query Protocol flow chart

B.2.2 FIPA Brokering protocol

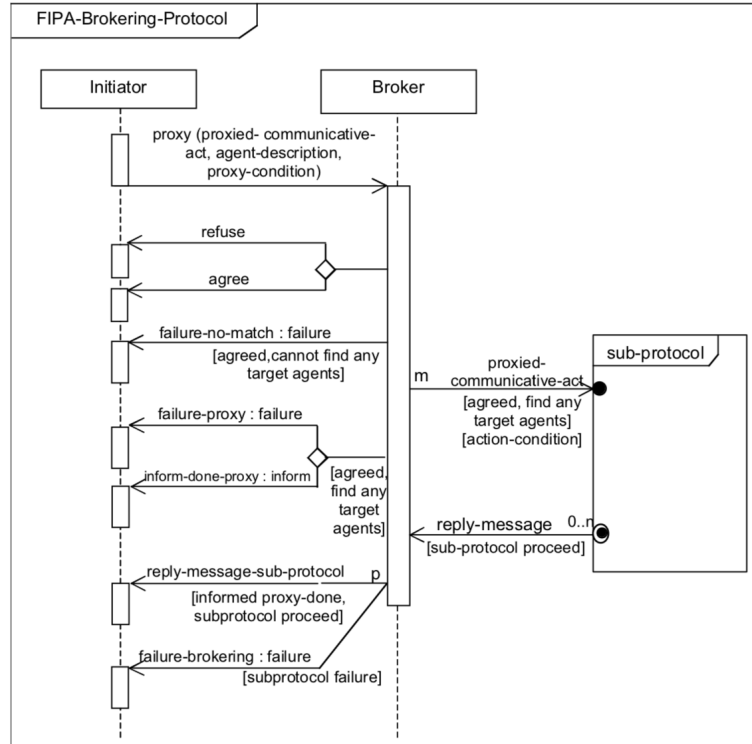


Figure B.2: FIPA Brokering Protocol flow chart

The brokering protocol, as shown in Figure B.2, is used to delegate an agents task to a different agent in order to free up its own computational resources. In Chapter 5 for instance, the load agents never communicate with the energy supplier directly, since the applying and undoing of power profiles is delegated to their brokering agents. The protocol is initiated by assigning a broker to a load agent by sending a “*proxy*” message. This message contains the required information for the broker, like the power profile a buying broker should apply. If the broker can fulfil this request, then an “*agree*” message is sent, otherwise a “*refuse*” message is sent. The broker uses the FIPA Query protocol, as explained in Section B.2.1, to obtain a list of broker agents that are linked to energy suppliers, which can be used to apply the load’s demand profile. However, if no such broker is found, then a “*failure*” (i.e. “no match”) message is sent. Alternatively, the broker begins its delegating task and it

forwards the requested demand profile to the corresponding energy supplier (i.e. it uses the FIPA ContractNet protocol as outlined in the next section, Section B.2.3). If an error occurs during this delegating process, then a “*failure*” message is sent (i.e. “proxy failure” or “inform failure”). Upon successful delegation, the broker replies to the “*Initiator*” with a “*reply*” message that contains information about the applied demand profile. Theoretically, this information can also contain pricing information, yet this feature was disregarded since it lies outside the scope of this thesis.

B.2.3 FIPA ContractNet Protocol

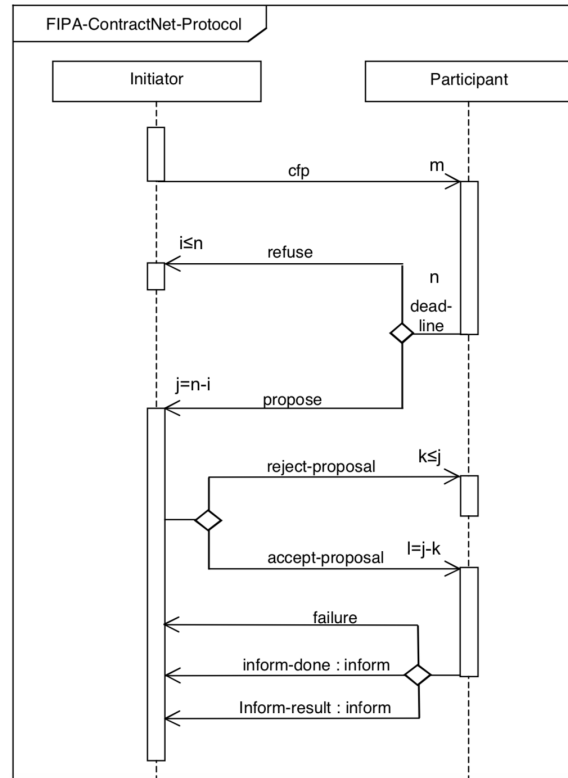


Figure B.3: FIPA ContractNet Protocol flow chart

Figure B.3 shows the FIPA ContractNet Protocol that allows an agent to negotiate a binding contract. After executing this dual handshake protocol, all contract participants are informed about the final contract decision and no information is lost during the message exchange. The protocol is initiated by an “*Initiator*”, who sends

a “*Call For Proposal*” (*cfp*) to m “*Participants*”. This *cfp* contains a deadline within which all agents that do want to participate should reply. They can reject their participation by sending a “*refuse*” message, or acknowledge their participation by sending a “*propose*” message that also contains proposition information (for example pricing information). Once all participants have replied or the deadline has expired, the *initiator* continues executing. It collects and assesses all proposals, chooses the accepted and rejected ones and, respectively, issues “*accept*” and “*reject*” notifications. The participating agents reply with an “*inform*” message if they acknowledge the “accept” or “reject” message, and in case of an error, they reply with a “failure” message.